

11333/1
NREAD
3 Apr 87

Mr. Wallace E. Venrick
Water Supply Branch
Division of Health Services
Post Office Box 2091
Raleigh, North Carolina 27602-2091

Dear Mr. Venrick:

Enclosures (1), (2) and (3) are the Trihalomethane analysis of the Hadnot Point (HP) Water Treatment Plant, ID No. 04-67-041 the Marine Corps Air Station (MCAS), New River Water Treatment Plant, ID No. 04-67-042, and the Holcomb Blvd (HB) Water Treatment Plant, ID No. 04-67-043. All samples were collected by the Environmental Chemistry and Microbiology Laboratory personnel and analyzed by Industrial and Environmental Analysts, Incorporated.

Point of contact in this matter is Ms. Elizabeth Setz, (919) 451-5977.

Sincerely,

J. I. WOOTEN, Director
Natural Resources Division
By direction of the Commanding General

Encls:

- (1) TTHM Analysis for HP
- (2) TTHM Analysis for MCAS
- (3) TTHM Analysis for HB

Copy to:
LANTDIV

Blind copy to:
EC & ML (2)
BMO (Util Dir)

11-11-52

Very faint, illegible text, possibly a letter or report, covering the upper half of the page.

Respectfully,
[Illegible Name]

Very faint, illegible text, possibly a signature or address block.

Very faint, illegible text, possibly a date or reference number.

Blind copy for
RC 2 (11/13)
me (11/13)

37720
C. Lab. ID



Industrial & Environmental Analysts, Inc
P.O. Box 12542 • Research Triangle Park, NC 27709 • 910-467-9000

WATER SYSTEM PERSONNEL TO COMPLETE ALL INFORMATION ABOVE HEAVY LINE

WATER SYSTEM INFORMATION

WATER SYSTEM ID# 04 - 67 - 041 TYPE OF SYSTEM:
 COMMUNITY () NON-COMMUNITY

SYSTEM NAME: HADNOT POINT SOURCE OF WATER:
 GROUND () BOTH
 SURFACE () PURCHASED

ADDRESS: COMMANDING GENERAL, MCB
CAMPLEJEUNE, NC ZIP 28542

COUNTY: ONSLOW TYPE OF TREATMENT:
 NONE LIME
 CHLORINATED () SODA ASH
 FLUORIDATED () POLYPHOSPHATE
 FILTERED WATER SOFTNER
 ALUM () OTHER

REPORT TO: AC/S FACILITIES (NREAD)

ADDRESS: SAME AS ABOVE ZIP _____

TELEPHONE: (919) 451-5977

SAMPLE INFORMATION

SOURCE OF SAMPLE TYPE OF SAMPLE

DISTRIBUTION TAP () HOUSE TAP D-REGULAR () M-M.R.T.
 PLANT TAP () WELL TAP () C-CHECK () S-SPECIAL

SAMPLING LOCATION (Address): BLDG FC-580

DATE COLLECTED: 17 MARCH 1987 TIME COLLECTED: 1220 am pm

COLLECTED BY: Env. Chem + Micro. LAB LOC. CODE: _____

FOR LABORATORY USE ONLY

STATE DRINKING WATER PARAMETERS

CONTAMINANT ID	NAME	METHOD	RESULTS mg/l	CONTAMINANT ID	NAME	METHOD	RESULTS mg/l
2005	Endrin	201	---	2941	Chloroform	215	0.011
2010	Lindane	201	---	2943	Bromodichloromethane	215	0.008
2015	Methoxychlor	201	---	2944	Chlorodibromomethane	215	0.005
2020	Toxaphene	201	---	2942	Bromoform	215	0.002
2105	2, 4-D	203	---	2950	Total THM	215	0.026
2110	2, 4, 5-TP	203	---				

DATE RECEIVED 03-19-87 DATE ANALYZED 03-24-87 REPORTED BY E. Folk
DATE EXTRACTED 03-24-87 DATE REPORTED 03-25-87 SAMPLE LAB 304-13-6

REMARKS:

ENCL (1)



INSTITUTIONAL USE ONLY

DATE OF BIRTH

SEX

EDUCATION

RELIGION

ETHNICITY

HEIGHT

WEIGHT

HAIR COLOR

EYES

SKIN TONE

TEETH

HEALTH HISTORY

ALLERGIES

PHYSICAL EXAM

LABORATORY TESTS

IMMUNIZATIONS

PHYSICIAN'S NOTES

PHYSICIAN'S SIGNATURE

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

LOCATION

REMARKS

INITIALS

DATE

TIME

3772
C. Lab. 1b



Industrial & Environmental Analysts, Inc.
P.O. Box 12542 • Research Triangle Park, NC 27709 • 919-467-9919

WATER SYSTEM PERSONNEL TO COMPLETE ALL INFORMATION ABOVE HEAVY LINE

WATER SYSTEM INFORMATION

WATER SYSTEM ID# 04 - 67 - 042 TYPE OF SYSTEM:
 COMMUNITY NON-COMMUNITY

SYSTEM NAME: NAVY CORPS AIR STATION SOURCE OF WATER:
 GROUND BOTH

ADDRESS: COMMANDING GENERAL MCB SURFACE PURCHASED
CAMP LEJEUNE, NC ZIP 28542

COUNTY: ONSONG TYPE OF TREATMENT:
 NONE LIME

REPORT TO: NAVY FACILITIES (NREAD) SODA ASH
 CHLORINATED POLYPHOSPHATE

ADDRESS: SAME AS ABOVE FLUORIDATED WATER SOFTNER
 ZIP _____ ALUM OTHER

TELEPHONE: (919) 451-5977

SAMPLE INFORMATION

SOURCE OF SAMPLE TYPE OF SAMPLE
 DISTRIBUTION TAP HOUSE TAP D-REGULAR M-M.R.T.
 PLANT TAP WELL TAP C-CHECK S-SPECIAL

SAMPLING LOCATION (Address): BLDG A5-110 WATER TREATMENT PLANT

DATE COLLECTED: 17 MARCH 1987 TIME COLLECTED: 1020 am pm

COLLECTED BY: ENV. CHEM + MICRO LAB LOC. CODE: _____

FOR LABORATORY USE ONLY


STATE DRINKING WATER PARAMETERS

CONTAMINANT ID	NAME	METHOD	RESULTS mg/l	CONTAMINANT ID	NAME	METHOD	RESULTS mg/l
2005	Endrin	201	---	2941	Chloroform	215	0.006
2010	Lindane	201	---	2943	Bromodichloromethane	215	0.008
2015	Methoxychlor	201	---	2944	Chlorodibromomethane	215	0.018
2020	Toxaphene	201	---	2942	Bromoform	215	0.036
2105	2, 4-D	203	---	2950	Total THM	215	0.068
2110	2, 4, 5-TP	203	---				

DATE RECEIVED 03-19-87 DATE ANALYZED 03-24-87 REPORTED BY E. Folk
 DATE EXTRACTED 03-24-87 DATE REPORTED 03-25-87 SAMPLE LAB 304-13-1

REMARKS:

Encl (2)

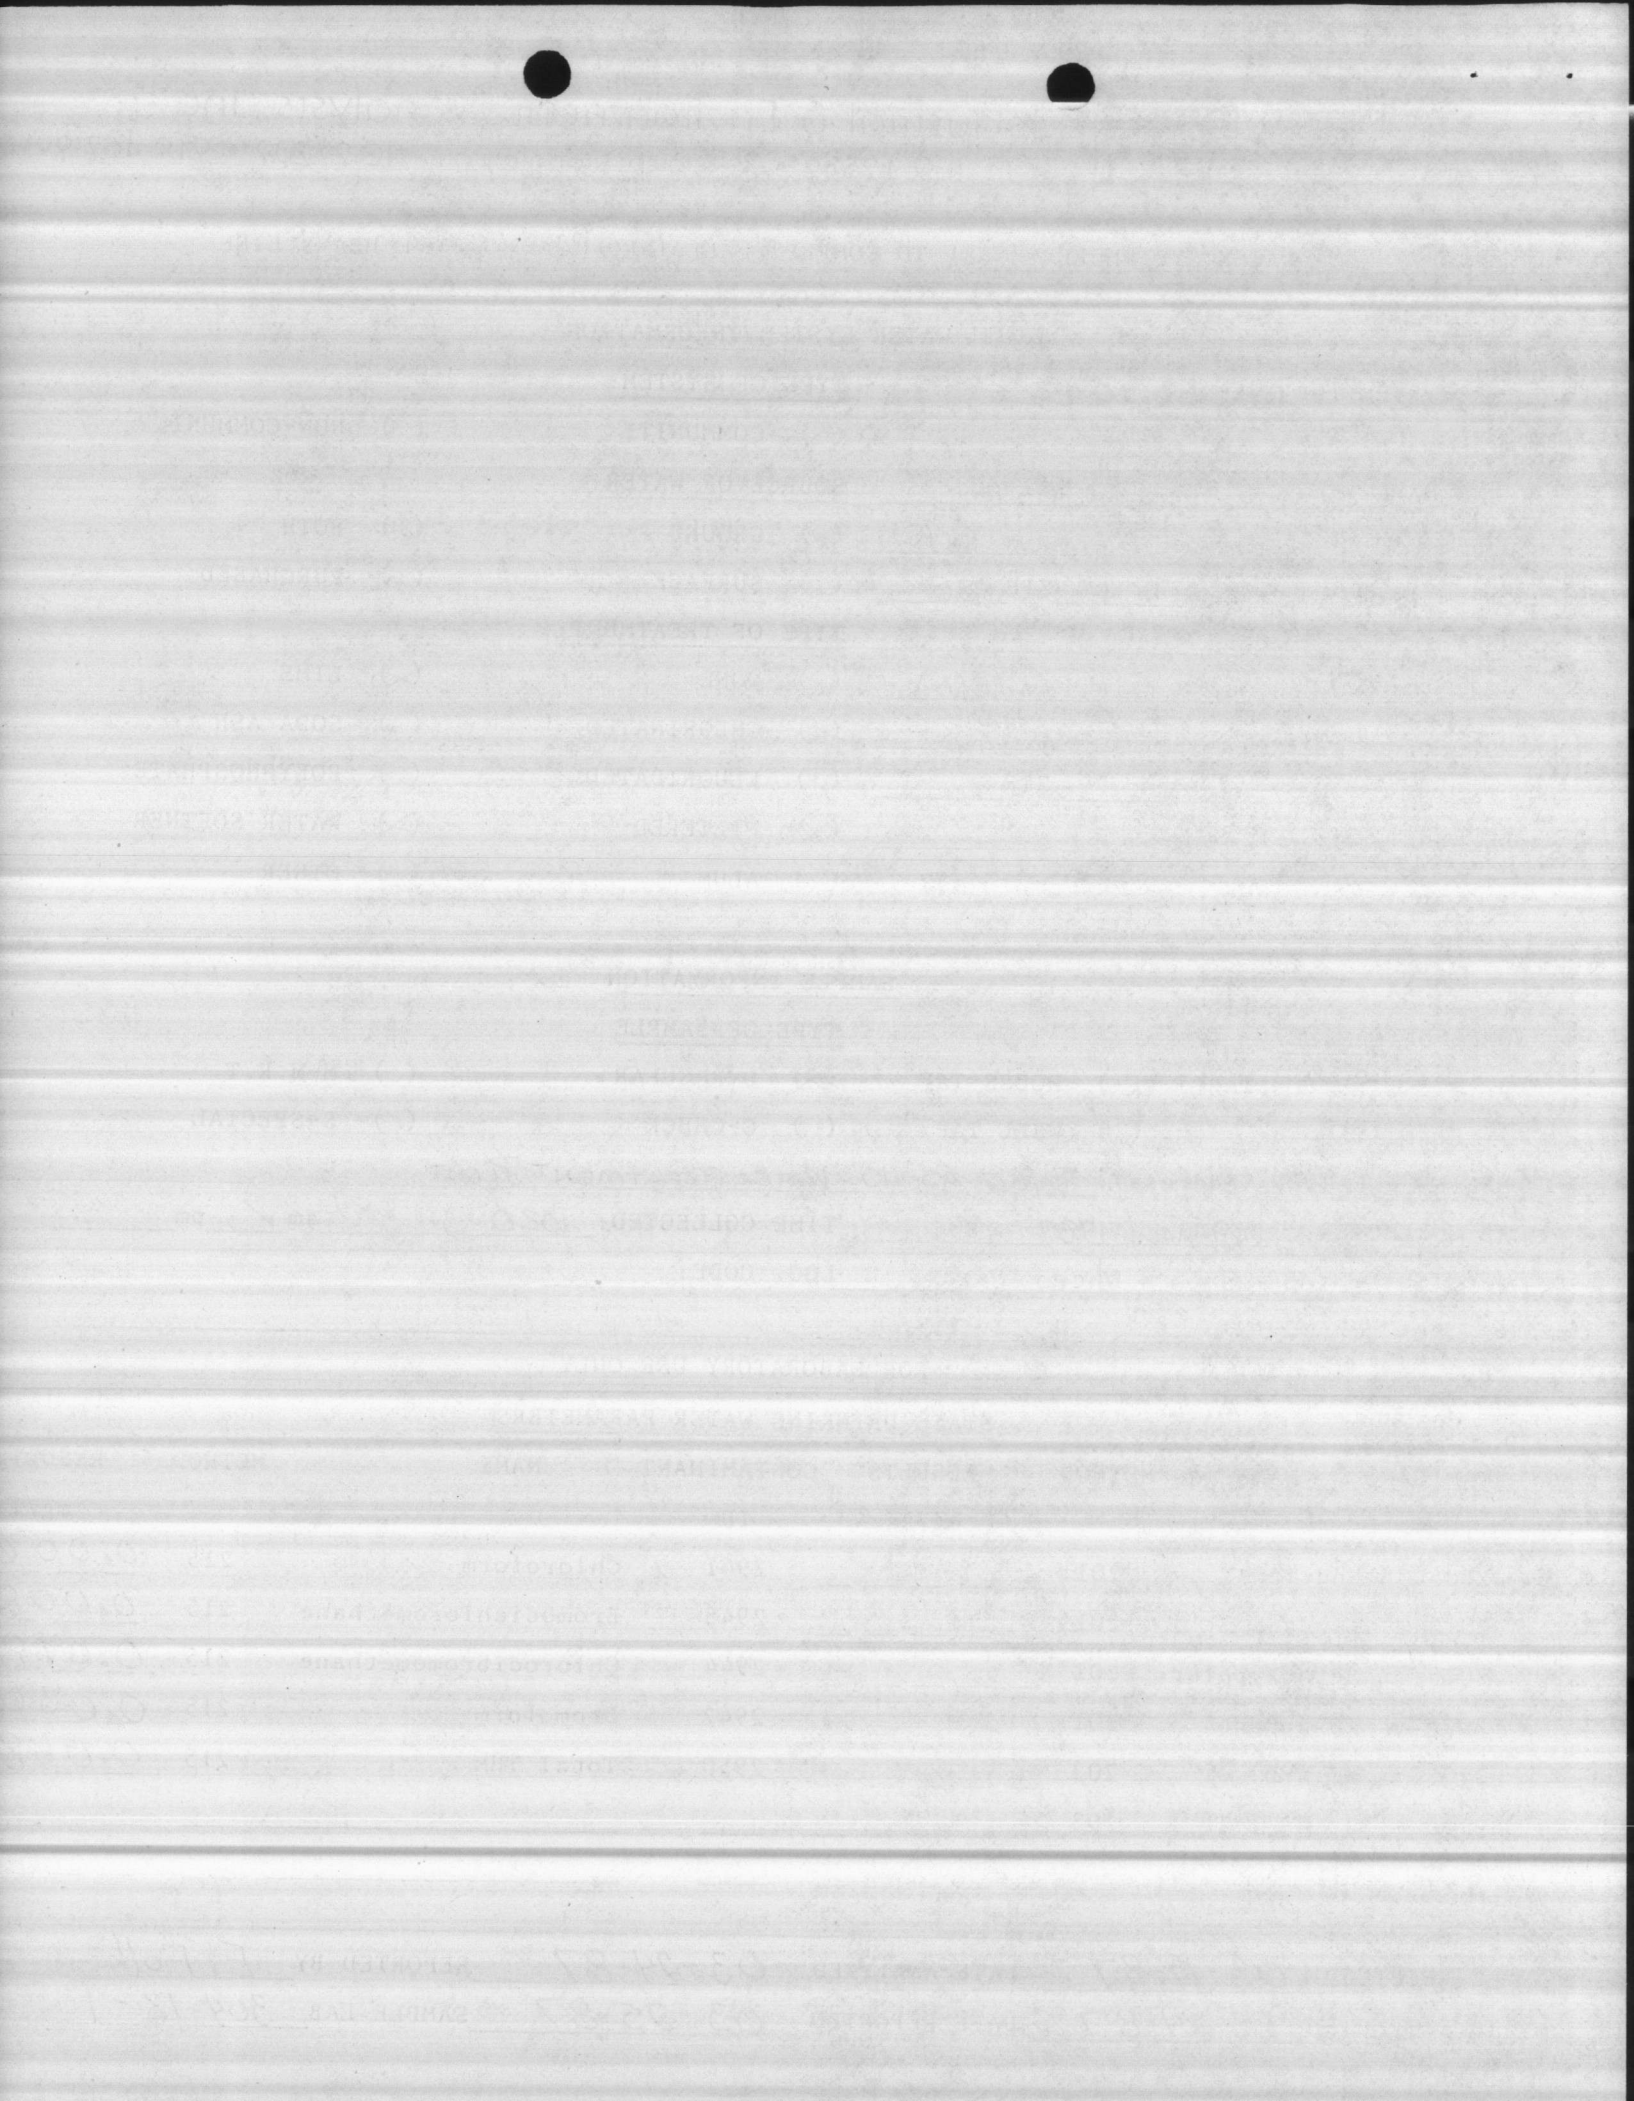

37780
C. Lab. ID



Industrial & Environmental Analysts, Inc.
P.O. Box 12542 • Research Triangle Park, NC, 27709 • 919-467-9919



WATER SYSTEM PERSONNEL TO COMPLETE ALL INFORMATION ABOVE HEAVY LINE

WATER SYSTEM INFORMATION

WATER SYSTEM ID# 04 - 67 - 042

TYPE OF SYSTEM:

COMMUNITY () NON-COMMUNITY

SYSTEM NAME: MINING CORPS AIR STATION

SOURCE OF WATER:

ADDRESS: COMMANDING GENERAL MCB

GROUND () BOTH

CAMP LEJEUNE, NC ZIP 28542

() SURFACE () PURCHASED

COUNTY: ONSLOW

TYPE OF TREATMENT:

REPORT TO: NO FACILITIES (NEED)

() NONE LIME

ADDRESS: STATE HWY ABOVE

CHLORINATED () SODA ASH

ZIP _____

() FLUORIDATED () POLYPHOSPHATE

TELEPHONE: (919) 451-5977

FILTERED WATER SOFTNER

() ALUM () OTHER

SAMPLE INFORMATION

SOURCE OF SAMPLE

TYPE OF SAMPLE

DISTRIBUTION TAP () HOUSE TAP

D-REGULAR () M-M.R.T.

() PLANT TAP () WELL TAP

() C-CHECK () S-SPECIAL

SAMPLING LOCATION (Address): A5-4025

DATE COLLECTED: 17 MARCH 1987

TIME COLLECTED: 1040 am pm

COLLECTED BY: ENV. CHEM + MICRO LAB

LOC. CODE: _____

FOR LABORATORY USE ONLY

STATE DRINKING WATER PARAMETERS

CONTAMINANT ID	NAME	METHOD	RESULTS mg/l	CONTAMINANT ID	NAME	METHOD	RESULTS mg/l
2005	Endrin	201	---	2941	Chloroform	215	0.010
2010	Lindane	201	---	2943	Bromodichloromethane	215	0.014
2015	Methoxychlor	201	---	2944	Chlorodibromomethane	215	0.031
2020	Toxaphene	201	---	2942	Bromoform	215	0.057
2105	2, 4-D	203	---	2950	Total THM	215	0.412
2110	2, 4, 5-TP	203	---				

DATE RECEIVED 03-19-87 DATE ANALYZED 03-24-87 REPORTED BY E. Follc
DATE EXTRACTED 03-24-87 DATE REPORTED 03-25-87 SAMPLE LAB 304-13-4

REMARKS:

ENCL (2)

HEAVY METALS

DATE: 10/15/88
TIME: 10:00 AM

SOURCE OF WATER: []

TYPE OF TREATMENT: []

USE OF WATER: []

TYPE OF TREATMENT: []

USE OF WATER: []

TYPE OF TREATMENT: []

USE OF WATER: []

TYPE OF TREATMENT: []

USE OF WATER: []

TYPE OF TREATMENT: []

USE OF WATER: []

TYPE OF TREATMENT: []

USE OF WATER: []

TYPE OF TREATMENT: []

USE OF WATER: []

TYPE OF TREATMENT: []

USE OF WATER: []

TYPE OF TREATMENT: []

USE OF WATER: []

TYPE OF TREATMENT: []



ENTER SYSTEM PERSONNEL TO COMPLETE ALL INFORMATION ABOVE HEAVY LINE

WATER SYSTEM INFORMATION

WATER SYSTEM ID# 04 - 67 - 042
TYPE OF SYSTEM: (X) COMMUNITY () NON-COMMUNITY
SYSTEM NAME: MARINE CORPS AIR STATION
SOURCE OF WATER: (X) GROUND () BOTH
ADDRESS: COMMANDING GENERAL MCB
COUNTY: ONSLow
TYPE OF TREATMENT: () NONE (X) LIME
PORT TO: A/C FACILITIES (NREAD)
ADDRESS: SAME AS ABOVE
TELEPHONE: (919) 451-5977
(X) CHLORINATED () SODA ASH
() SURFACE () PURCHASED
() FLUORIDATED () POLYPHOSPHATE
(X) FILTERED (X) WATER SOFTNER
() ALUM () OTHER

SAMPLE INFORMATION

SOURCE OF SAMPLE: (X) DISTRIBUTION TAP () HOUSE TAP (X) D-REGULAR () M-M.R.T.
() PLANT TAP () WELL TAP () C-CHECK () S-SPECIAL
SAMPLING LOCATION (Address): Bldg A3-705
DATE COLLECTED: 17 MARCH 1987 TIME COLLECTED: 11:35 am
COLLECTED BY: ENV. CHEM + MICRO LAB LOC. CODE:

FOR LABORATORY USE ONLY

STATE DRINKING WATER PARAMETERS

Table with columns: CONTAMINANT ID, NAME, METHOD, RESULTS mg/l, CONTAMINANT ID, NAME, METHOD, RESULTS mg/l. Rows include Endrin, Lindane, Methoxychlor, Toxaphene, 2, 4-D, 2, 4, 5-TP, Chloroform, Bromodichloromethane, Chlorodibromomethane, Bromoform, Total THM.

DATE RECEIVED 03-19-87 DATE ANALYZED 03-24-87 REPORTED BY E. Folk
DATE EXTRACTED 03-24-87 DATE REPORTED 03-25-87 SAMPLE LAB 304-13-2

MARKS:

ENCL (2)



FEDERAL BUREAU OF INVESTIGATION
 U. S. DEPARTMENT OF JUSTICE
 LABORATORY
 WASHINGTON, D. C. 20535

TYPE OF SAMPLE

DATE COLLECTED: 11-25-77

LABORATORY RESULT

1941	Chloroform	0.00%
1942	Bromochloroethane	0.01%
1943	Chloroacetylene	0.00%
1944	Bromocloroethane	0.00%
1945	Chloroform	0.00%

REPORT BY: G. H. ...
 SAMPLE NO. 20118



Industrial & Environmental Analysts, Inc.

P.O. Box 12542 • Research Triangle Park, NC 27709 • 919-467-9919



WATER SYSTEM PERSONNEL TO COMPLETE ALL INFORMATION ABOVE HEAVY LINE

WATER SYSTEM INFORMATION

WATER SYSTEM ID# 04 - 67 - 042 TYPE OF SYSTEM:
 COMMUNITY () NON-COMMUNITY
 SYSTEM NAME: MINING CORPS AIR STATION SOURCE OF WATER:
 ADDRESS: COMMANDING GENERAL MCB GROUND () BOTH
CAMP LEJEUNE, NC ZIP 28542 () SURFACE () PURCHASED
 COUNTY: ONKLOW TYPE OF TREATMENT:
 REPORT TO: NC'S FACILITIES (NREAD) () NONE LIME
 ADDRESS: SAME AS ABOVE CHLORINATED () SODA ASH
 ZIP _____ () FLUORIDATED () POLYPHOSPHATE
 TELEPHONE: (919) 451-5977 FILTERED WATER SOFTNER
 () ALUM () OTHER

SAMPLE INFORMATION

SOURCE OF SAMPLE TYPE OF SAMPLE
 DISTRIBUTION TAP () HOUSE TAP D-REGULAR () M-M.R.T.
 PLANT TAP () WELL TAP () C-CHECK () S-SPECIAL
 SAMPLING LOCATION (Address): BLDG G-520
 DATE COLLECTED: 17 MARCH 1987 TIME COLLECTED: 1145 am pm
 COLLECTED BY: ENV. CHEM + MICRO LAB LOC. CODE: _____

FOR LABORATORY USE ONLY

STATE DRINKING WATER PARAMETERS

CONTAMINANT ID	NAME	METHOD	RESULTS mg/l	CONTAMINANT ID	NAME	METHOD	RESULTS mg/l
2005	Endrin	201	---	2941	Chloroform	215	<u>0.007</u>
2010	Lindane	201	---	2943	Bromodichloromethane	215	<u>0.012</u>
2015	Methoxychlor	201	---	2944	Chlorodibromomethane	215	<u>0.025</u>
2020	Toxaphene	201	---	2942	Bromoform	215	<u>0.048</u>
2105	2, 4-D	203	---	2950	Total THM	215	<u>0.092</u>
2110	2, 4, 5-TP	203	---				

DATE RECEIVED 03-19-87 DATE ANALYZED 03-24-87 REPORTED BY E. Folk
 DATE EXTRACTED 03-24-87 DATE REPORTED 03-25-87 SAMPLE LAB 304-13-7

REMARKS:

ENCL (2)



QUALITY CONTROL
 REPORT FOR
 WATER SUPPLY

TEST RESULTS

TEST NO.	TEST NAME	RESULT	UNIT
1	PH	7.2	
2	TOTAL HARDNESS	120	MG/L
3	CALCIUM	60	MG/L
4	MAGNESIUM	60	MG/L
5	CHLORIDE	15	MG/L
6	SULFATE	10	MG/L
7	AMMONIA NITROGEN	0.5	MG/L
8	NITRATE NITROGEN	1.0	MG/L
9	PERMANGANATE INDEX	2.5	MG/L
10	TOTAL SOLIDS	200	MG/L
11	DISSOLVED SOLIDS	150	MG/L
12	SUSPENDED SOLIDS	50	MG/L

DATE: 10/15/2023

ANALYST: J. SMITH

LABORATORY USE ONLY

STATE DEPARTMENT OF HEALTH

LABORATORY NO. 12345

TEST NAME	RESULT	UNIT
1.0	120	MG/L
2.0	60	MG/L
3.0	60	MG/L
4.0	15	MG/L
5.0	10	MG/L
6.0	0.5	MG/L
7.0	1.0	MG/L
8.0	2.5	MG/L
9.0	200	MG/L
10.0	150	MG/L
11.0	50	MG/L

REPORTED BY: J. SMITH

Lab. ID



Industrial & Environmental Analysts, Inc.
P.O. Box 12542 • Research Triangle Park, NC 27709 • 919-467-9919



WATER SYSTEM PERSONNEL TO COMPLETE ALL INFORMATION ABOVE HEAVY LINE

WATER SYSTEM INFORMATION

WATER SYSTEM ID# 04-67-042 TYPE OF SYSTEM:
 COMMUNITY NON-COMMUNITY

SYSTEM NAME: WINNIE CORPS AIR STATION SOURCE OF WATER:
 GROUND BOTH
 SURFACE PURCHASED

ADDRESS: COMMANDING GENERAL MCB
CAMP LEJEUNE, NC ZIP 28542

COUNTY: ONCO TYPE OF TREATMENT:
 NONE LIME
 CHLORINATED SODA ASH
 FLUORIDATED POLYPHOSPHATE

PORT TO: WATER FACILITIES (NREAD)
 FILTERED WATER SOFTNER
 ALUM OTHER

ADDRESS: PO BOX 100 ABOVE ZIP _____

TELEPHONE: (919) 451-5977

SAMPLE INFORMATION

SOURCE OF SAMPLE TYPE OF SAMPLE
 DISTRIBUTION TAP HOUSE TAP D-REGULAR M-M.R.T.
 PLANT TAP WELL TAP C-CHECK S-SPECIAL

SAMPLING LOCATION (Address): BLDG AS-2800

DATE COLLECTED: 17 MARCH 1987 TIME COLLECTED: 1055 am pm

COLLECTED BY: ENV. CHEM + MICRO LAB LOC. CODE: _____

FOR LABORATORY USE ONLY

STATE DRINKING WATER PARAMETERS

CONTAMINANT ID	NAME	METHOD	RESULTS mg/l	CONTAMINANT ID	NAME	METHOD	RESULTS mg/l
2005	Endrin	201	_____	2941	Chloroform	215	<u>0.008</u>
2010	Lindane	201	_____	2943	Bromodichloromethane	215	<u>0.016</u>
2015	Methoxychlor	201	_____	2944	Chlorodibromomethane	215	<u>0.036</u>
2020	Toxaphene	201	_____	2942	Bromoform	215	<u>0.064</u>
2105	2, 4-D	203	_____	2950	Total THM	215	<u>0.124</u>
2110	2, 4, 5-TP	203	_____				_____

DATE RECEIVED 03-19-87 DATE ANALYZED 03-24-87 REPORTED BY E. Folk
DATE EXTRACTED 03-24-87 DATE REPORTED 03-25-87 SAMPLE LAB 304-13-3

REMARKS:

ENCL (2)

NO. 100-100000-100000

LABORATORY OF
COMMUNITY HEALTH

DATE: 10/10/10

TYPE OF TEST: WATER SAMPLE

TYPE OF SAMPLE: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

TYPE OF ANALYSIS: WATER SAMPLE

37720
C. Lab. ID



Industrial & Environmental Analysts, Inc.
P.O. Box 12542 • Research Triangle Park, NC 27709 • 919-867-9000



WATER SYSTEM PERSONNEL TO COMPLETE ALL INFORMATION ABOVE HEAVY LINE

WATER SYSTEM INFORMATION

WATER SYSTEM ID# 04 - 67 - 043 TYPE OF SYSTEM:
 COMMUNITY () NON-COMMUNITY

SYSTEM NAME: HOLCOMB BLVD SOURCE OF WATER:
 GROUND () BOTH
 ADDRESS: COMMANDING GENERAL, MCB
CAMP LEJUNE, NC ZIP 28542 () SURFACE () PURCHASED

COUNTY: ONSLow TYPE OF TREATMENT:
 REPORT TO: AC/S FACILITIES (NREAD) () NONE LIME
 ADDRESS: SAME AS ABOVE CHLORINATED () SODA ASH
 ZIP _____ FLUORIDATED () POLYPHOSPHATE
 TELEPHONE: (919) 451-5977 FILTERED WATER SOFTNER
 () ALUM () OTHER

SAMPLE INFORMATION

SOURCE OF SAMPLE TYPE OF SAMPLE
 DISTRIBUTION TAP () HOUSE TAP D-REGULAR () M-M.R.T.
 PLANT TAP () WELL TAP () C-CHECK () S-SPECIAL

SAMPLING LOCATION (Address): BLDG 670, WATER TREATMENT PLANT

DATE COLLECTED: 17 MARCH 1987 TIME COLLECTED: 0945 am pm

COLLECTED BY: ENV. CHEM + MICRO. LAB LOC. CODE: _____

FOR LABORATORY USE ONLY

STATE DRINKING WATER PARAMETERS

CONTAMINANT ID	NAME	METHOD	RESULTS mg/l	CONTAMINANT ID	NAME	METHOD	RESULTS mg/l
2005	Endrin	201	---	2941	Chloroform	215	0.008
2010	Lindane	201	---	2943	Bromodichloromethane	215	0.003
2015	Methoxychlor	201	---	2944	Chlorodibromomethane	215	0.002
2020	Toxaphene	201	---	2942	Bromoform	215	<0.001
2105	2, 4-D	203	---	2950	Total THM	215	0.013
2110	2, 4, 5-TP	203	---				

DATE RECEIVED 03-19-87 DATE ANALYZED 03-24-87 REPORTED BY E. Folk
 DATE EXTRACTED 03-24-87 DATE REPORTED 03-25-87 SAMPLE LAB 304-13-5

REMARKS:

Encl (3)



11-11-54

IDENTIFICATION

STATE OF TEXAS

COUNTY OF DALLAS

CITY OF DALLAS

BY: _____

CLERK OF DISTRICT COURT

FOR DEPOSIT

IN THE

CASE OF

NO. _____

VS. _____

FILED

THIS _____ DAY OF _____

AT DALLAS, TEXAS

1954

BY: _____

CLERK OF DISTRICT COURT

FILE OF RECORD

NO. _____

FILED

THIS _____ DAY OF _____

AT DALLAS, TEXAS

1954

FOR LABORATORY USE ONLY

NO. _____

FILED

THIS _____ DAY OF _____

AT DALLAS, TEXAS

1954

BY: _____

CLERK OF DISTRICT COURT

FILED

THIS _____ DAY OF _____

AT DALLAS, TEXAS

1954