

TT-38 WATER TREATMENT PLANT

DELIVERED WATER FLOW FOR 12 MONTH PERIOD

JANUARY	27,750 GALS.	HIGH DAY	950,000 GALS.
FEBRUARY	28,480	"	981,000
MARCH	25,187	"	988,000
APRIL	26,832	"	1,072,000
MAY	26,138	"	977,000
JUNE	29,561	"	1,056,000
JULY	29,786	"	1,128,000
AUGUST	27,866	"	954,000
SEPTEMBER	26,915	"	1,083,000
OCTOBER	31,320	"	1,012,000
NOVEMBER	23,174	"	986,000
DECEMBER	24,080	"	892,000

M-178 WATER TREATMENT PLANT

JANUARY	12,878	"	498,000
FEBRUARY	13,304	"	488,000
MARCH	12,322	"	488,000
APRIL	12,278	"	527,000
MAY	14,279	"	596,000
JUNE	13,774	"	554,000
JULY	12,301	"	604,000
AUGUST	13,884	"	623,000
SEPTEMBER	14,651	"	539,000
OCTOBER	12,466	"	529,000
NOVEMBER	11,749	"	661,000
DECEMBER	11,065	"	432,000

WELL CAPACITY AT THE WELL

<u>WELL #</u>	<u>ORIGINAL</u>	<u>PRESENT</u>
TT-26	200	175
TT-30	100	70
TT-31	145	125
TT-52	300	200
TT-53	350	75
TT-54	200	170
TT-67	168	140
TOTAL	<u>1463</u>	<u>955</u>
M-142	100	70
M-168	100	50
M-197	155	130
M-243	150	CAVED
M-628	130	80
M-629	150	140
M-630	<u>150</u>	<u>140</u>
TOTAL	<u>935</u>	<u>620</u>

WATER TREATMENT PLANT

WATER FLOWDATE JANUARY 1980

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY/ DAY	TREATMENT
HADNOT POINT	107,530	101,340	6,184	3,600	13	5,900	5,000	LIME
HOLCOMB BLVD.	27,071	25,918	1,150	1,103	3	2,304	2,000	LIME
TARAWA TERRACE	29,005	28,107	893	1,215	3	1,152	1,000	LIME
MONTFORD POINT	5,573	5,121	449	382	3	622	750	ZEOLITE
MCAS (H)	35,015	32,493	2,520	1,400	3	4,081	3,500	LIME
RIFLE RANGE	6,346	5,671	673	162	3	648	600	ZEOLITE
CGA-5 (EST)	-----	-----	-----	-----	-	288	288	CHLORINE
COURTHOUSE BAY	12,851	12,043	806	452	3	864	600	ZEOLITE
ONslow BEACH	2,805	2,663	142	96	3	250	250	ZEOLITE

WATER IN MILLION GALS.

REMARKS:

Water was fed from Tarawa Terrace to Montford Point Plant from 1-8-80 thru 1-16-80 and from

1-22-80 thru 1-24-80.

REVENUE

VALLEY IN REVENUE 1912

CHURCH REVENUE					13	120	120	NEGATIVE
COLLEGE REVENUE					3	300	300	NEGATIVE
CHURCH (SEE)					1	50	50	NEGATIVE
CHURCH REVENUE					3	120	120	NEGATIVE
CHURCH (SEE)					3	1,000	1,000	POSITIVE
HOSPITAL BOARD					1	50	50	NEGATIVE
CHURCH REVENUE					3	1,125	1,125	POSITIVE
HOSPITAL BOARD					3	1,200	1,200	POSITIVE
HOSPITAL BOARD					13	1,200	1,200	POSITIVE
REVENUE	DEBITED	DEBITED	REVENUE	REVENUE	VALLEY REVENUE	ALSO DVA	DVA	REVENUE
			REVENUE	REVENUE	REVENUE	REVENUE	REVENUE	REVENUE

VALLEY IN REVENUE 1912

VALLEY REVENUE

DATE

WATER TREATMENT PLANT

WATER FLOW

DATE **FEBRUARY 1980**

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	117,982	112,194	5,785	4,464	13	5,900	5,000	LIME
HOLCOMB BLVD.	24,858	23,779	1,076	1,132	3	2,304	2,000	LIME
TARAWA TERRACE	20,643	19,806	853	861	3	1,152	1,000	LIME
MONTFORD POINT	9,609	9,200	406	384	3	622	750	ZEOLITE
MCAS (H)	27,864	25,557	2,304	1,065	3	4,081	3,500	LIME
RIFLE RANGE	5,333	4,689	644	179	3	648	600	ZEOLITE
COURTHOUSE BAY	12,434	11,679	752	452	3	864	600	ZEOLITE
ONSIOW BEACH	2,346	2,234	110	116	3	250	250	ZEOLITE

WATER IN MILLION GALS.

209,138,000

REMARKS:

1' 20"	1' 20"	1' 20"	1' 20"
2' 20"	2' 20"	2' 20"	2' 20"
3' 20"	3' 20"	3' 20"	3' 20"
4' 20"	4' 20"	4' 20"	4' 20"
5' 20"	5' 20"	5' 20"	5' 20"
6' 20"	6' 20"	6' 20"	6' 20"
7' 20"	7' 20"	7' 20"	7' 20"
8' 20"	8' 20"	8' 20"	8' 20"
9' 20"	9' 20"	9' 20"	9' 20"
10' 20"	10' 20"	10' 20"	10' 20"

WATER TREATMENT PLANT

WATER FLOW

DATE **MARCH 1980**

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	113,740	107,550	6,184	4,716	13	5,900	5,000	LIME
HOLCOMB BLVD.	26,464	25,331	1,130	1,383	3	2,304	2,000	LIME
TARAWA TERRACE	25,991	25,095	893	1,118	3	1,152	1,000	LIME
MONTFORD POINT	8,023	7,632	388	503	3	622	750	ZEOLITE
MCAS (H)	37,174	35,251	1,920	2,134	3	4,081	3,500	LIME
RIFLE RANGE	4,908	4,205	698	195	3	648	600	ZEOLITE
COURTHOUSE BAY	12,796	11,976	817	492	3	864	600	ZEOLITE
ONSLOW BEACH	2,953	2,810	141	100	3	250	250	ZEOLITE

WATER IN MILLION GALS.

219,850,000

REMARKS :

10' 00"	10' 00"	10' 00"	10' 00"
11' 00"	11' 00"	11' 00"	11' 00"
12' 00"	12' 00"	12' 00"	12' 00"
13' 00"	13' 00"	13' 00"	13' 00"
14' 00"	14' 00"	14' 00"	14' 00"
15' 00"	15' 00"	15' 00"	15' 00"
16' 00"	16' 00"	16' 00"	16' 00"
17' 00"	17' 00"	17' 00"	17' 00"
18' 00"	18' 00"	18' 00"	18' 00"
19' 00"	19' 00"	19' 00"	19' 00"
20' 00"	20' 00"	20' 00"	20' 00"

WATER TREATMENT PLANT

WATER FLOW

DATE **APRIL 1980**

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	107,025	101,037	5,985	3,708	13	5,900	5,000	LIME
HOLCOMB BLVD.	27,240	26,122	1,113	1,390	3	2,304	2,000	LIME
TARAWA TERRACE	20,599	19,728	864	1,049	3	1,152	1,000	LIME
MONTFORD POINT	7,182	6,805	375	295	3	622	750	ZEOLITE
MCAS (H)	35,372	33,016	2,352	1,113	3	4,081	3,500	LIME
RIFLE RANGE	5,405	4,731	671	154	3	648	600	ZEOLITE
COURTHOUSE BAY	11,766	11,013	751	428	3	864	600	ZEOLITE
ONSLOW BEACH	2,667	2,551	111	104	3	250	250	ZEOLITE

WATER IN MILLION GALS.

205,003,000

REMARKS :

Faint, illegible text, possibly bleed-through from the reverse side of the page.

Faint, illegible text, possibly bleed-through from the reverse side of the page.

WATER TREATMENT PLANT

WATER FLOW

DATE MAY 1980

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	100,422	95,688	4,730	3,618	13	5,900	5,000	LIME
HOLCOMB BLVD.	33,101	32,304	811	1,384	3	2,304	2,000	LIME
TARAWA TERRACE	22,273	21,321	893	868	3	1,152	1,000	LIME
MONTFORD POINT	7,902	7,318	581	368	3	622	750	ZEOLITE
MCAS (H)	38,361	35,670	2,688	1,321	3	4,081	3,500	LIME
RIFLE RANGE	5,423	4,810	680	186	3	648	600	ZEOLITE
COURTHOUSE BAY	11,762	10,961	760	475	3	864	600	ZEOLITE
ONSLow BEACH	2,668	2,546	119	130	3	250	250	ZEOLITE

WATER IN MILLION GALS.

210,688,000

REMARKS:

~~WASH WATER IS ESTIMATED~~

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

11-11-12

WATER TREATMENT PLANT

WATER FLOW

DATE JUNE 1980

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	101,519	95,508	5,985	3,600	13	5,900	5,000	LIME
HOLCOMB BLVD.	36,644	35,521	1,113	1,829	3	2,304	2,000	LIME
TARAWA TERRACE	23,752	22,530	989	1,075	3	1,152	1,000	LIME
MONTFORD POINT	7,014	6,414	574	278	3	622	750	ZEOLITE
MCAS (H)	36,116	33,652	2,448	1,256	3	4,081	3,500	LIME
RIFLE RANGE	6,349	5,678	665	261	3	648	600	ZEOLITE
COURTHOUSE BAY	11,879	10,944	842	409	3	864	600	ZEOLITE
ONSLOW BEACH	3,010	2,936	119	222	3	250	250	ZEOLITE

WATER IN MILLION GALS.

213,183,000

REMARKS :

THE UNIVERSITY OF CHICAGO

PHYSICS DEPARTMENT

RESEARCH REPORT

NO. 1234

BY J. D. JONES

1955

WATER TREATMENT PLANT

WATER FLOW


DATE **JULY 1980**

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	116,984	110,798	6,184	3,348	13	5,900	5,000	LIME
HOLCOMB BLVD.	33,712	32,559	1,150	1,449	3	2,304	2,000	LIME
TARAWA TERRACE	28,066	27,162	893	868	3	1,152	1,000	LIME
MONTFORD POINT	7,407	6,776	627	286	3	622	750	ZEOLITE
MCAS (H)'	35,345	33,508	2,832	1,279	3	4,081	3,500	LIME
RIFLE RANGE	6,624	5,911	709	243	3	648	600	ZEOLITE
COURTHOUSE BAY	11,512	10,760	749	456	3	864	600	ZEOLITE
ONSIOW BEACH	2,807	2,683	121	233	3	250	250	ZEOLITE

WATER IN MILLION GALS.

230,157,000

REMARKS:

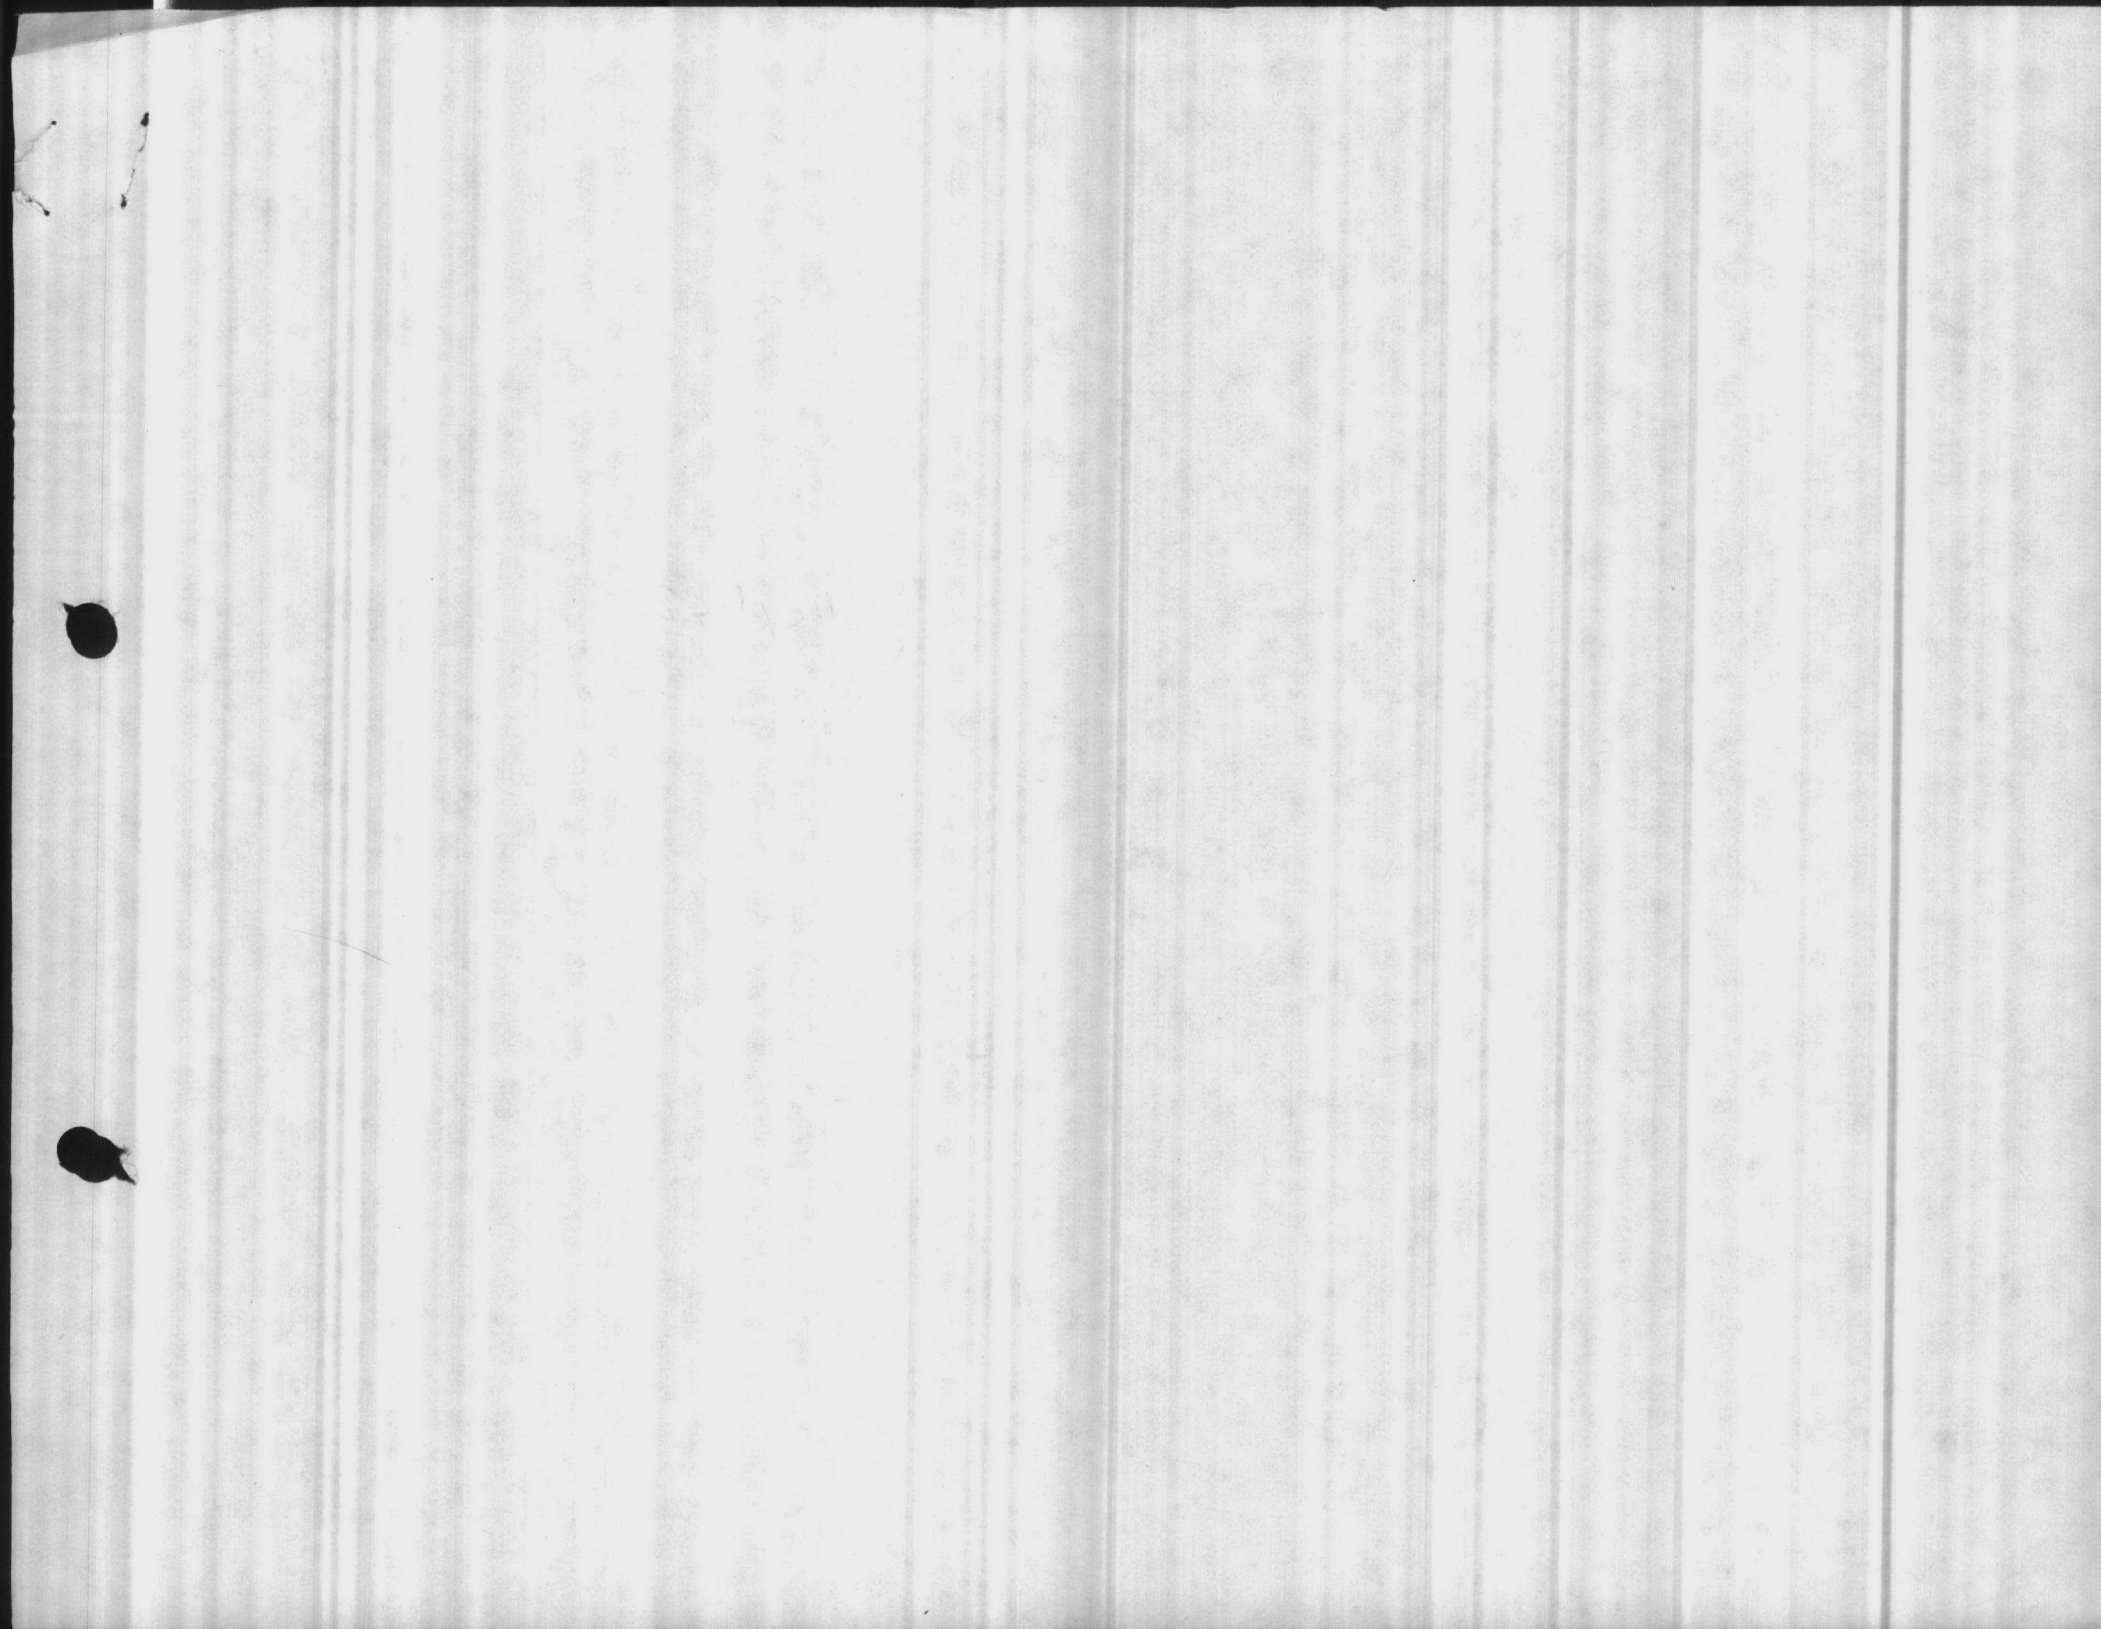

WATER TREATMENT PLANT

WATER FLOW


DATE **Aug. 1980**

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	100,062	95,112	4,948	3,600	13	5,900	5,000	LIME
HOLCOMB BLVD.	42,590	41,435	1,150	1,902	3	2,304	2,000	LIME
TARAWA TERRACE	25,061	24,027	989	884	3	1,152	1,000	LIME
MONTFORD POINT	8,391	7,690	607	307	3	622	750	ZEOLITE
MCAS (H)	42,178	39,682	2,496	1,200	3	4,081	3,500	LIME
RIFLE RANGE	6,319	5,567	752	213	3	648	600	ZEOLITE
COURTHOUSE BAY	13,371	12,590	781	445	3	864	600	ZEOLITE
ONSLow BEACH	3,594	3,577	160	168	3	250	250	ZEOLITE

WATER IN MILLION GALS.

227,680,000

REMARKS:

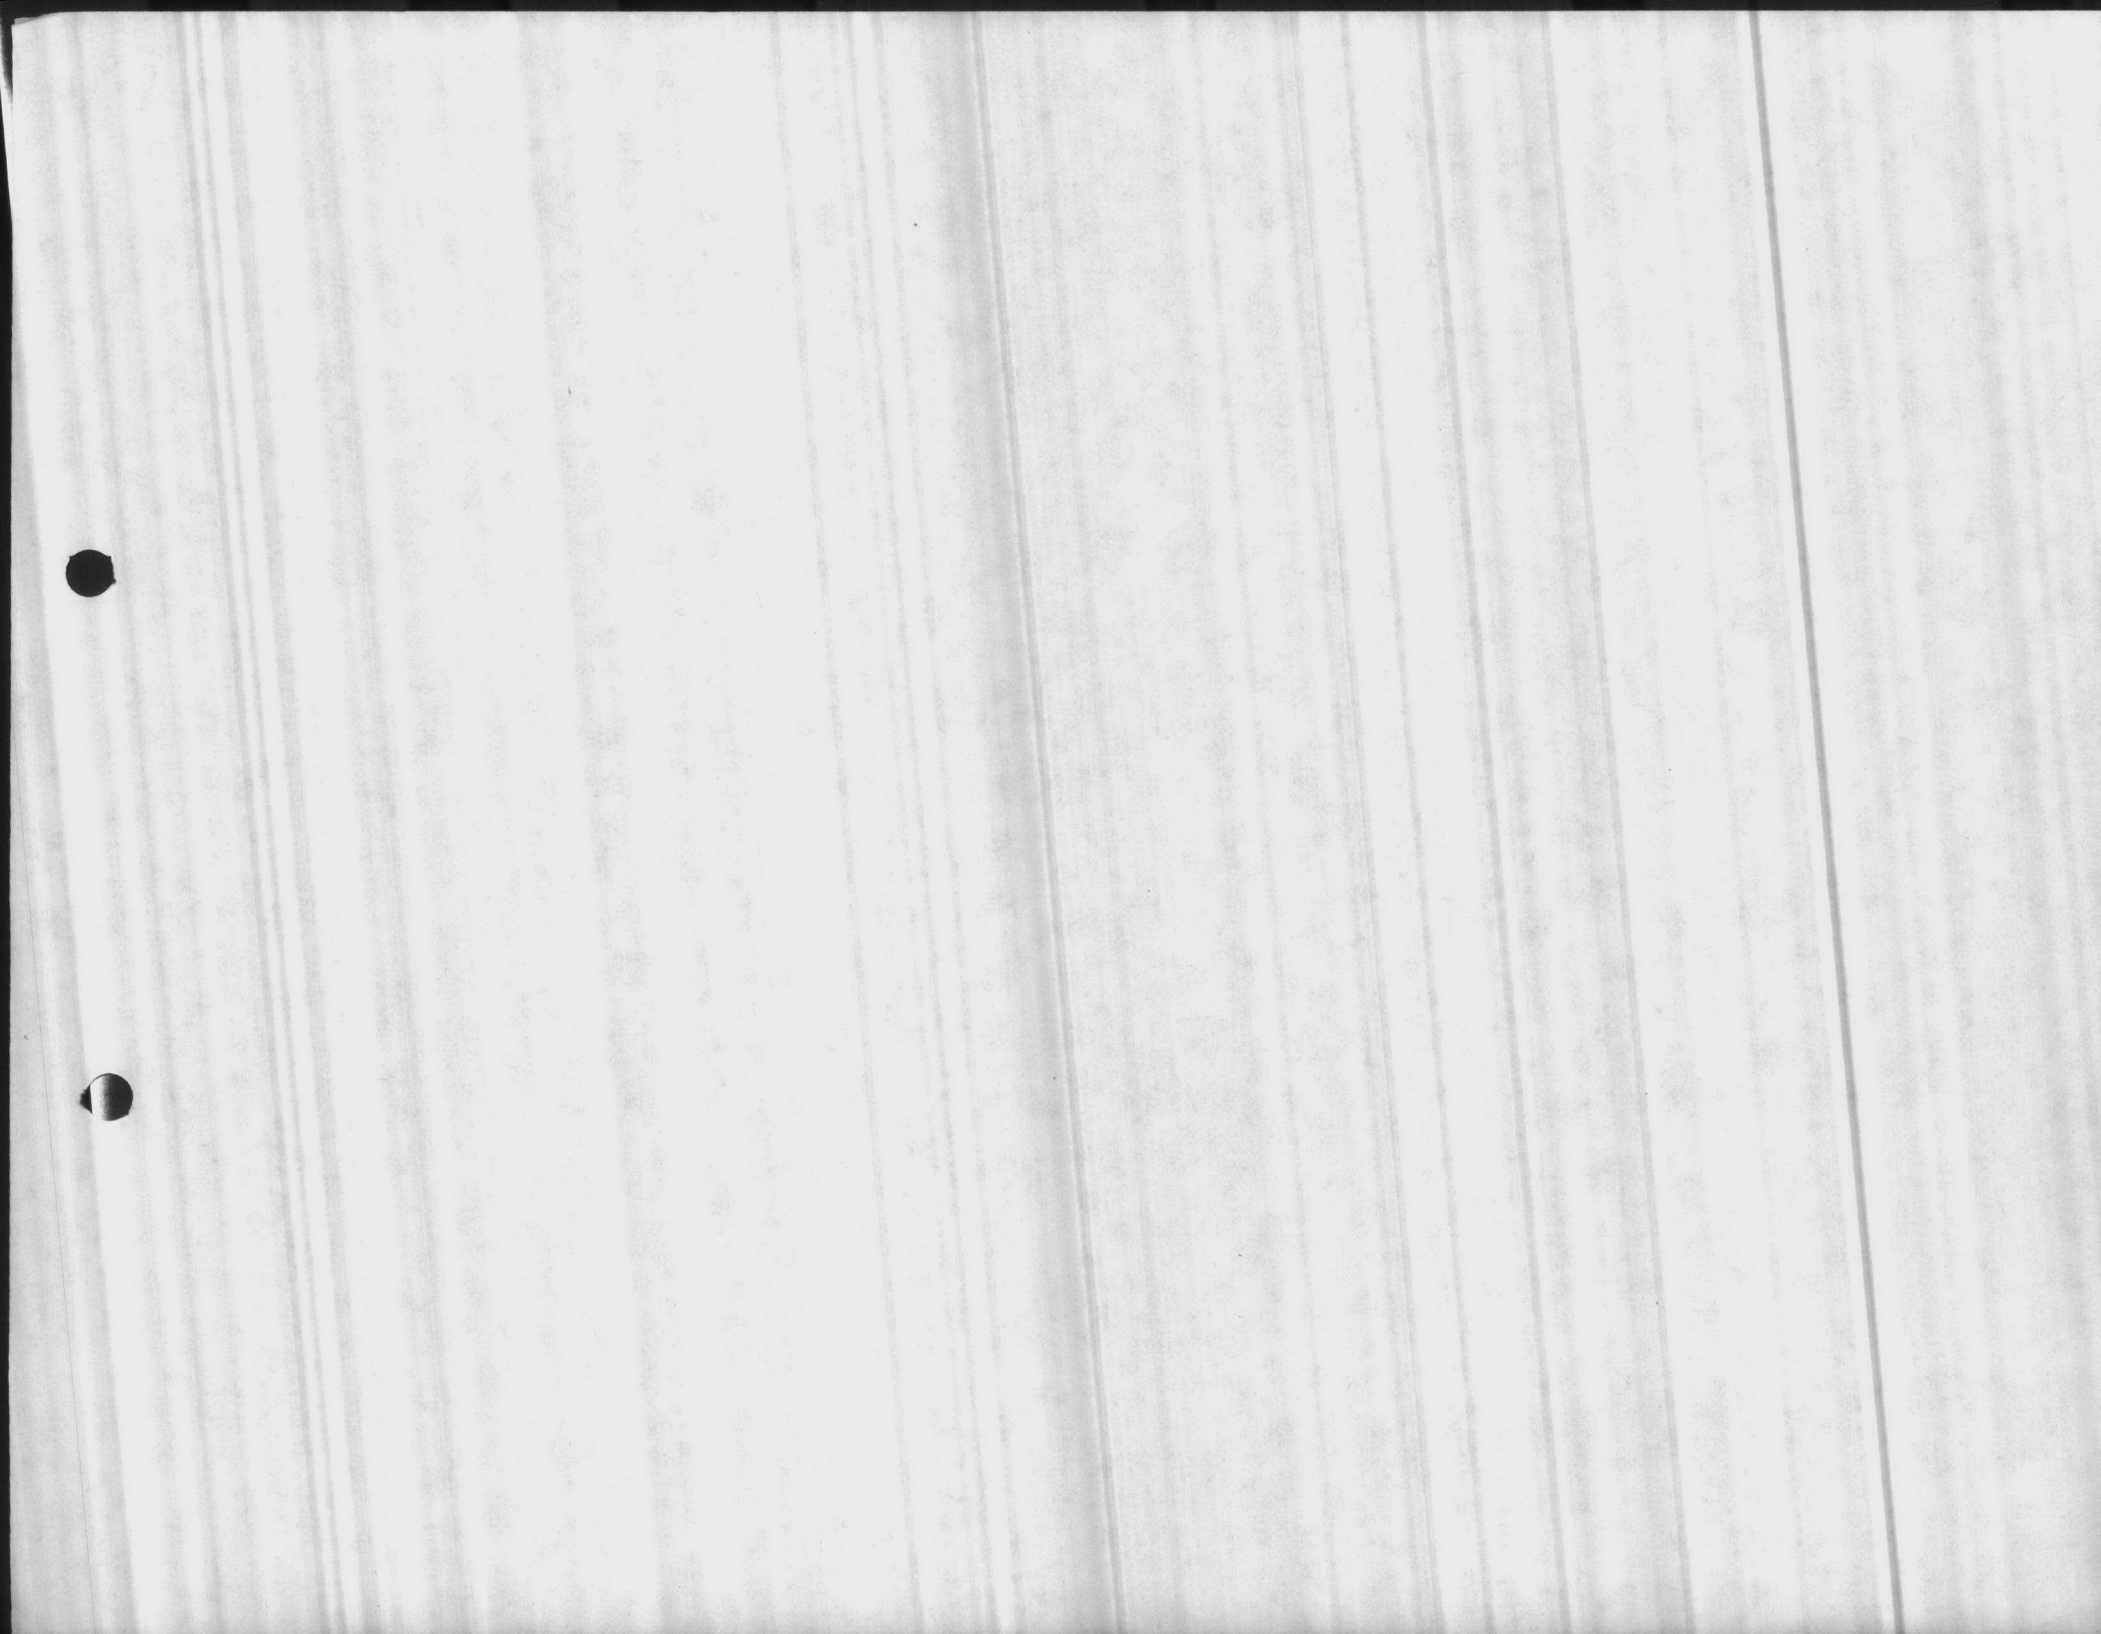

WATER TREATMENT PLANT

WATER FLOW

DATE SEPTEMBER 80

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	95,780	91,314	4,462	3,276	13	5,900	5,000	LIME
HOLCOMB BLVD.	40,014	38,888	1,113	1,711	3	2,304	2,000	LIME
TARAWA TERRACE	23,556	22,889	864	926	3	1,152	1,000	LIME
MONTFORD POINT	8,425	7,787	634	314	3	622	750	ZEOLITE
MCAS (H)	32,210	29,949	2,256	1,506	3	4,081	3,500	LIME
RIFLE RANGE	6,151	5,459	688	291	3	648	600	ZEOLITE
COURTHOUSE BAY	11,226	10,455	767	382	3	864	600	ZEOLITE
ONSLow BEACH	3,679	3,523	140	154	3	250	250	ZEOLITE

WATER IN MILLION GALS.

210,264,000

REMARKS :



WATER TREATMENT PLANT

WATER FLOW

DATE OCTOBER 80

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	91,925	86,292	5,621	3,744	13	5,900	5,000	LIME
HOLCOMB BLVD.	33,944	32,766 (est.)	1,150	1,128	3	2,304	2,000	LIME
TARAWA TERRACE	22,966	21,725	1000	897	3	1,152	1,000	LIME
MONTFORD POINT	7,141	6,592 (est.)	539	276	3	622	750	ZEOLITE
MCAS (H)	31,329	28,681	2,640	1,133	3	4,081	3,500	LIME
RTELE RANGE	6,581	5,866	705	248	3	648	600	ZEOLITE
COURTHOUSE PAV	13,711	11,870	795	385	3	864	600	ZEOLITE
ONSIOW BEACH	4,116	3,978	128	120	3	250	250	ZEOLITE

WATER IN MILLION GALS.

197,779,000

REMARKS:



WATER TREATMENT PLANT

WATER FLOW


DATE NOVEMBER 1980

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	104,060	99,268	4,788	3,456	13	5,900	5,000	LIME
HOLCOMB BLVD.	28,534	27,057	1,313	1,383	3	2,304	2,000	LIME
TARAWA TERRACE	21,161	20,174	964	767	3	1,152	1,000	LIME
MONTFORD POINT	7,045	6,323	719	373	3	622	750	ZEOLITE
NCAS (H)	27,763	25,120	2,640	1,087	3	4,081	3,500	LIME
RIFLE RANGE	6,311	5,620	688	213	3	648	600	ZEOLITE
COURTHOUSE PAY	12,520	11,768	749	501	3	864	600	ZEOLITE
ONSIOW BEACH	3,795	3,651	142	152	3	250	250	ZEOLITE

WATER IN MILLION GALS.

198,981,000

REMARKS:

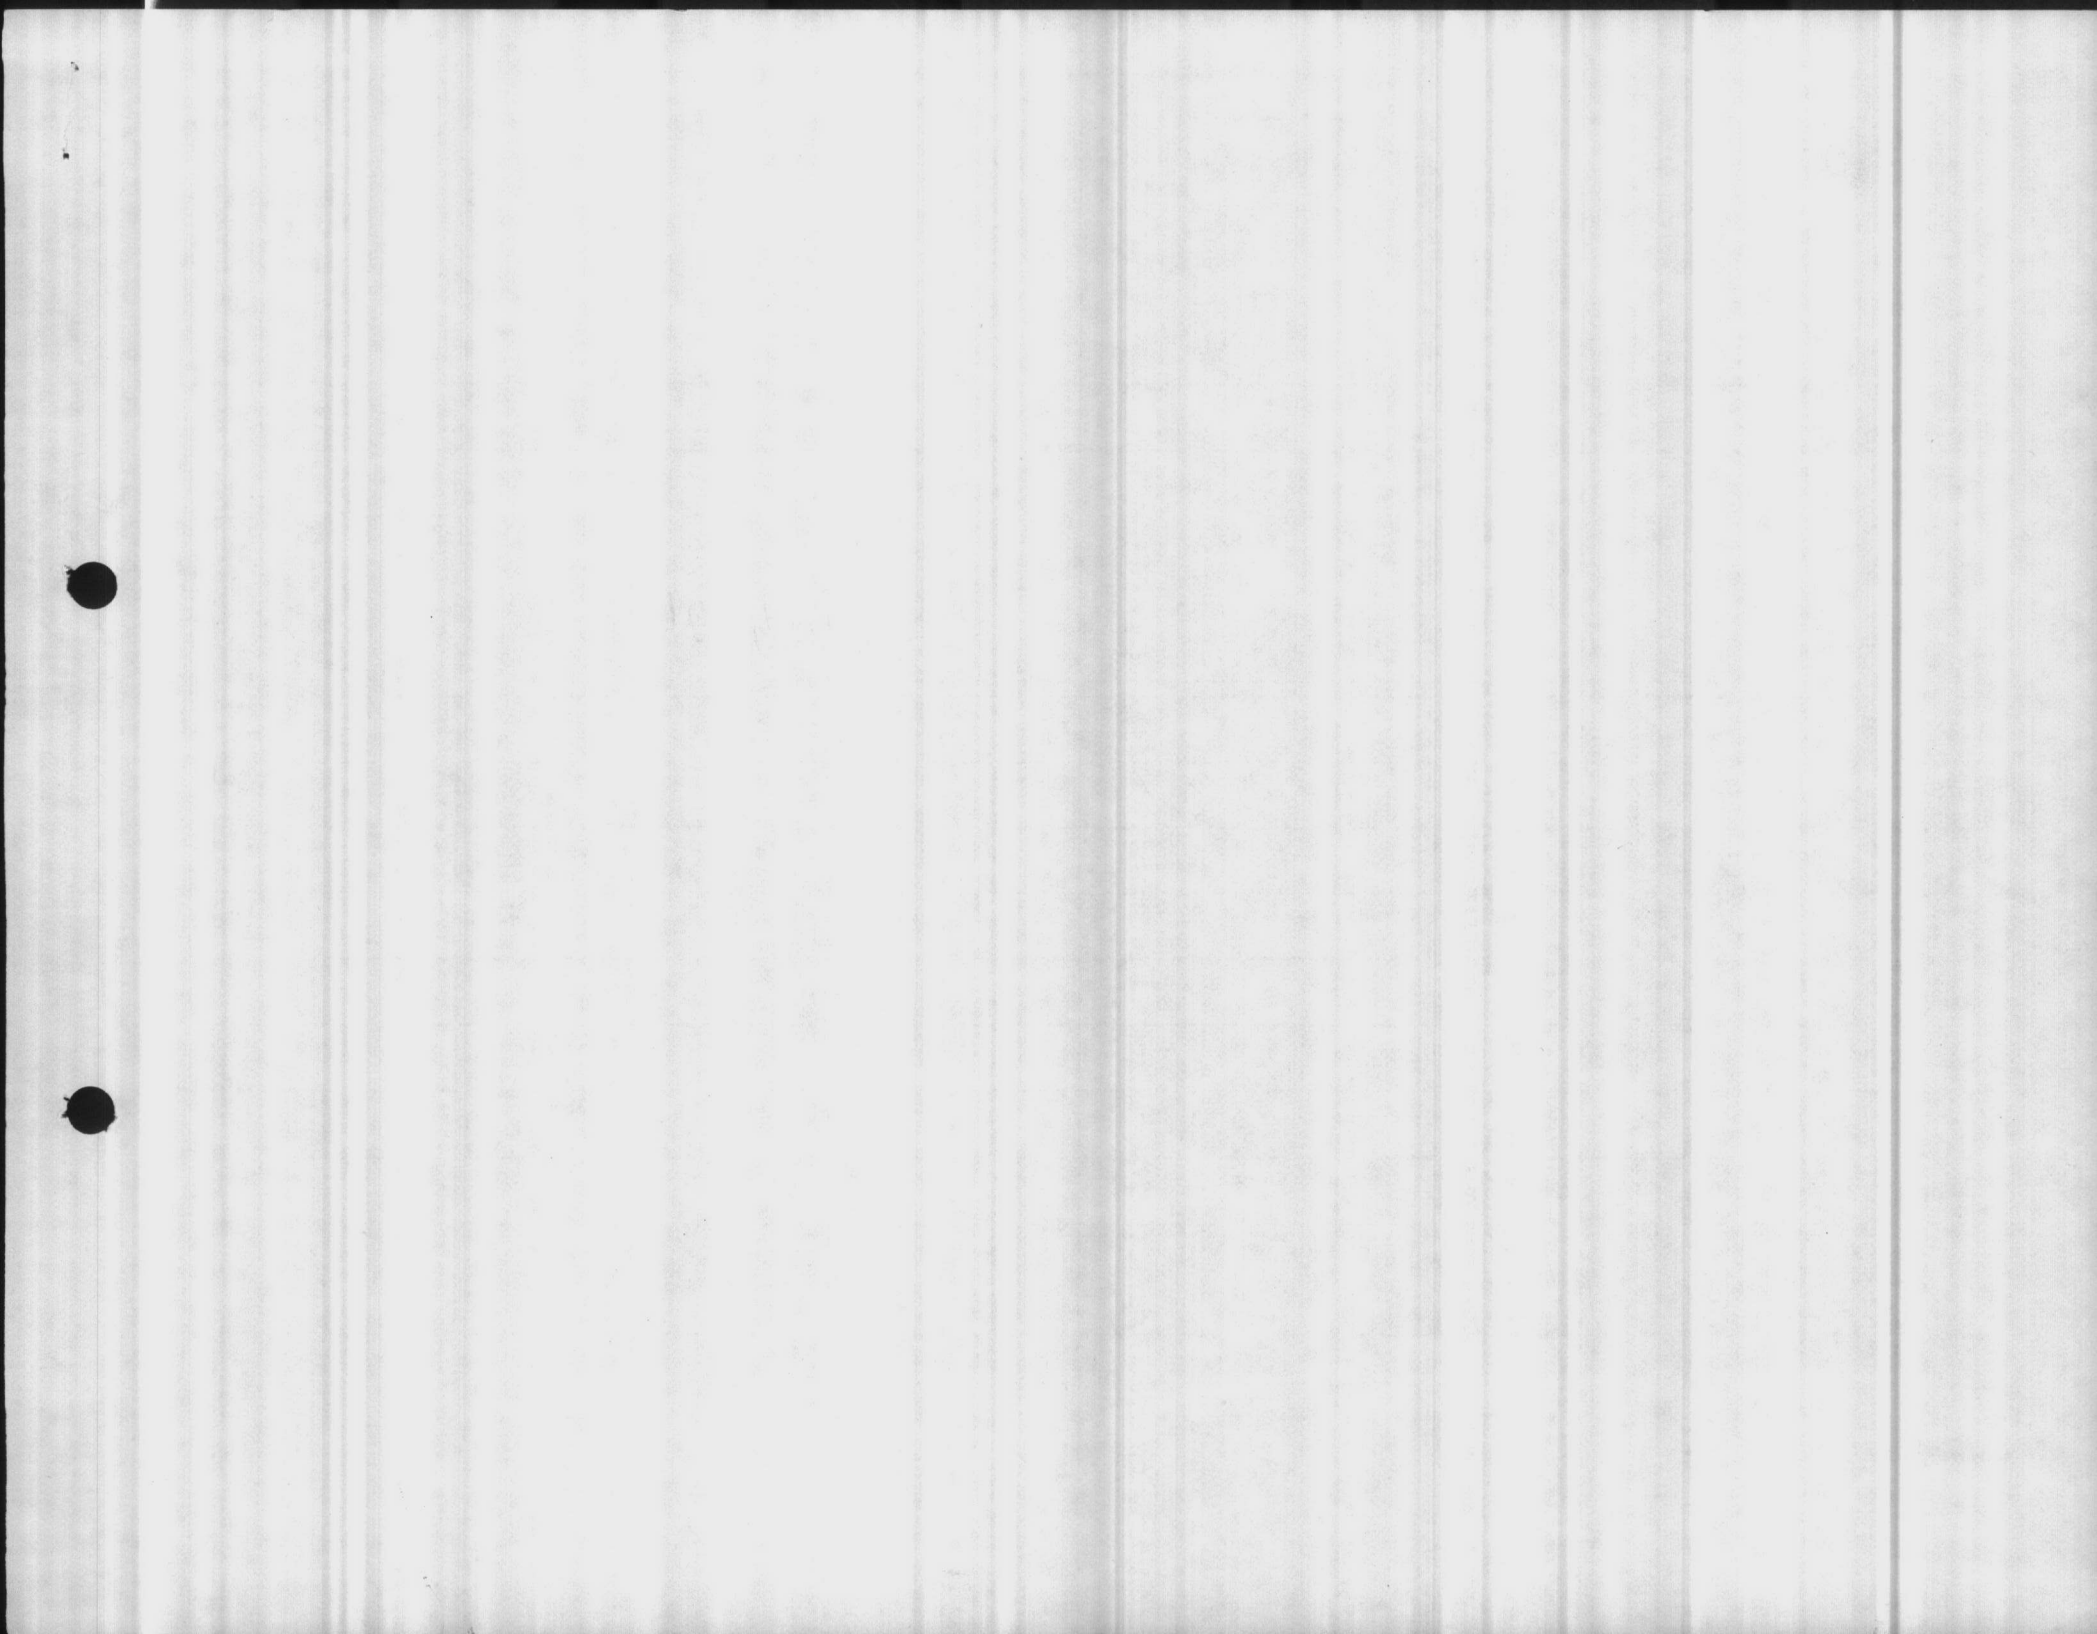

WATER TREATMENT PLANT

WATER FLOW


DATE DECEMBER 80

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	104,399	99,432	4,947	3,528	13	5,900	5,000	LIME
HOLCOMB BLVD.	25,083	24,020	1,150	901	3	2,304	2,000	LIME
TARAWA TERRACE	22,585	21,643	893	872	3	1,152	1,000	LIME
MONTFORD POINT	9,255	8,563	679	272	3	622	750	ZEOLITE
MCAS (H)	34,734	31,849	2,880	1,394	3	4,081	3,500	LIME
RIFLE RANGE	7,478	6,758	677	246	3	648	600	ZEOLITE
COURTHOUSE BAY	15,754	14,937	788	562	3	864	600	ZEOLITE
ONSIOW BEACH	3,409	3,257	142	140	3	250	250	ZEOLITE

WATER IN MILLION GALS.

210,459,000

REMARKS:

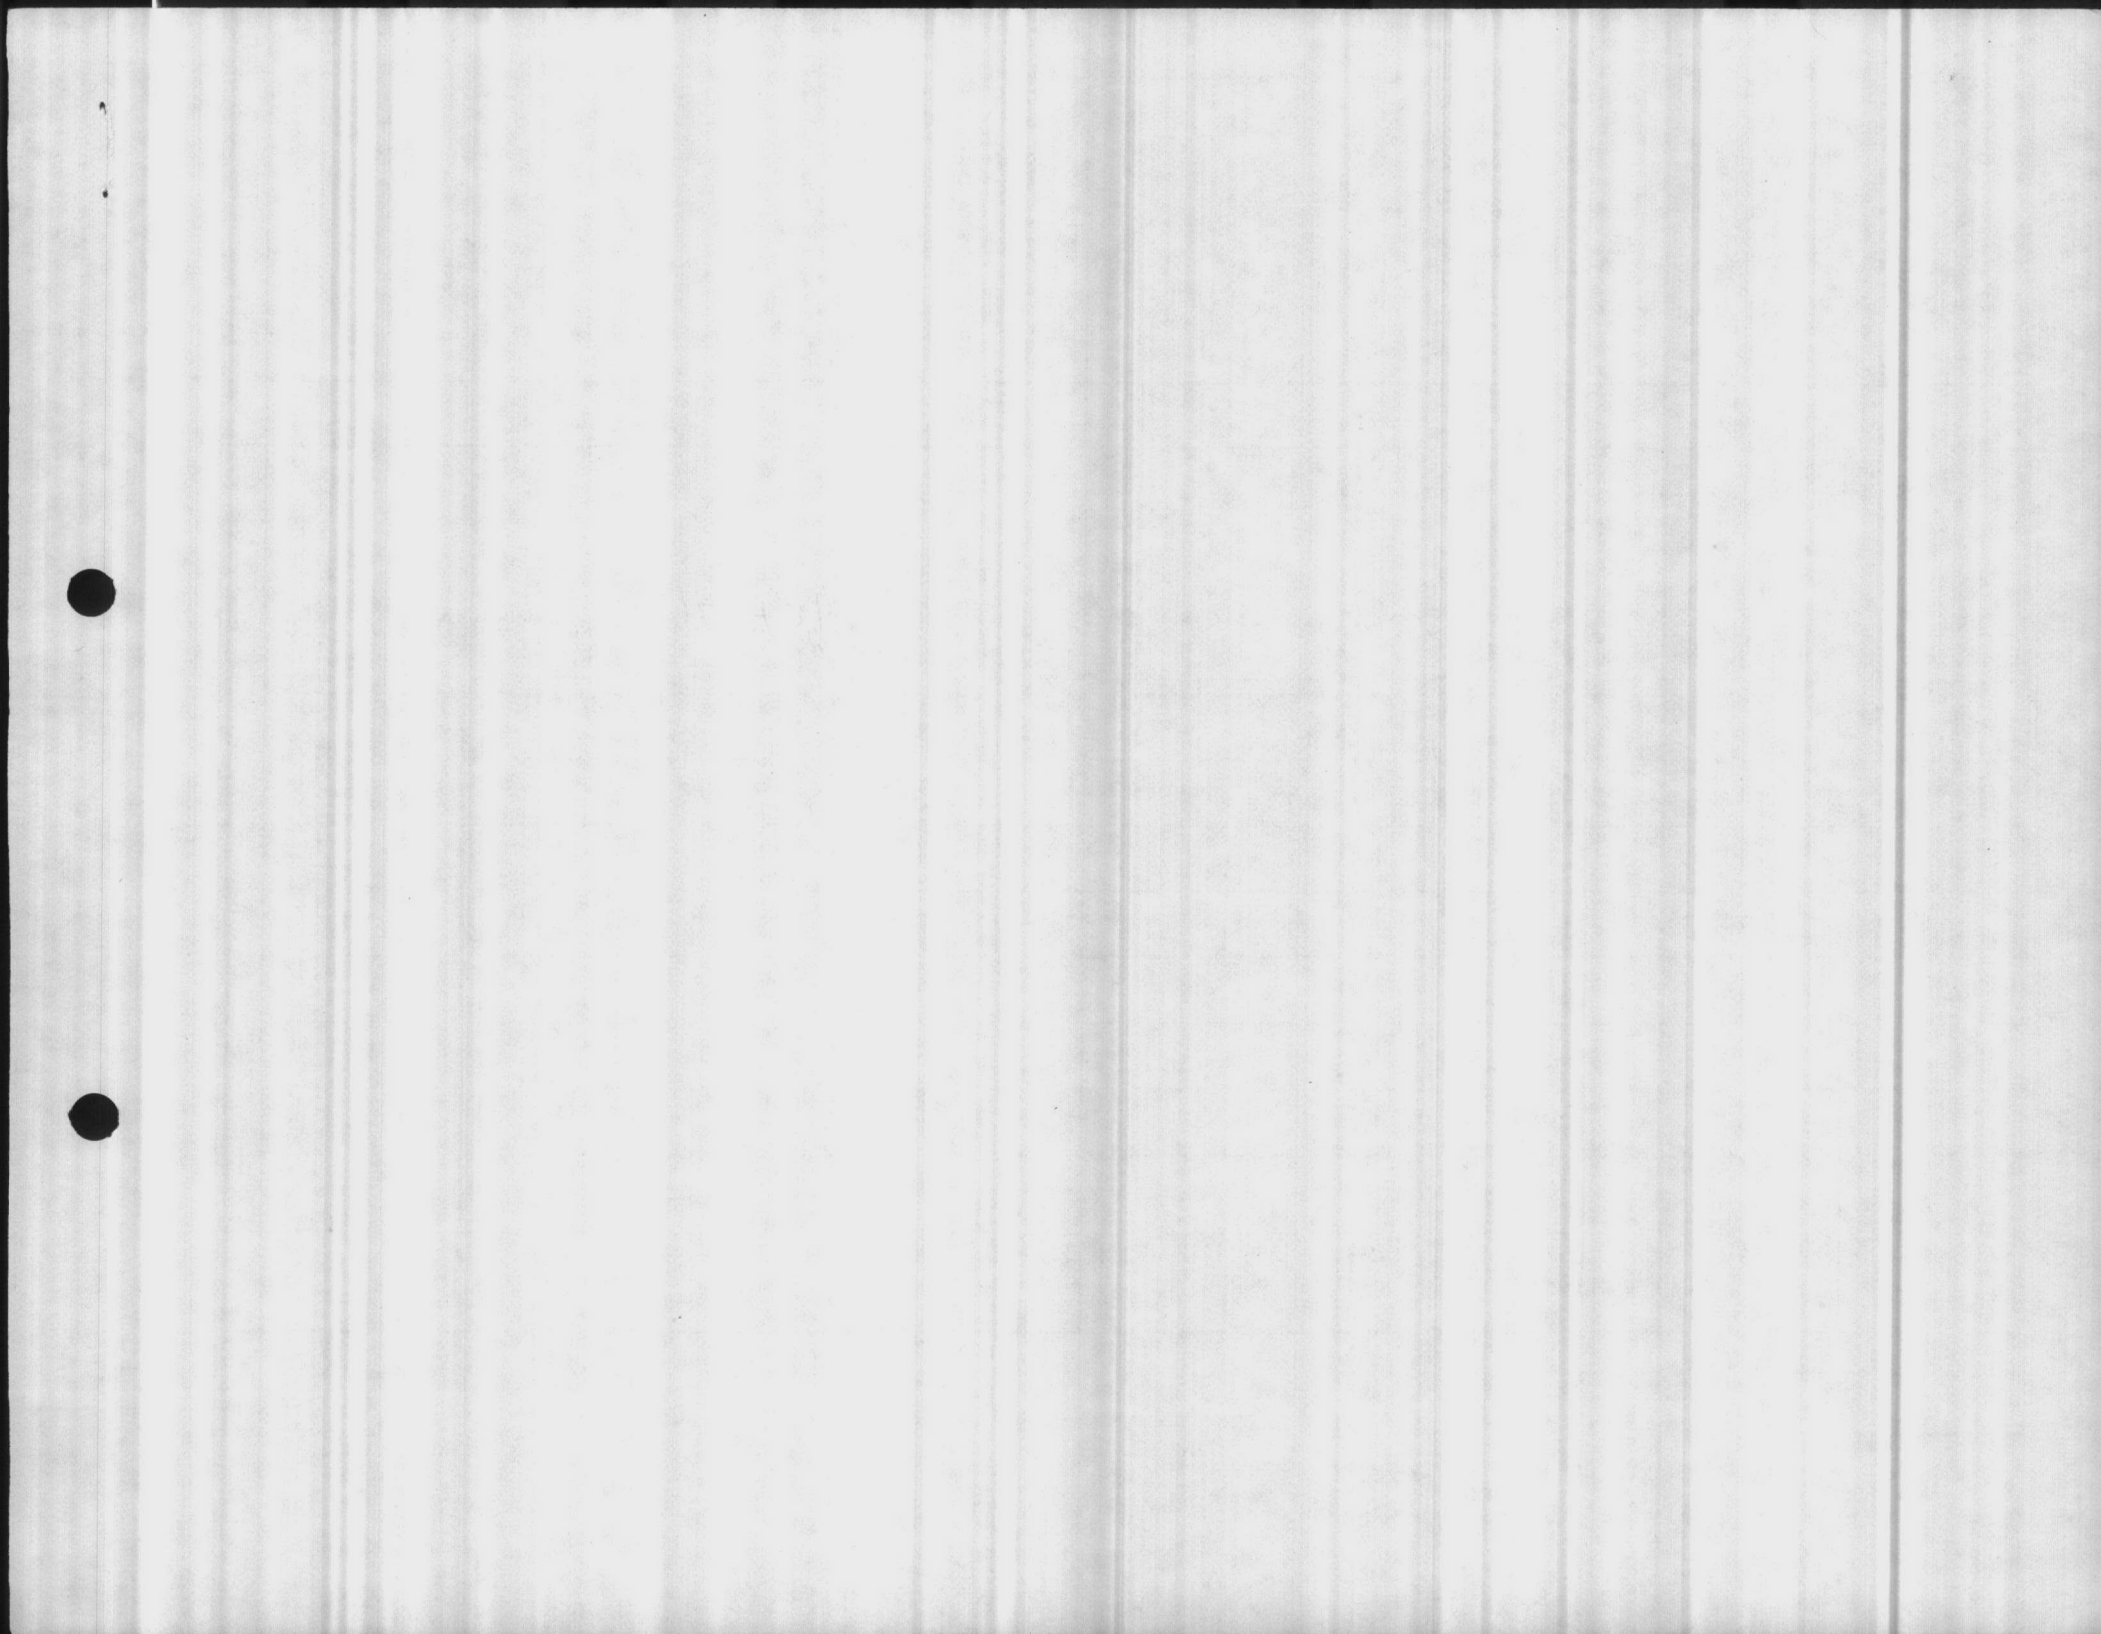

WATER TREATMENT PLANT

WATER FLOW


DATE JANUARY 81

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	110,266	106,596	3,648	3,852	13	5,900	5,000	LIME
HOLCOMB BLVD.	30,999	29,738	1,150	1,026	3	2,304	2,000	LIME
TARAWA TERRACE	24,600	23,717	893	1,343	3	1,152	1,000	LIME
MONTFORD POINT	9,561	8,635	861	472	3	622	750	ZEOLITE
MCAS (H)	39,820	35,423	3,120	1,420	3	4,081	3,500	LIME
RIFLE RANGE	8,708	7,962	736	300	3	648	600	ZEOLITE
COURTHOUSE BAY	19,679	18,886	781	593	3	864	600	ZEOLITE
ONSIOW BEACH	4,331	4,161	158	125	3	250	250	ZEOLITE

WATER IN MILLION GALS.

235,118,000

REMARKS:

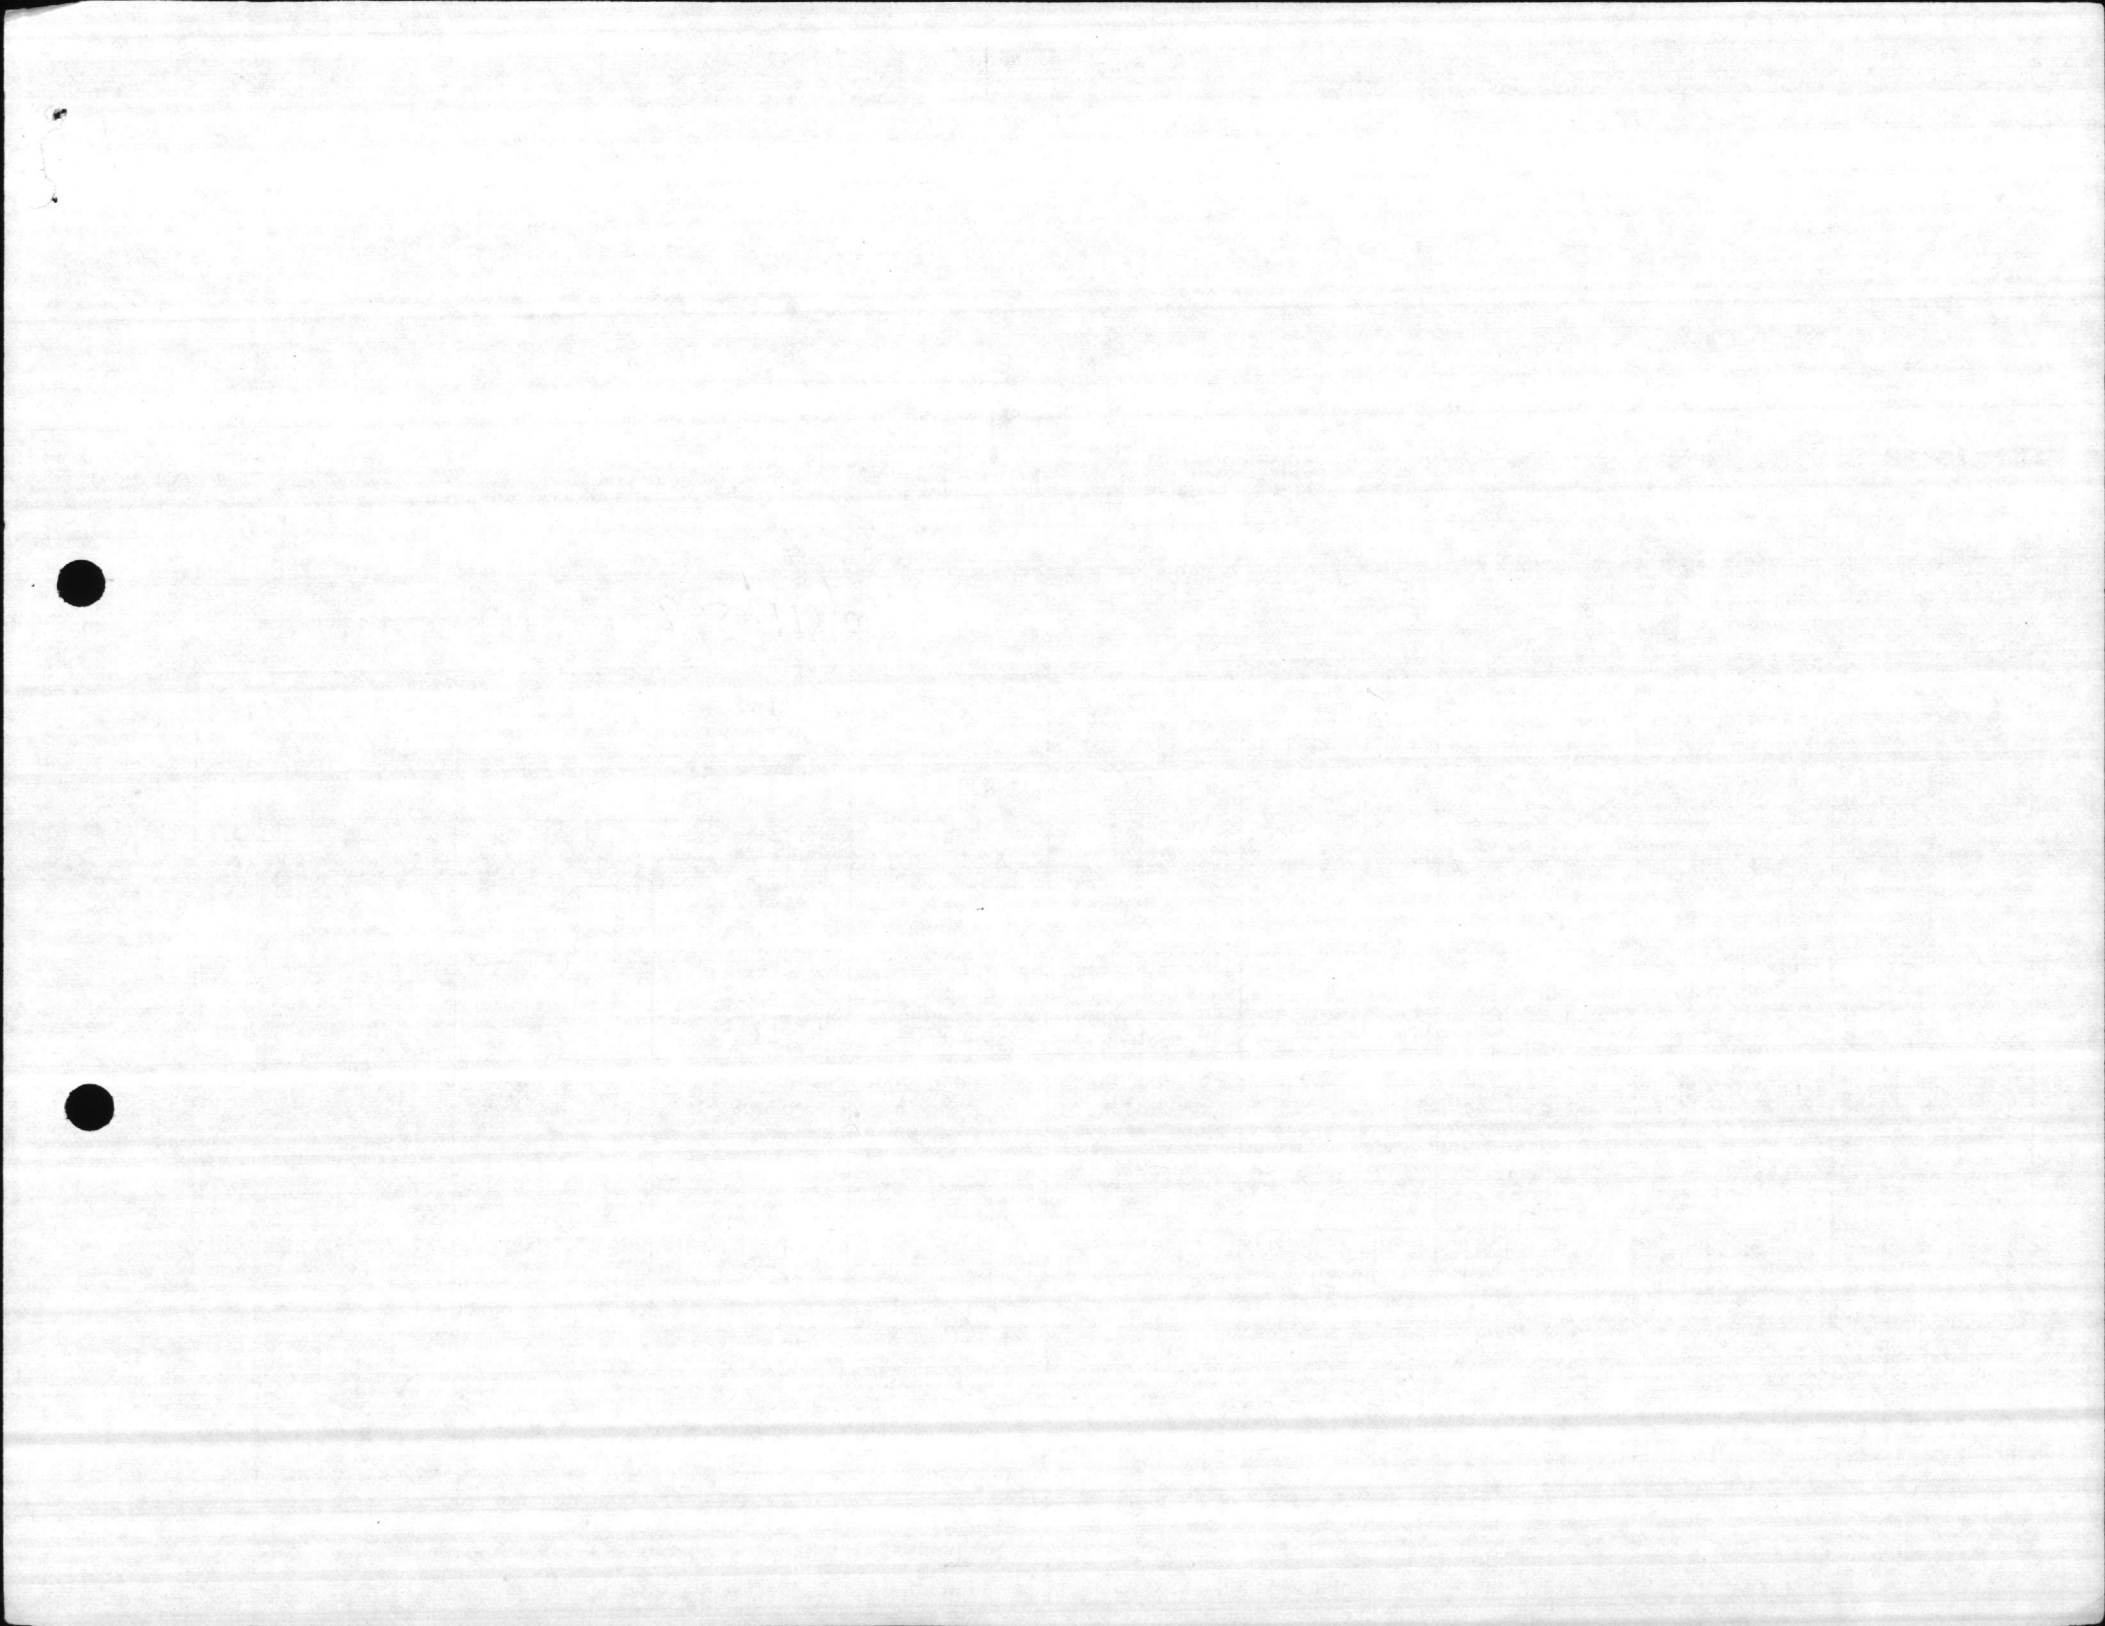

WATER TREATMENT PLANT


WATER FLOW

DATE FEBRUARY 81

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	96,238	91,764	4,469	3,672	13	5,900	5,000	LIME
HOLCOMB BLVD.	26,197	25,146	1,039	1,080	3	2,304	2,000	LIME
TARAWA TERRACE	19,226	19,114	806	861	3	1,152	1,000	LIME
MONTFORD POINT	9,686	8,940	726	541	3	622	750	ZEOLITE
NCAS (H)	30,853	28,155	2,688	1,028	3	4,081	3,500	LIME
RIFLE RANGE	6,445	5,769	662	238	3	648	600	ZEOLITE
COURTHOUSE BAY	11,592	10,876	712	477	3	864	600	ZEOLITE
ONSLow BEACH	2,686	2,567	99	73	3	250	250	ZEOLITE

WATER IN MILLION GALS.

REMARKS:

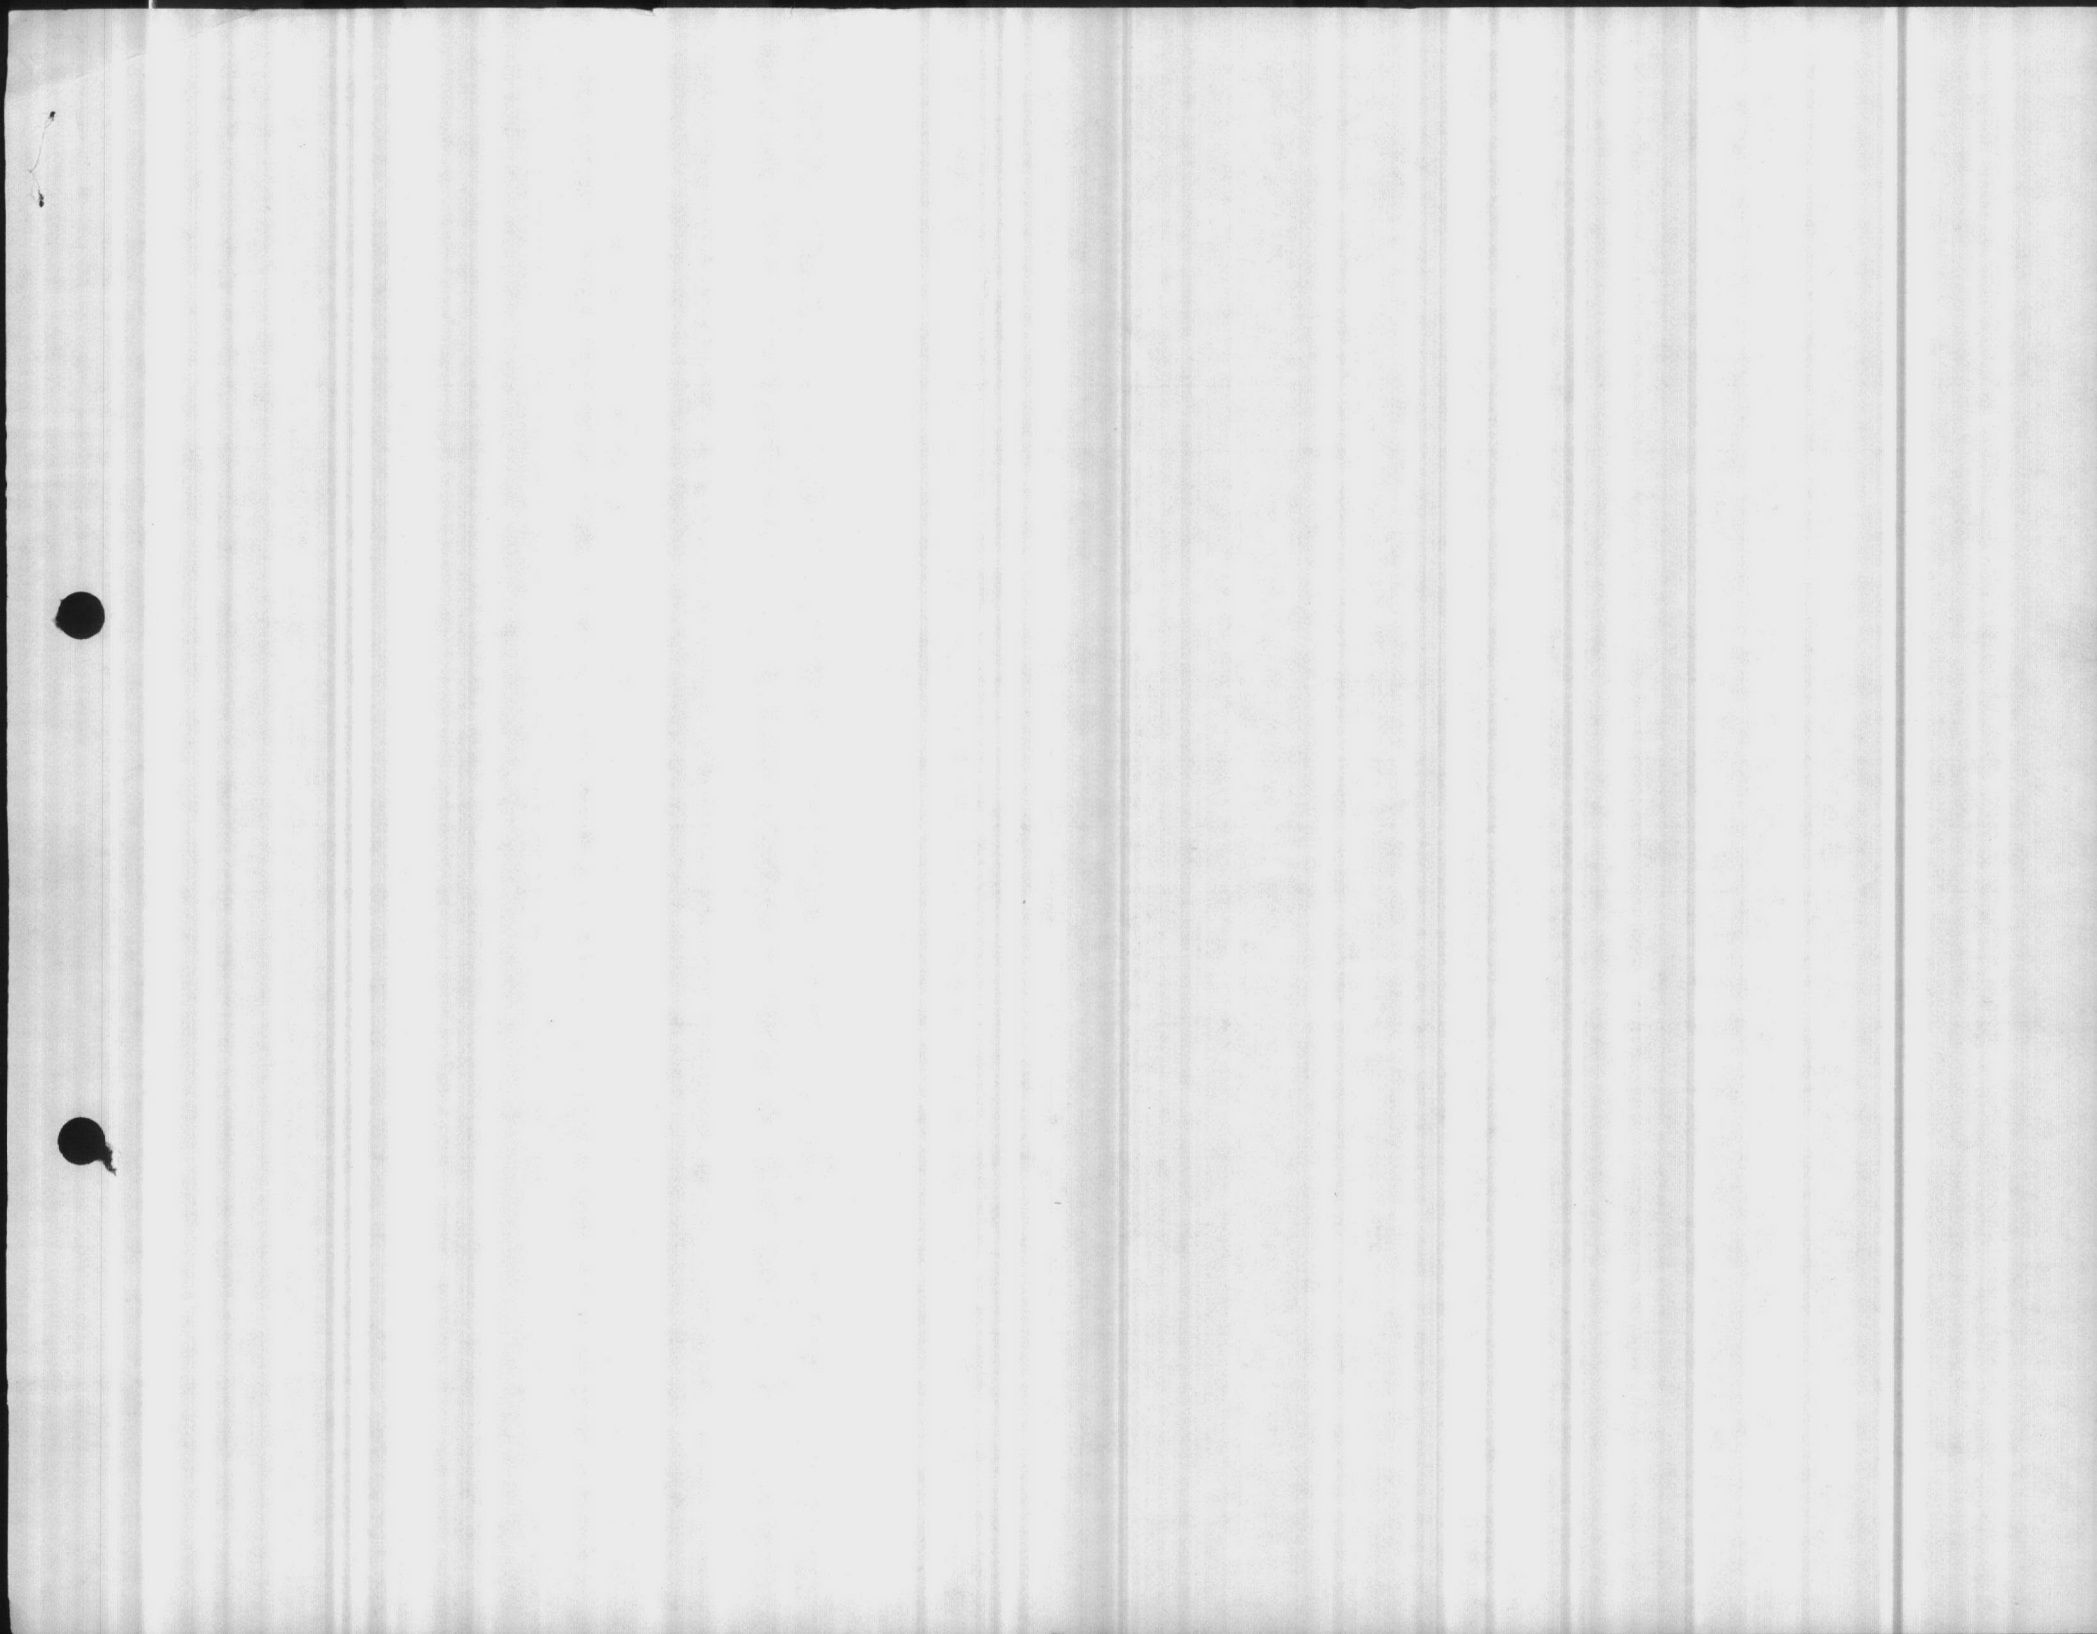

WATER TREATMENT PLANT


WATER FLOW

DATE MARCH 81

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	103,392	98,424	4,948	3,708	13	5,900	5,000	LIME
HOLCOMB BLVD.	26,056	24,896	1,150	982	3	2,304	2,000	LIME
TARAWA TERRACE	25,444	24,692	744	942	3	1,152	1,000	LIME
MONTFORD POINT	8,859	8,152	673	354	3	622	750	ZEOLITE
MCAS (II)	34,099	31,059	3,024	1,116	3	4,081	3,500	LIME
RIFLE RANGE	7,077	6,326	742	232	3	648	600	ZEOLITE
COURTHOUSE PAY	17,231	16,411	796	463	3	864	600	ZEOLITE
ONSLOW BEACH	2,838	2,707	111	57	3	250	250	ZEOLITE

WATER IN MILLION GALS.

REMARKS:

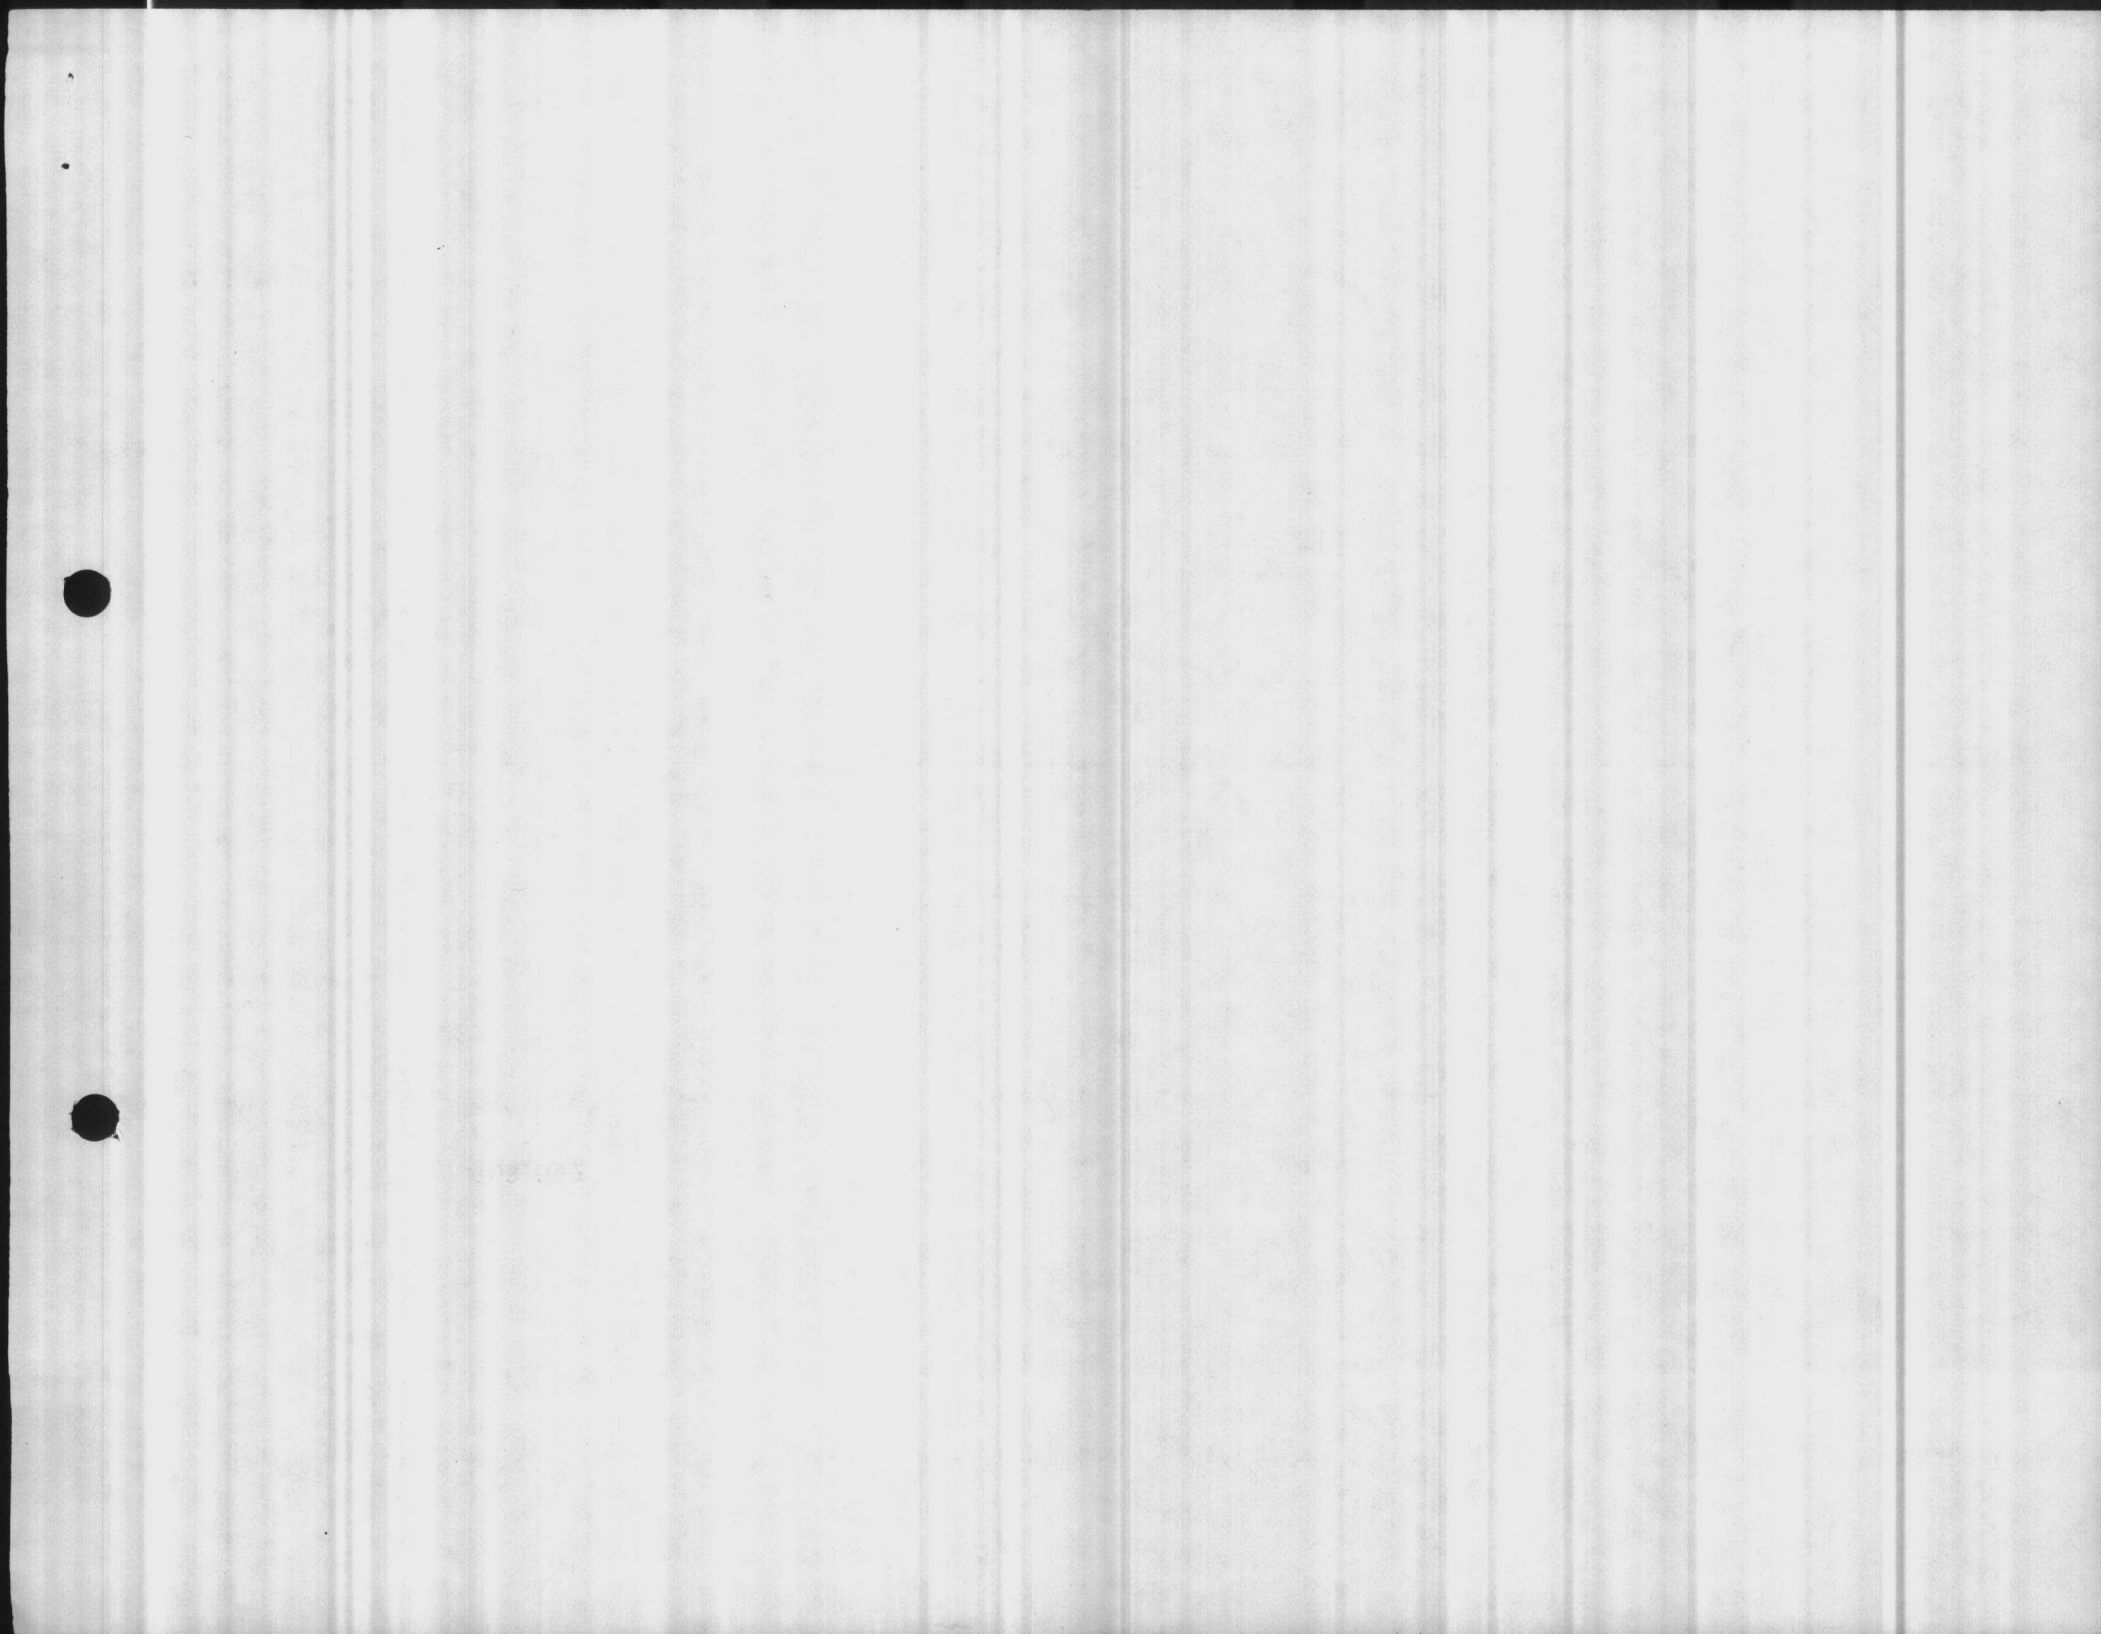

WATER TREATMENT PLANT

WATER FLOW


DATE APRIL 1981

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	103,190	98,388	4,788	3,888	13	5,900	5,000	LIME
HOLCOMB BLVD.	58,234	56,501 EST.	1,632	1,805	3	2,304	2,000	LIME
TARAWA TERRACE	25,716	24,984	720	982	3	1,152	1,000	LIME
MONTFORD POINT	9,530	8,860	667	421	3	622	750	ZEOLITE
MCAS (H)	34,191	31,425	2,748	1,346	3	4,081	3,500	LIME
RIFLE RANGE	6,549	5,830	713	219	3	648	600	ZEOLITE
COURTHOUSE BAY	14,920	14,162	745	491	3	864	600	ZEOLITE
ONSLOW BEACH	5,426	5,196	219	113	3	250	250	ZEOLITE

WATER IN MILLION GALS.

REMARKS :

NOTE: SENT WATER FROM B-20 TO B-670 DUE TO INCREASED WATER DEMAND, BAD LIME CAUSING INCREASING FILTER WASHES

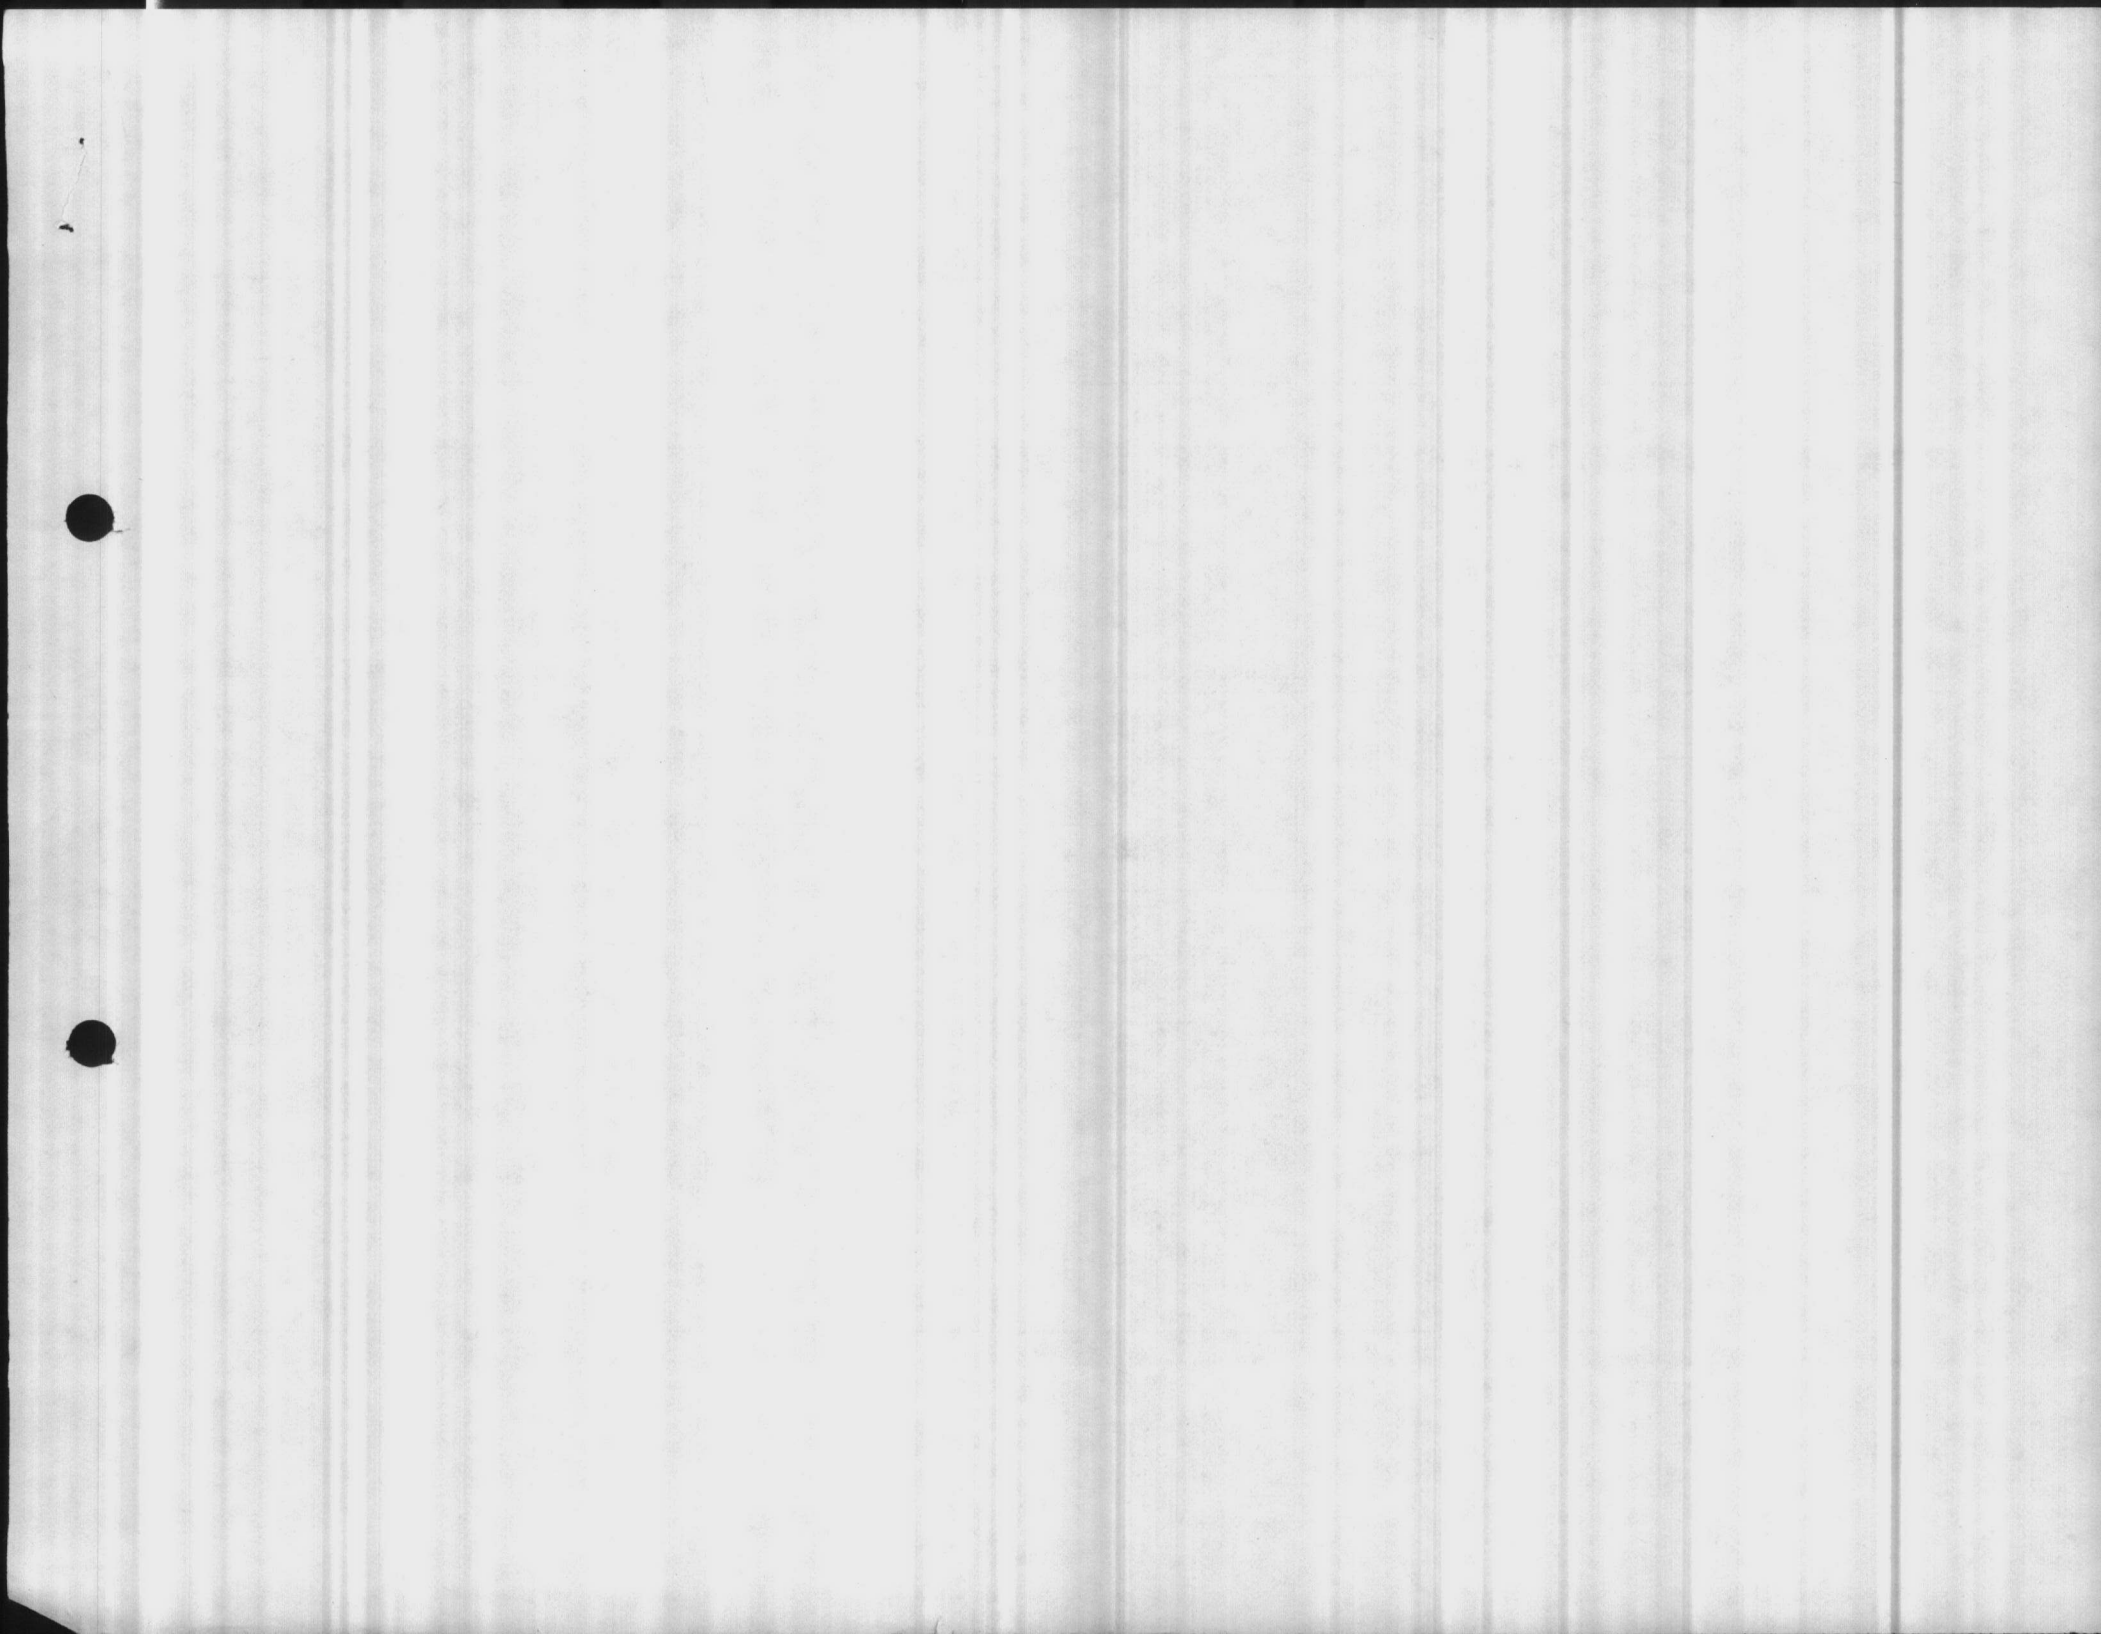

WATER TREATMENT PLANT


WATER FLOW

DATE MAY 1981

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	109,764	102,880	6,187	3,960	13	5,900	5,000	LIME
HOLCOMB BLVD.	33,819	37,646	1,150	1,718	3	2,304	2,000	LIME
TARAWA TERRACE	27,079	25,973	844	1,006	3	1,152	1,000	LIME
MONTFORD POINT	10,472	9,715	744	560	3	622	750	ZEOLITE
MCAS (H)	32,409	29,479	2,880	1,693	3	4,081	3,500	LIME
RIFLE RANGE	6,594	5,846	729	224	3	648	600	ZEOLITE
COURTHOUSE BAY	12,208	11,331	777	406	3	864	600	ZEOLITE
ONSTOW BEACH	6,361	6,077	273	179	3	250	250	ZEOLITE

WATER IN MILLION GALS.

REMARKS:

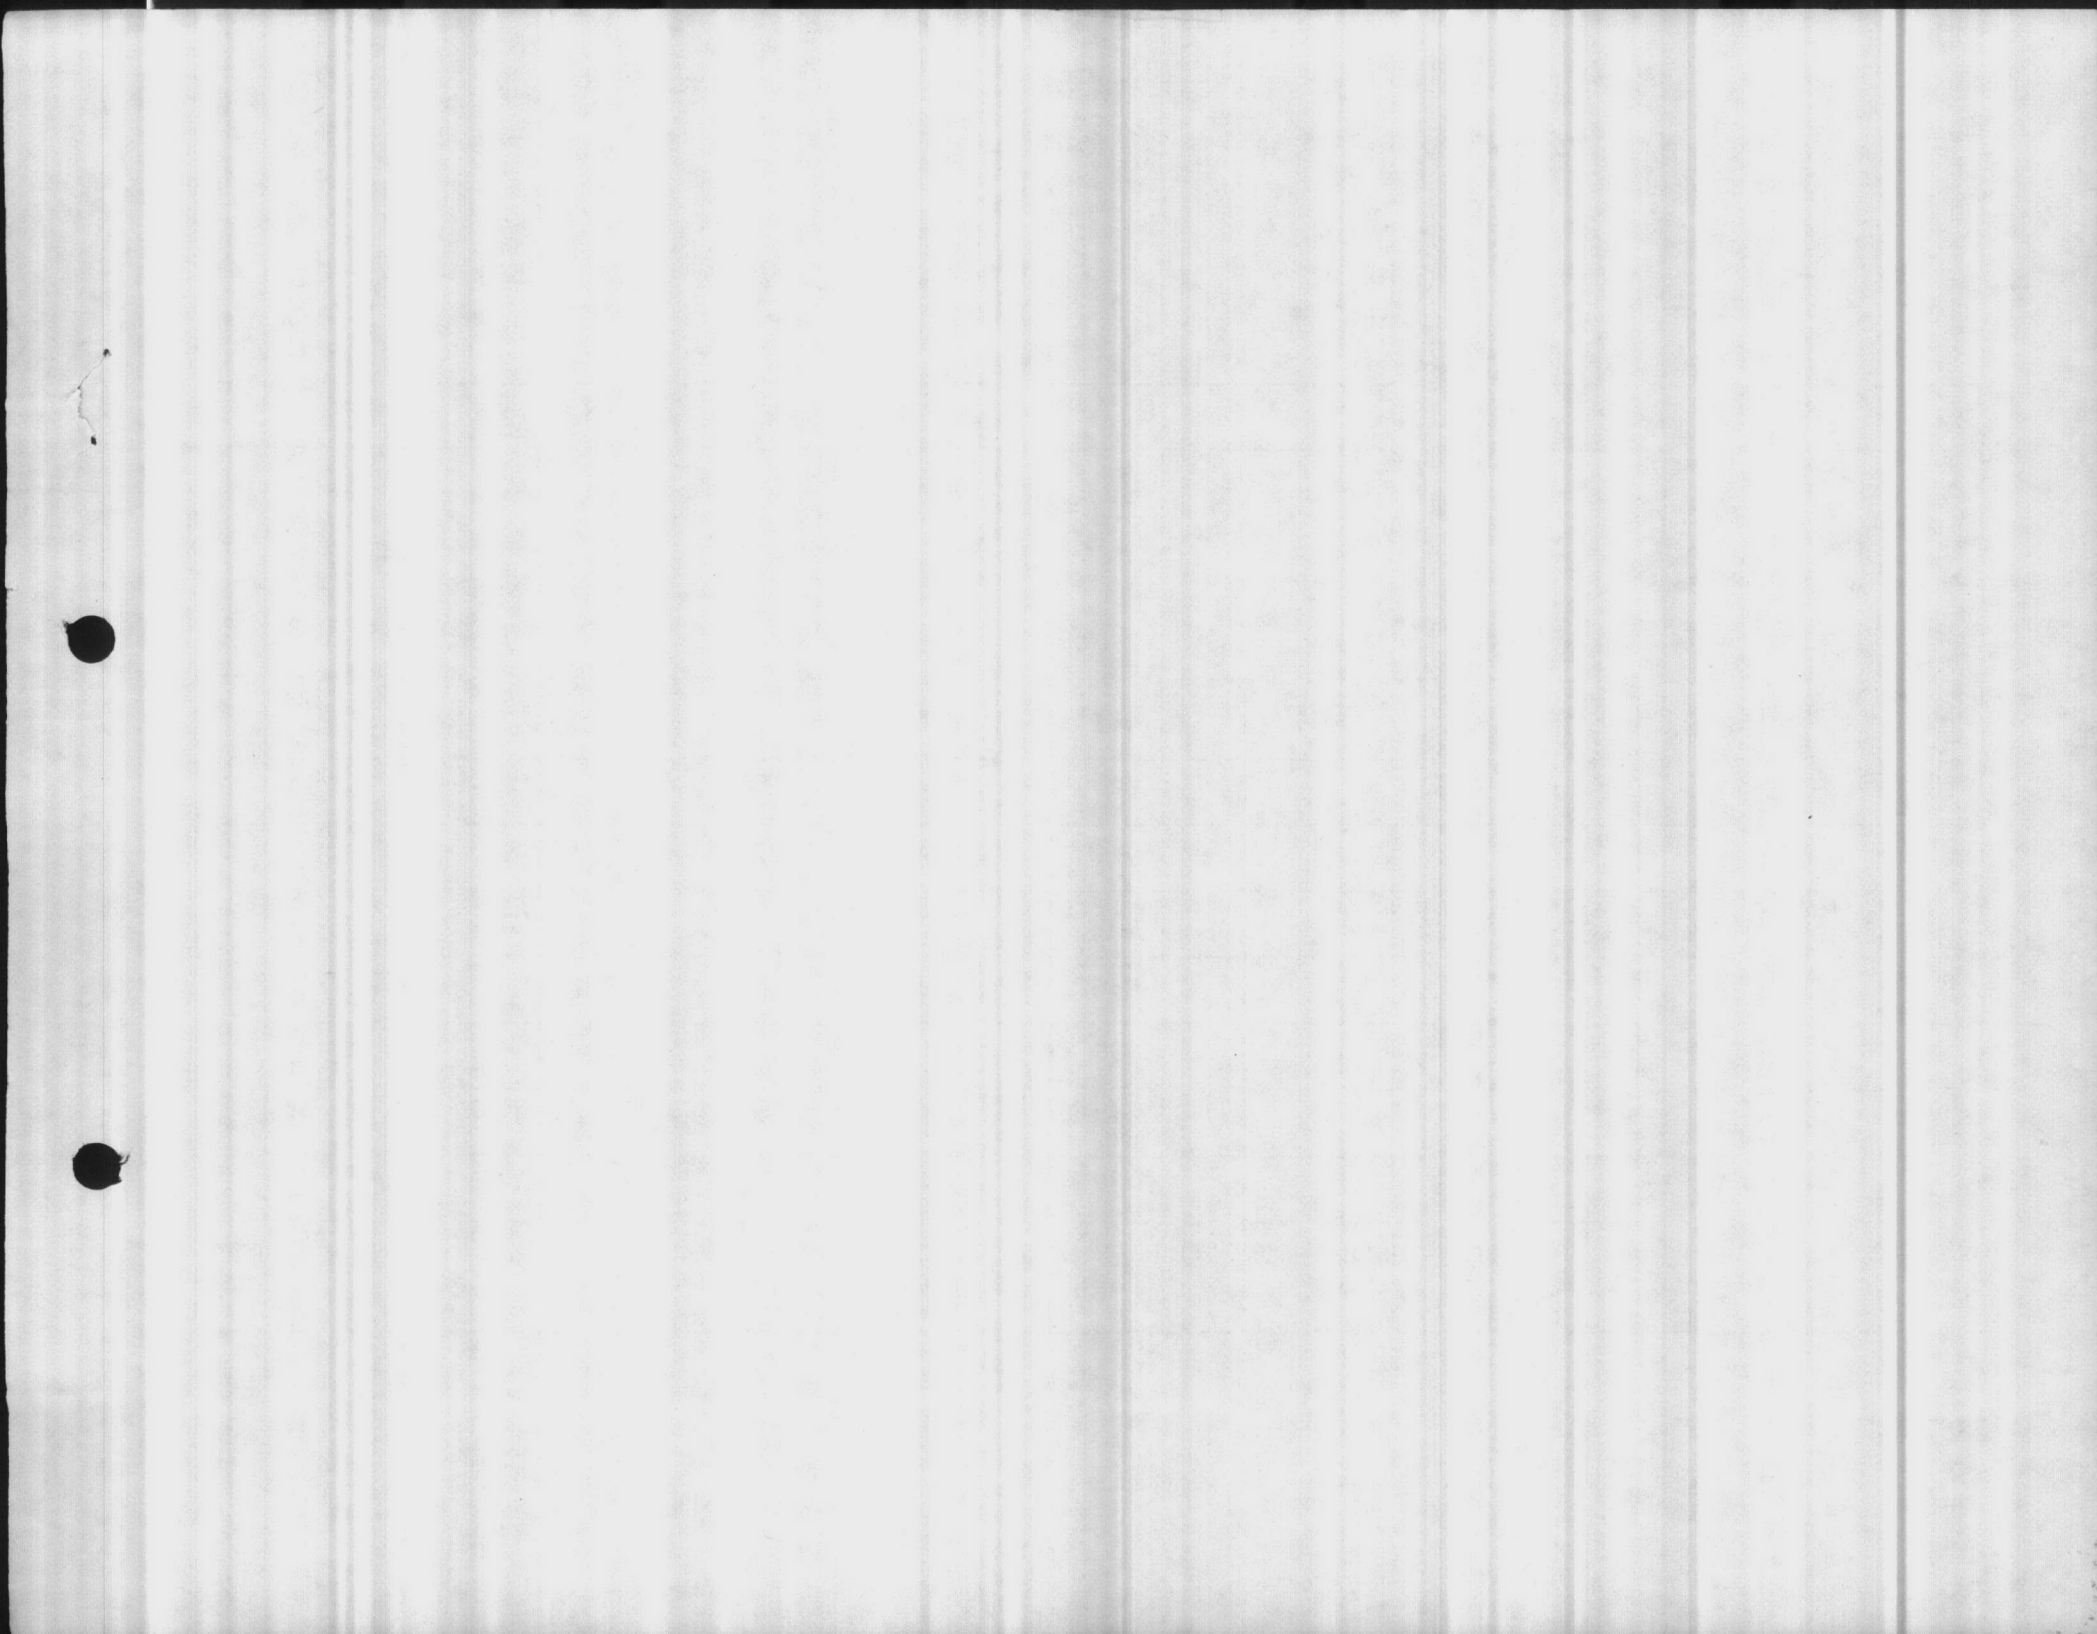

WATER TREATMENT PLANT

WATER FLOW

DATE JUNE 1981

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	102,748	97,956	4,788	3,780	13	5,900	5,000	LIME
HOLCOMB BLVD.	46,645	44,416	2,226	2,045	3	2,304	2,000	LIME
TARAWA TERRACE	29,887	29,903 EST.	664	1,034	3	1,152	1,000	LIME
MONTFORD POINT	9,755	9,068	686	339	3	622	750	ZEOLITE
MCAS (H)	32,711	30,212	2,496	1,225	3	4,081	3,500	LIME
RIFLE RANGE	7,291	6,569 EST.	716	236	3	648	600	ZEOLITE
COURTHOUSE BAY	11,950	11,185	763	441	3	864	600	ZEOLITE
ONSIOW BEACH	5,085	4,802	281	229	3	250	250	ZEOLITE

WATER IN MILLION GALS.

REMARKS :



WATER TREATMENT PLANT

WATER FLOW

DATE JULY 1981

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	117,902	112,950	4,948	4,032	13	5,900	5,000	CLF
HOLCOMB BLVD.	33,567	32,414	1,150	1,799	3	2,304	2,000	CLF
TARAWA TERRACE	29,868	29,121	744	1,034	3	1,152	1,000	CLF
MONTFORD POINT	9,598	8,903	693	451	3	622	750	ZFOLITE
NCAS (H)	35,558	32,578	2,976	1,312	3	4,081	3,500	CLF
RTELE RANGE	7,518	6,781	734	299	3	648	600	ZFOLITE
COURTHOUSE PAY	12,026	11,234	788	431	3	864	600	ZFOLITE
ONSLOW BEACH	6,080	5,787	291	229	3	250	250	ZFOLITE

WATER IN MILLION GALS.

REMARKS:



WATER TREATMENT PLANT

WATER FLOW

DATE AUGUST 81

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	99,232	98,280	4,948	3,528	13	5,900	5,000	LT&F
HOLCOMB BLVD.	34,966	33,813	1,150	1,443	3	2,304	2,000	LT&F
TARAWA TERRACE	28,708	27,813	892	1,125	3	1,152	1,000	LT&F
MONTFORD POINT	9,459	8,763	693	543	3	622	750	ZFO&TF
NCAS (II)	32,427	29,688	2,736	1,140	3	4,081	3,500	LT&F
RIFLE RANGE	7,701	6,971	727	250	3	648	600	ZFO&TF
COURTHOUSE PAV	12,321	11,581	737	461	3	864	600	ZFO&TF
ONSLOW BEACH	3,951	3,762	177	188	3	250	250	ZFO&TF

WATER IN MILLION GALS.

REMARKS :

100

100

100

WATER TREATMENT PLANT


WATER PLANT

DATE SEPTEMBER 81

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	98,316	89,568	4,788	3,368	13	5,900	5,000	TRIC
HOLCOMB BLVD.	38,855	37,733	1,113	1,519	3	2,304	2,000	TRIC
TARAWA TERRACE	27,442	26,575	864	955	3	1,152	1,000	TRIC
MONTFORD POINT	8,518	7,873	636	354	3	622	750	ZEOLITE
NCAS (II)	28,614	25,718	2,880	1,164	3	4,081	3,500	TRIC
RTELE RANGE	9,109	8,412	694	262	3	648	600	ZEOLITE
COURTHOUSE FAY	12,458	11,682	774	490	3	864	700	ZEOLITE
ONSLOW BEACH	3,890	3,712	165	157	3	250	250	ZEOLITE

WATER IN MILLION GALS.

REMARKS:

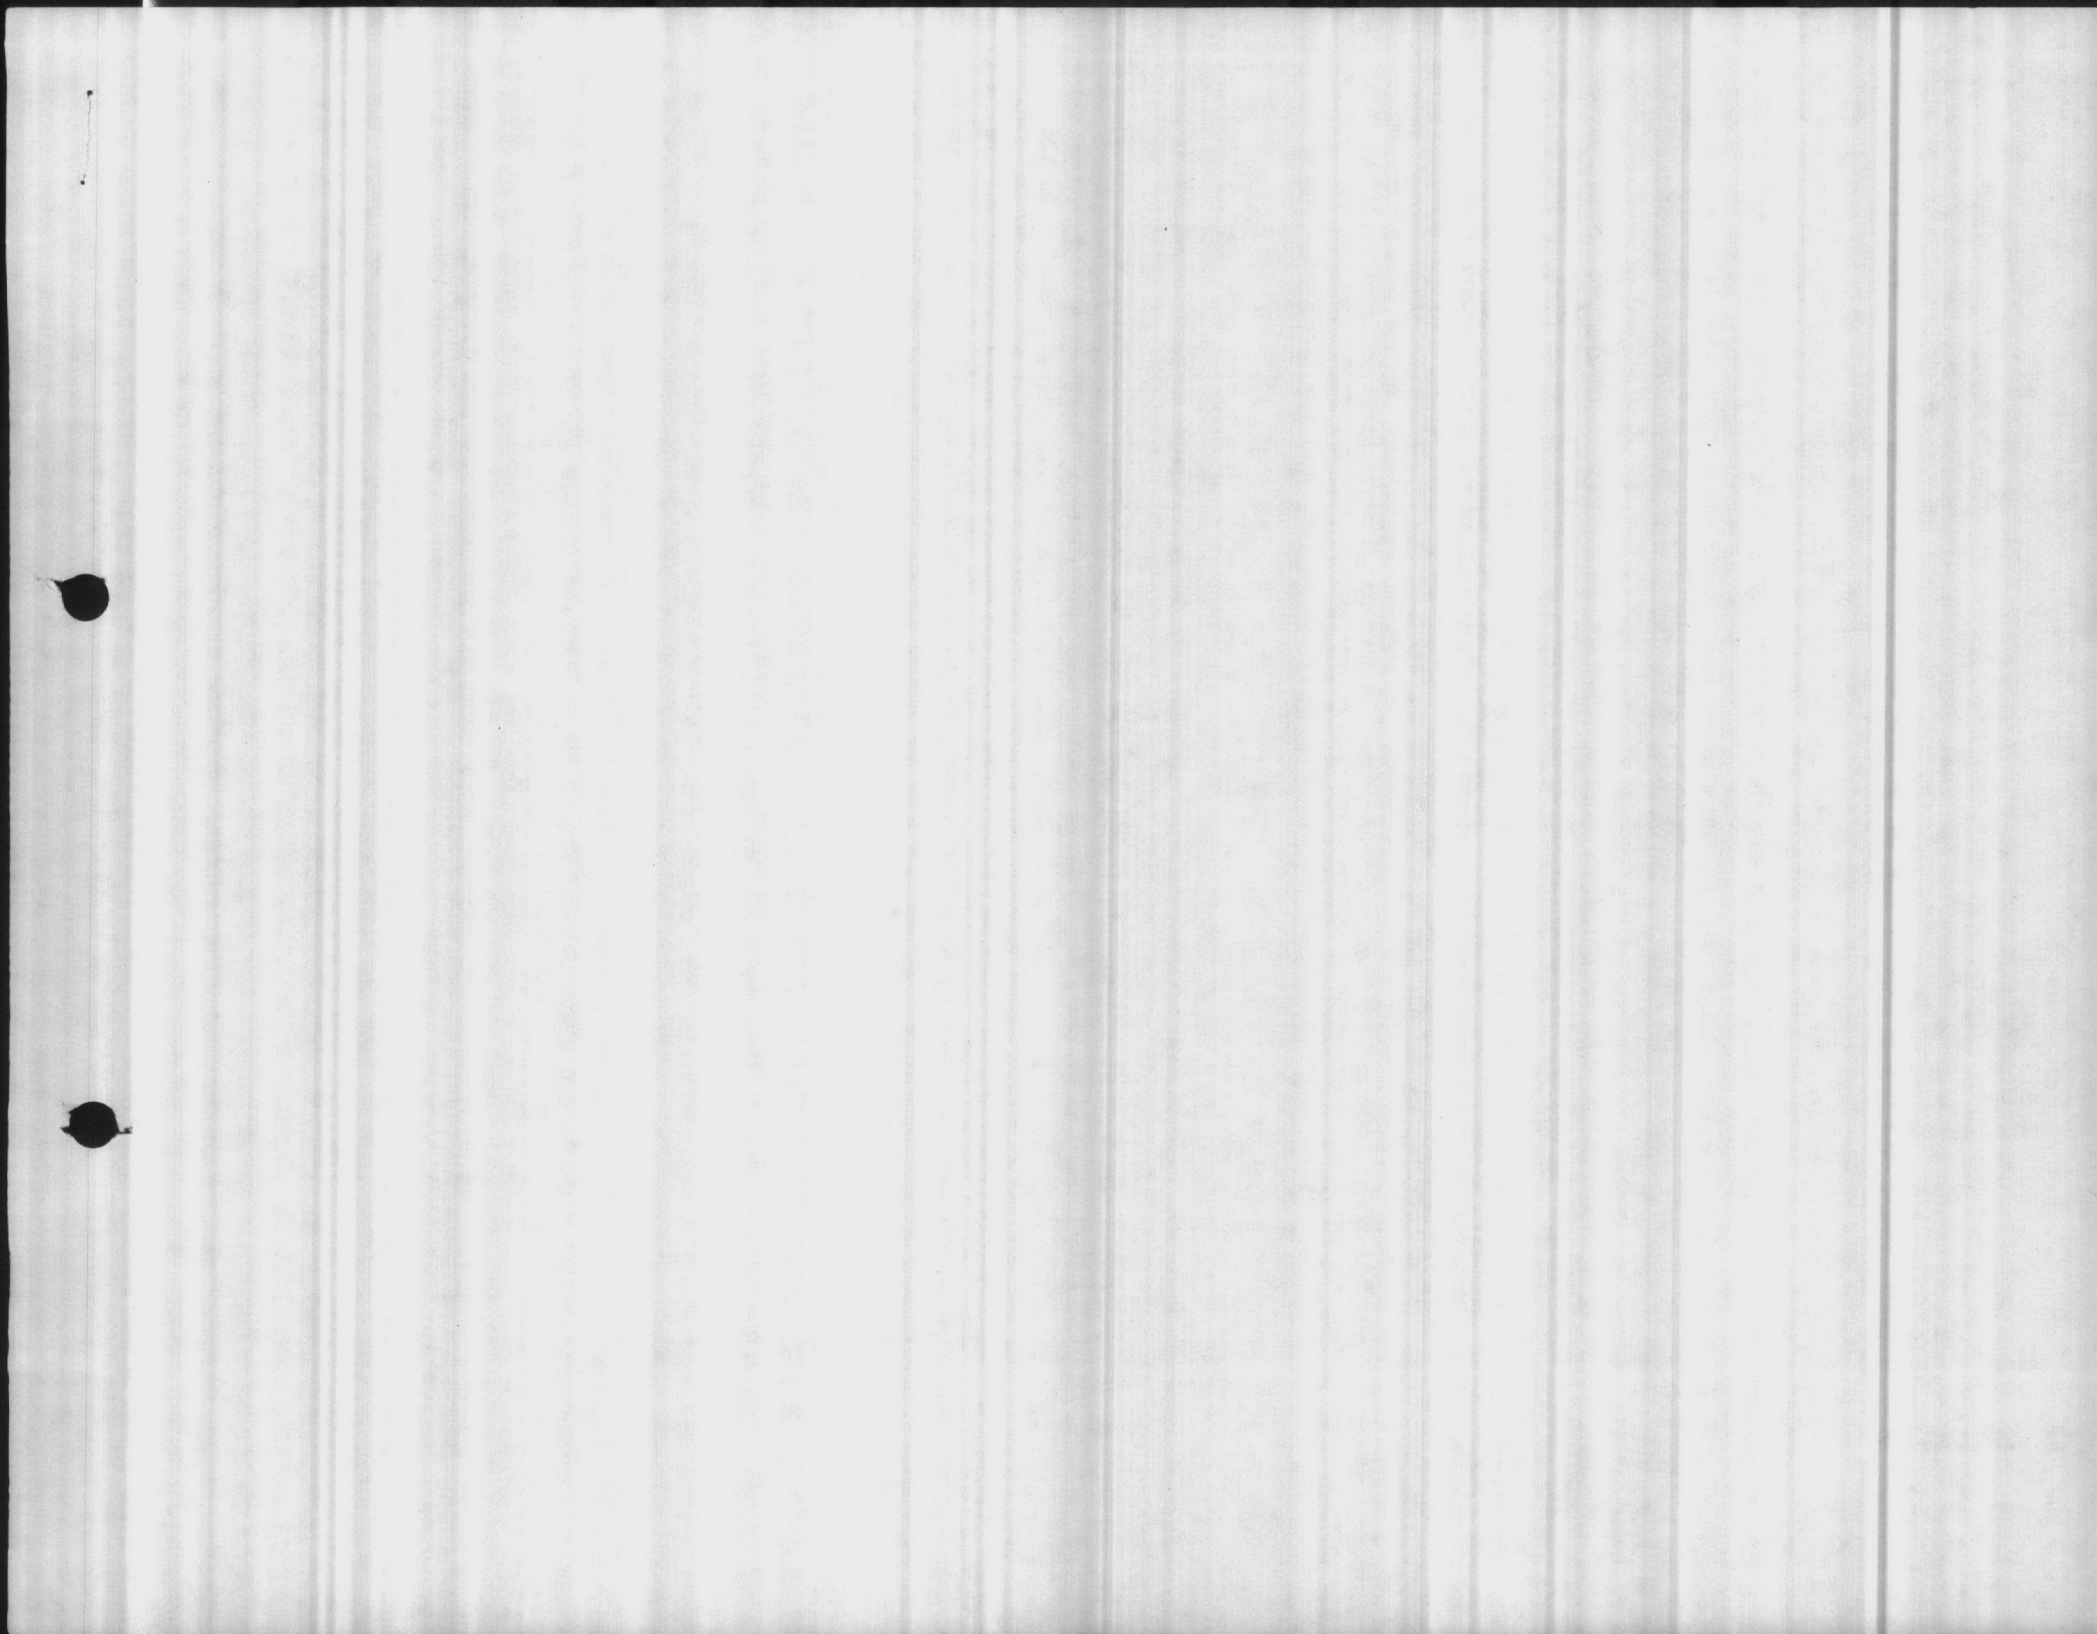


WATER TREATMENT PLANTWATER FLOWDATE: OCTOBER 1982

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	90,966	87,056	3,900	3,200	13	5,900	5,000	LIME
HOLCOMB BLVD.	38,896	37,722	1,150	1,238	3	2,304	2,000	LIME
TARAWA TERRACE	30,100	29,198	893	851	3	1,152	1,000	LIME
MONTFORD POINT	7,033	6,451	580	421	3	622	750	ZEOLITE
MCAS	30,942	28,261	2,664	1,888	3	4,081	3,500	LIME
RIFLE RANGE	8,159	7,472	685	270	3	648	600	ZEOLITE
COURTHOUSE BAY	12,935	12,166	758	458	3	864	600	ZEOLITE
ONSLow BEACH	3,363	3,203	114	241	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

HADNOT POINT, TARAWA TERRACE AND MARINE CORPS AIR STATION ESTIMATED.

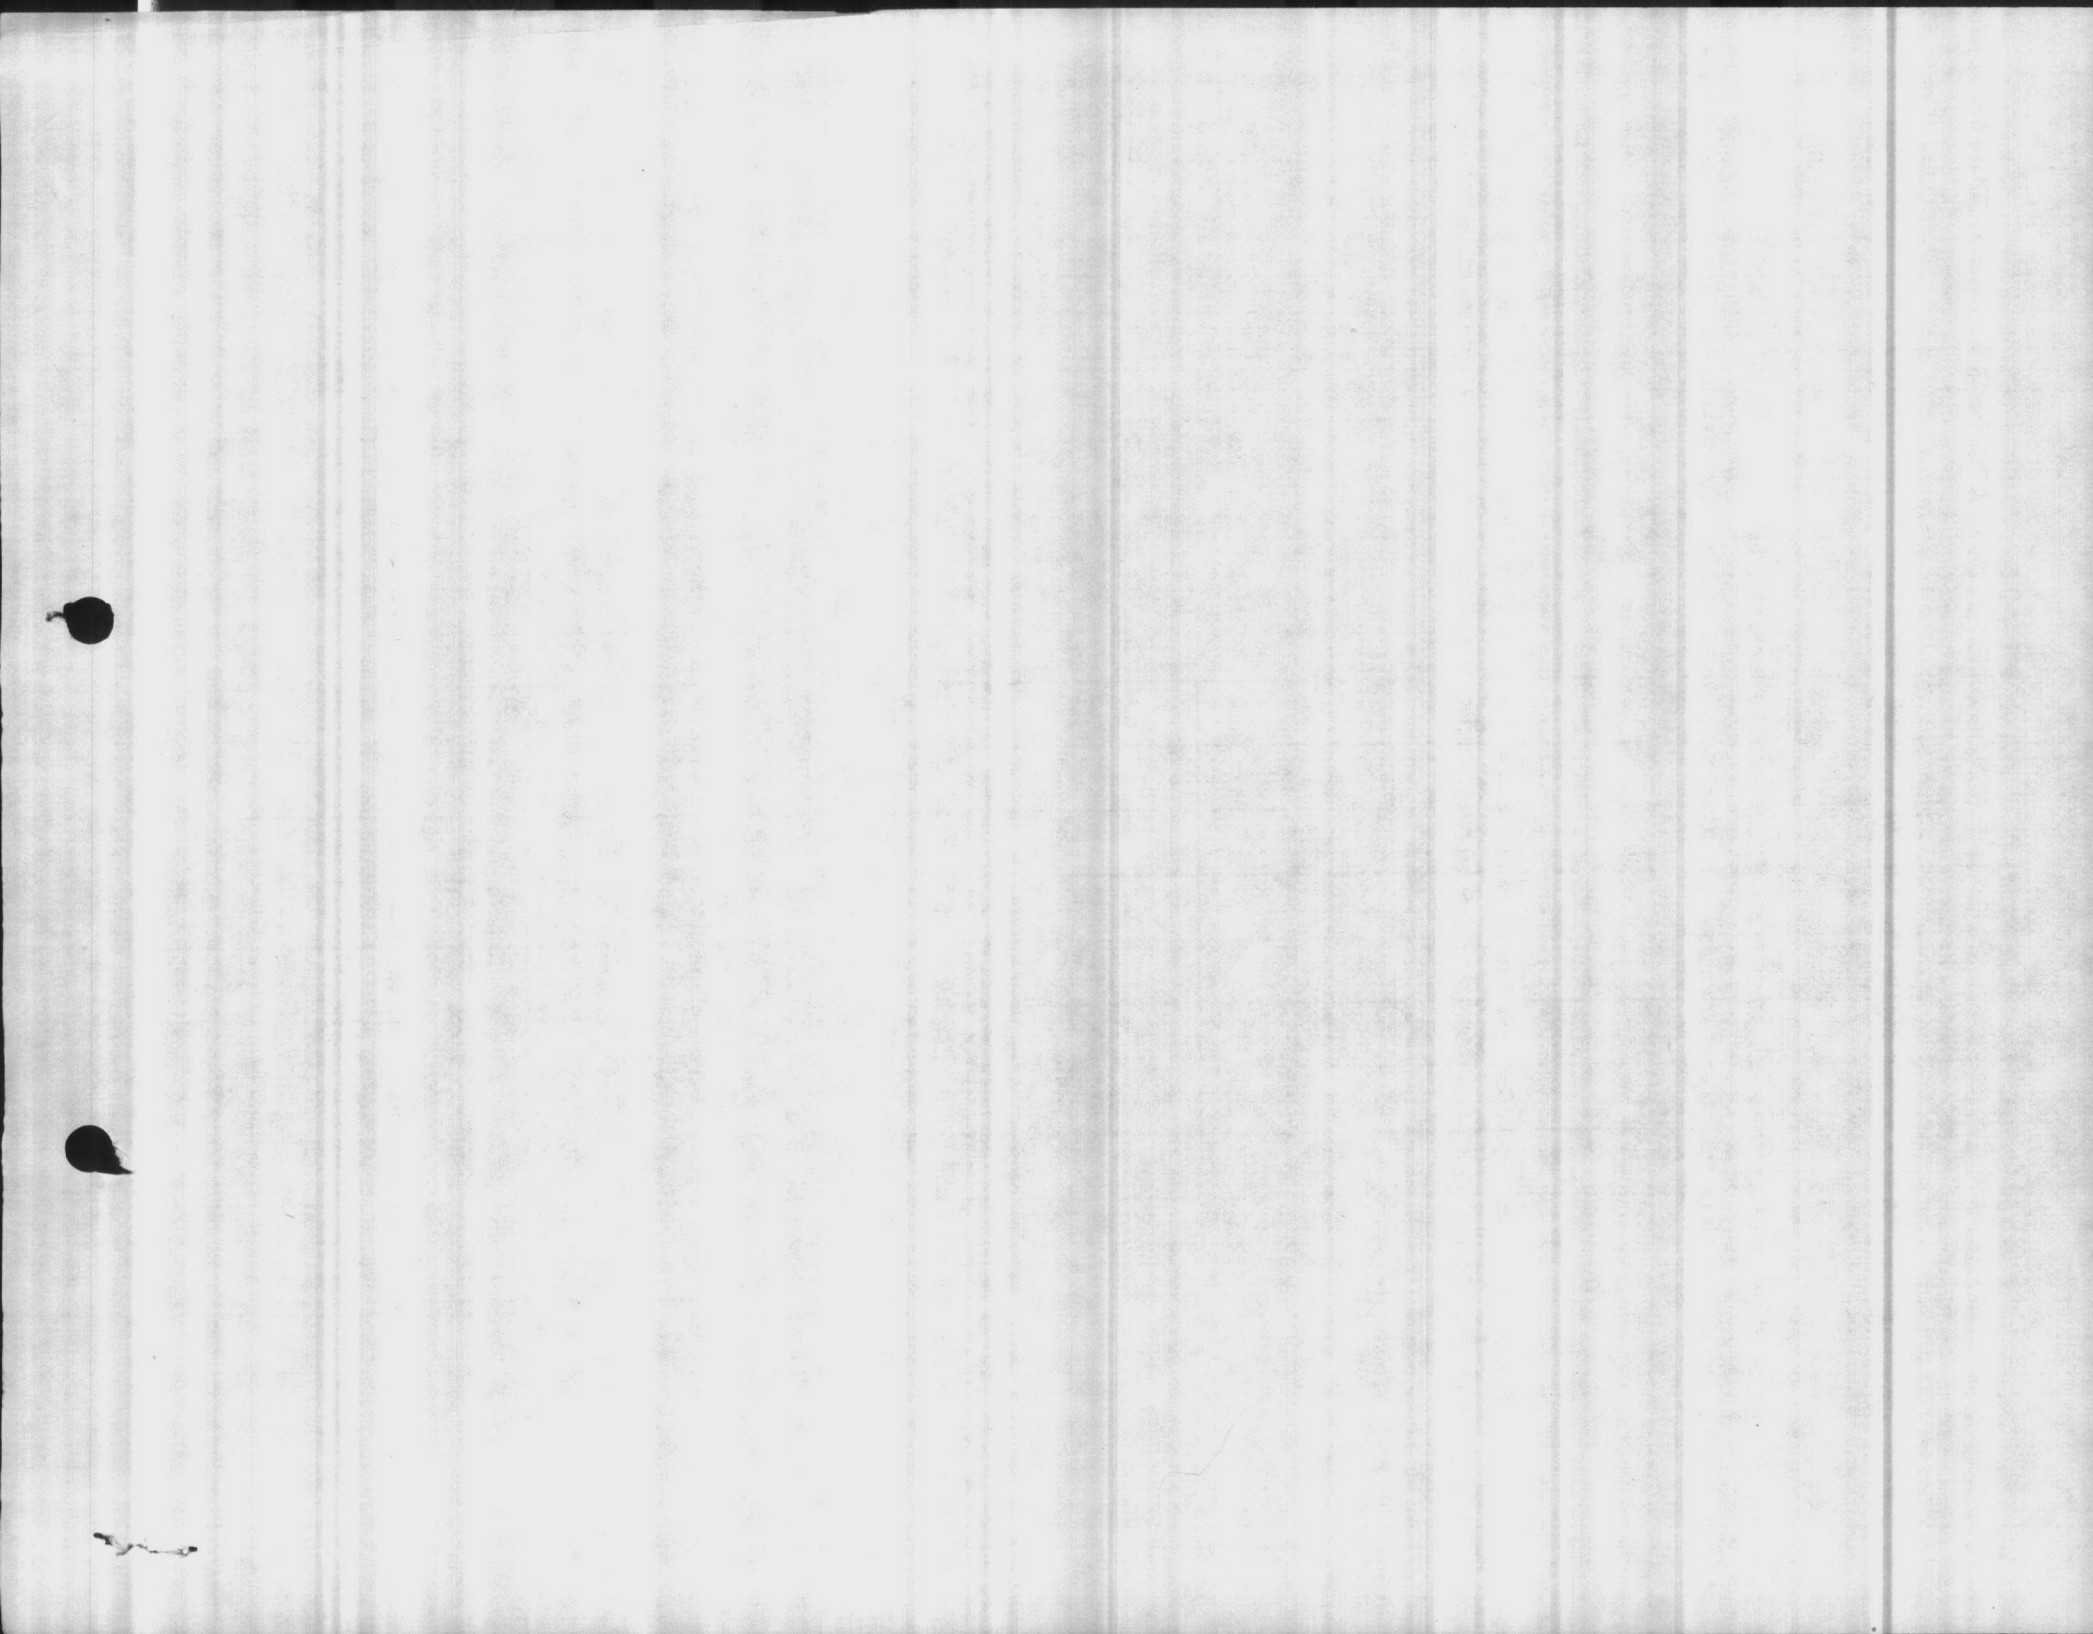

WATER TREATMENT PLANT

WATER FLOW

DATE: NOVEMBER 1982

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	102,625	96,633	5,985	3,410	13	5,900	5,000	LIME
HOLCOMB BLVD.	36,183	35,066	1,113	1,162	3	2,304	2,000	LIME
TARAWA TERRACE	22,364	21,480	864	1,494	3	1,152	1,000	LIME
MONTFORD POINT	9,066	8,511	543	384	3	622	750	ZEOLITE
MCAS	29,652	27,099	2,551	1,933	3	4,081	3,500	LIME
RIFLE RANGE	7,914	7,231	669	272	3	648	600	ZEOLITE
COURTHOUSE BAY	27,526 10,588	27,526 9,624	947	441	3	864	600	ZEOLITE
ONSLOW BEACH	3,462	2,956	125	196	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

MCAS FLOW ESTIMATED DUE TO MECHANICAL FAILURE OF TOTALIZERS.



WATER TREATMENT PLANTWATER FLOWDATE: December 1982


PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	103,626	97,433	6,184	3,480	13	5,900	5,000	LIME
HOLCOMB BLVD.	35,169	33,988	1,150	1,672	3	2,304	2,000	LIME
TARAWA TERRACE	26,126	25,223	893	895	3	1,152	1,000	LIME
MONTFORD POINT	9,359	8,765	585	478	3	622	750	ZEOLITE
MCAS	32,361	29,688	2,666	2,033	3	4,081	3,500	LIME
RIFLE RANGE	8,149	7,471	675	289	3	648	600	ZEOLITE
COURTHOUSE BAY	13,272	12,482	774	374	3	864	600	ZEOLITE
ONSLow BEACH	3,199	2,747	121	115	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

MCAS FLOW ESTIMATED DUE TO MECHANICAL FAILURE OF TOTALIZERS.

(Parts on Order)

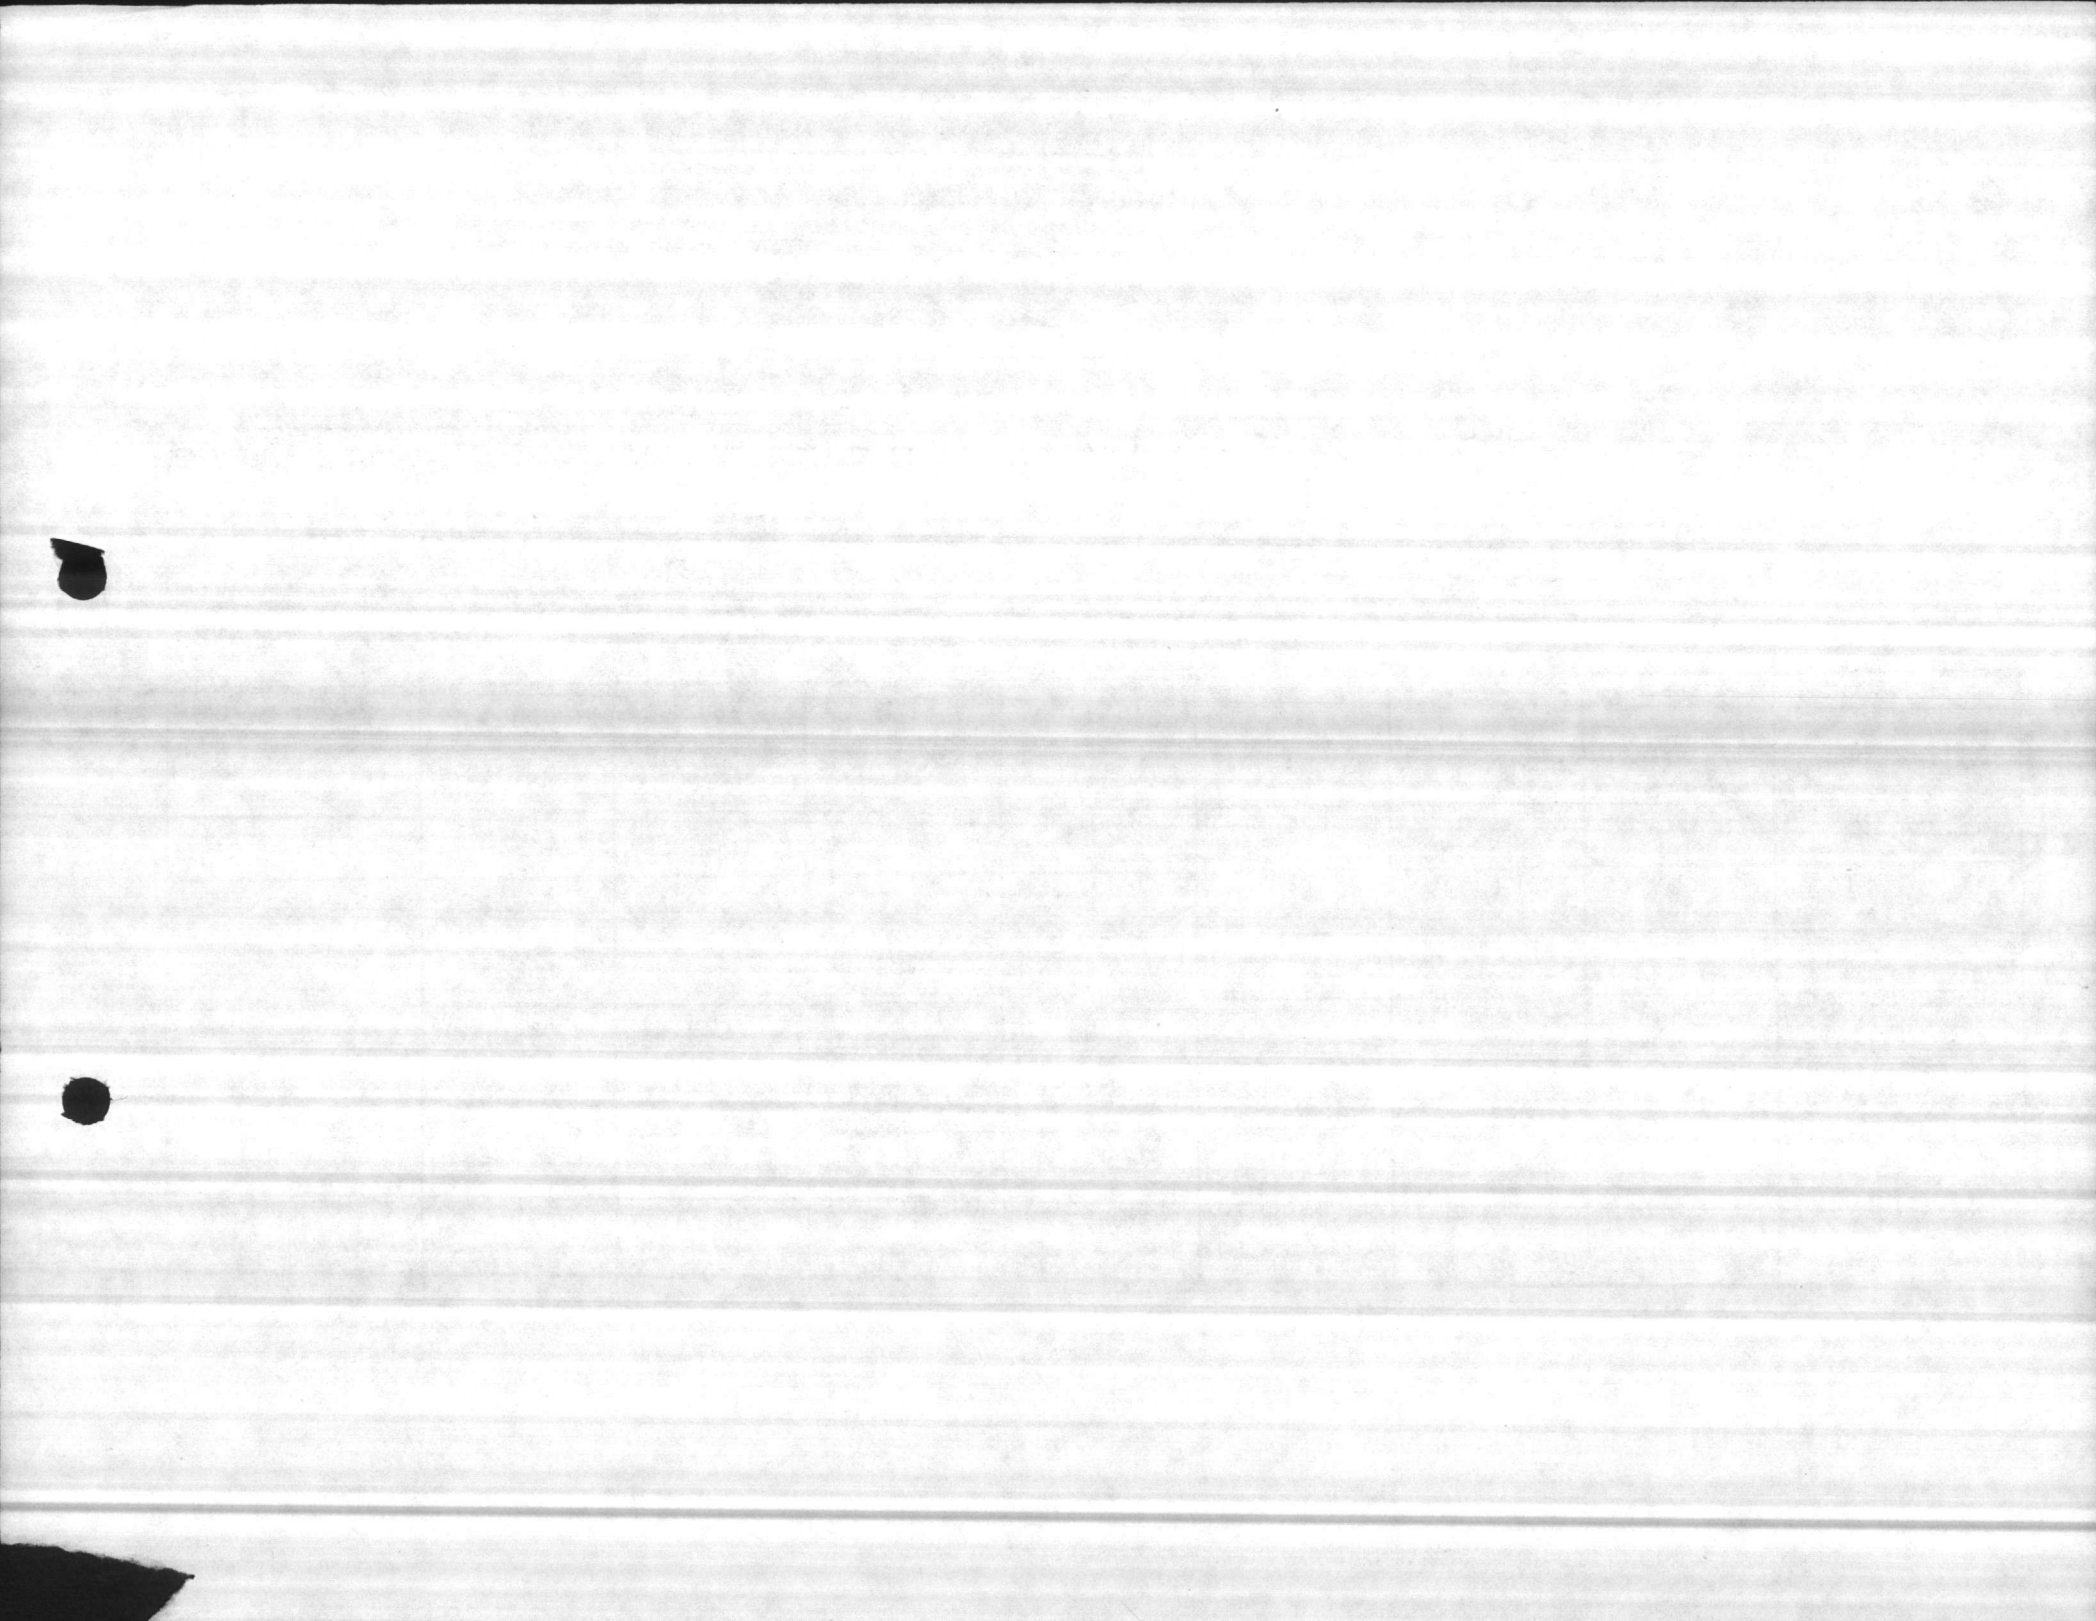


WATER TREATMENT PLANTWATER FLOWDATE: January 1983

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	100,353	95,386	4,947	3,464	13	5,900	5,000	LIME
HOLCOMB BLVD.	32,667Est	31,352	1,150	2,130	3	2,304	2,000	LIME
TARAWA TERRACE	25,888	24,980	893	926	3	1,152	1,000	LIME
MONTFORD POINT	9,483	9,361	666	464	3	622	750	ZEOLITE
MCAS	30,417Est	28,001	2,406	1,989	3	4,081	3,500	LIME
RIFLE RANGE	9,289	8,563	718	363	3	648	600	ZEOLITE
COURTHOUSE BAY	12,842	11,113	803	439	3	864	600	ZEOLITE
ONSLow BEACH	2,915	1,616	90	101	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

MCAS FLOW ESTIMATED DUE TO MECHANICAL FAILURE OF TOTALIZERS. (PARTS ON ORDER)

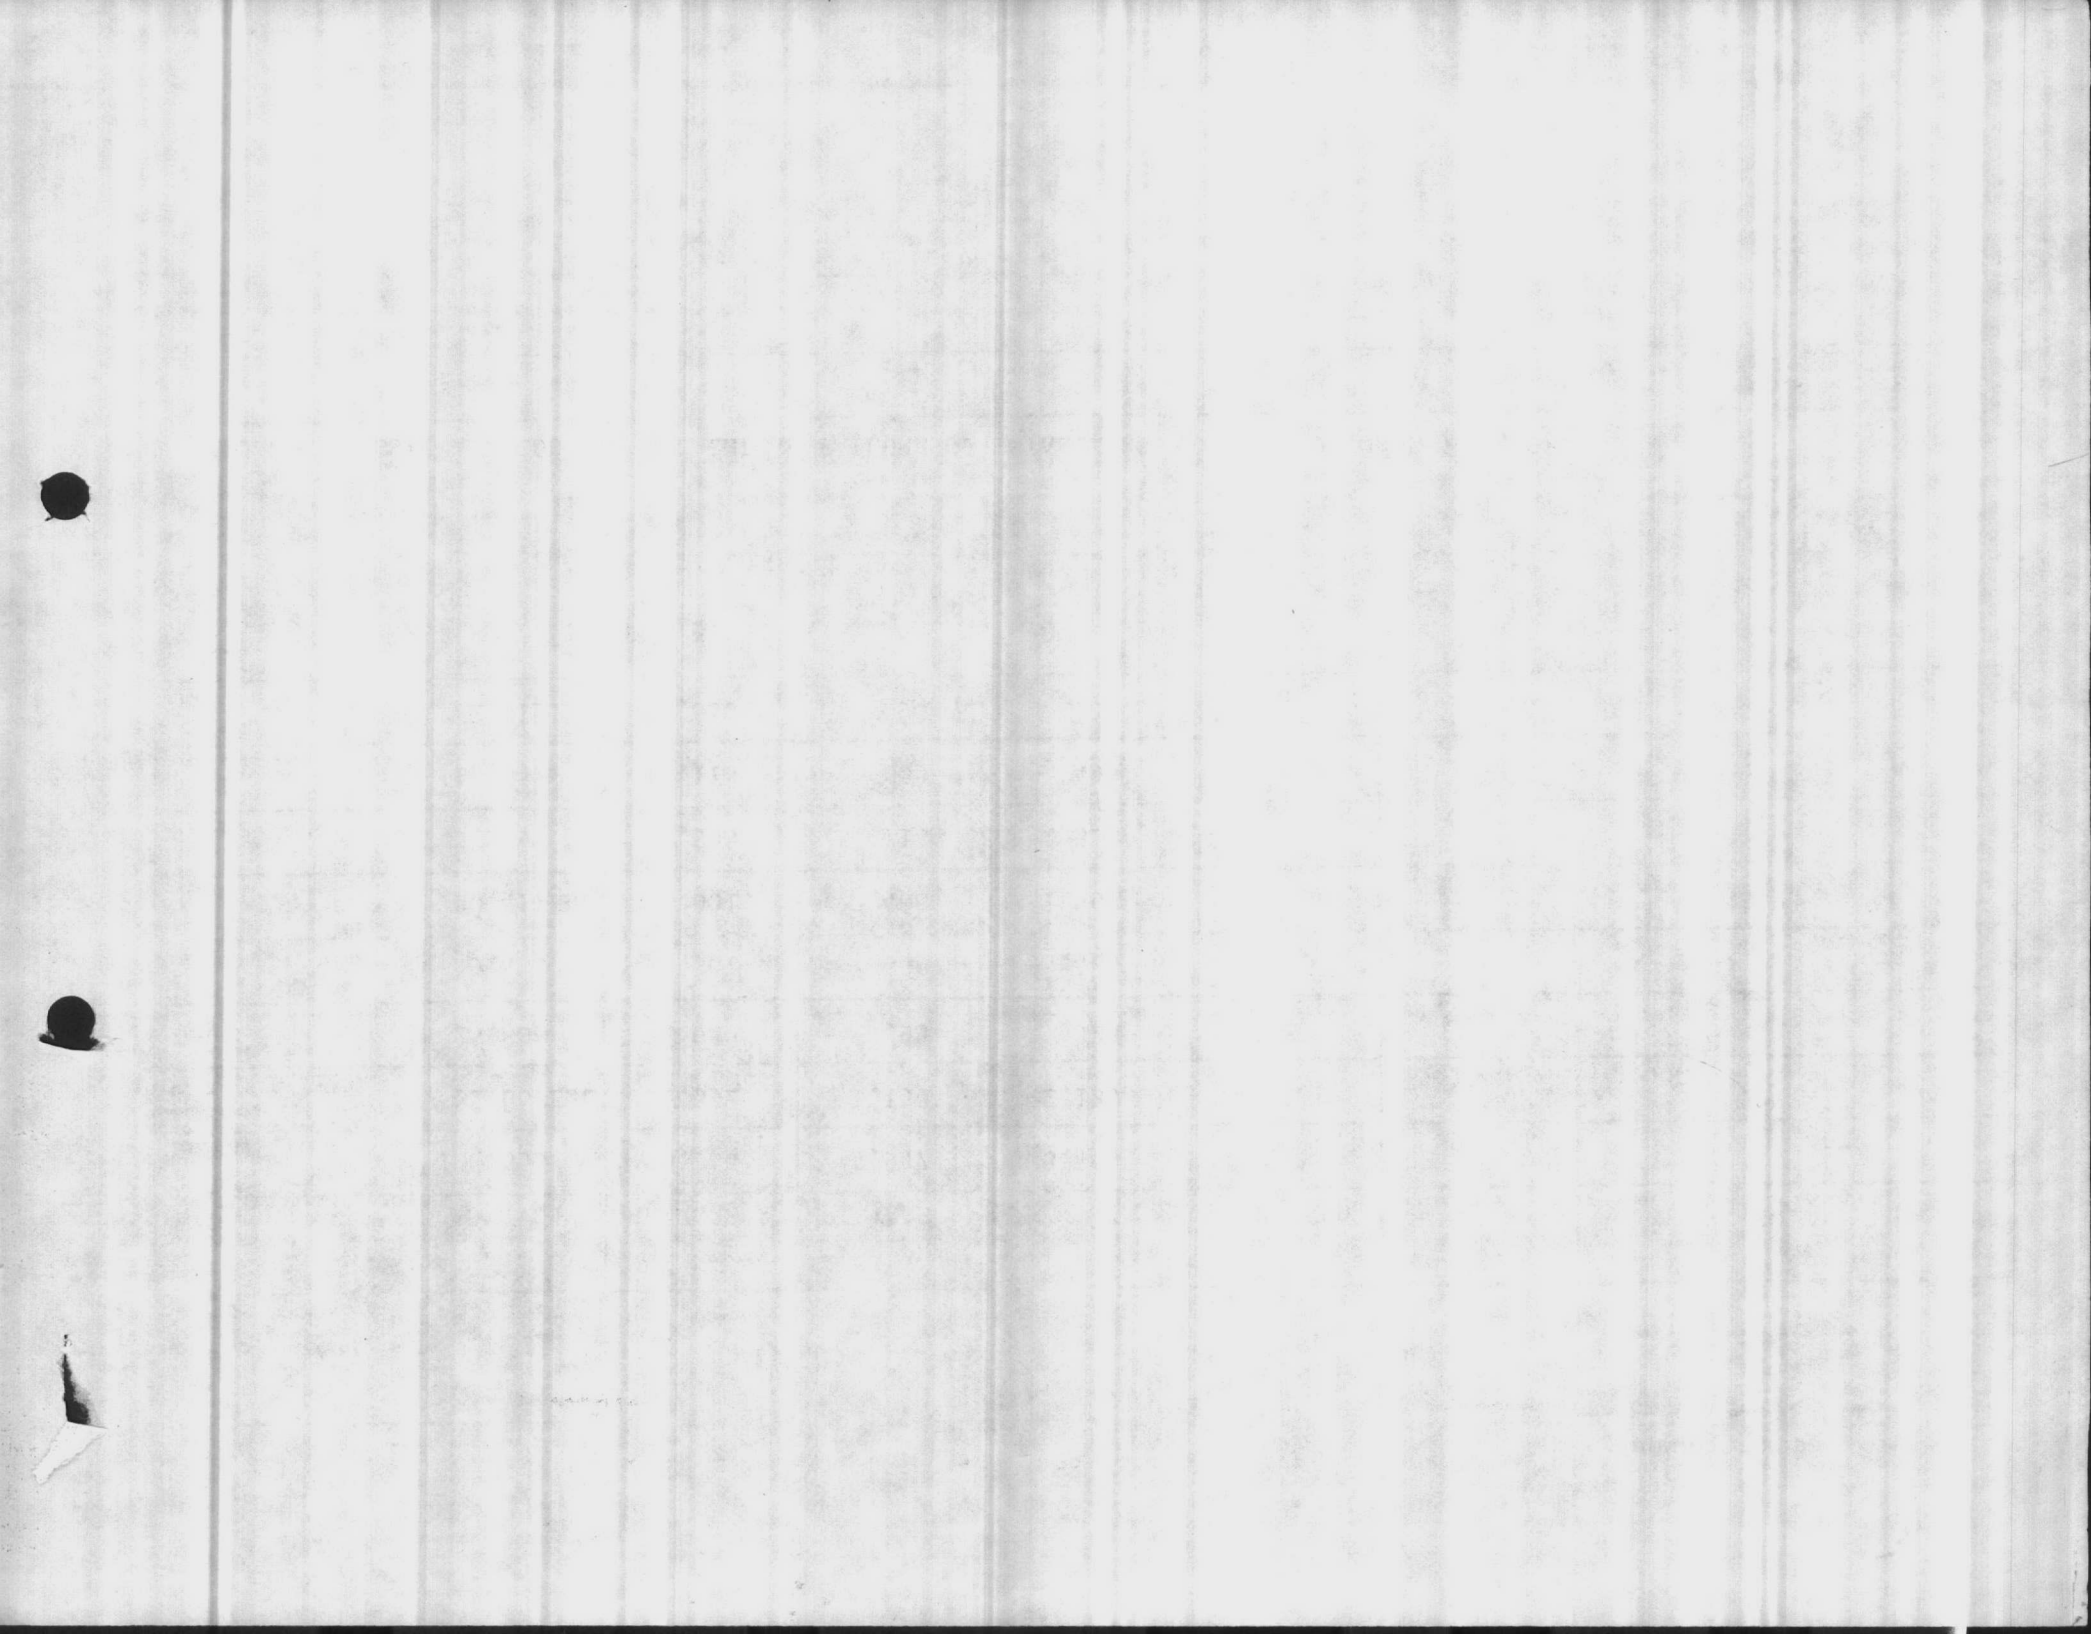

WATER TREATMENT PLANT

WATER FLOW


DATE: FEBRUARY 1963

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	87,560	83,654	4,469	3,424	13	5,900	5,000	LIME
HOLCOMB BLVD.	38,119	31,409	1,447	1,985	3	2,304	2,000	LIME
TARAWA TERRACE	23,071	22,960	.672	.968	3	1,152	1,000	LIME
MONTFORD POINT	9,338	9,118	.652	.514	3	622	750	ZEOLITE
MCAS (Estimated)	27,111	24,604	2,496	2,103	3	4,081	3,500	LIME
RIFLE RANGE	4,731	3,914	.610	.340	3	648	600	ZEOLITE
COURTHOUSE BAY	9,245	9,313	.696	.673	3	864	600	ZEOLITE
ONSLow BEACH	1,491	1,358	.099	.059	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

MCAS estimated due to mechanical failure of totalizers. (Parts on Order).

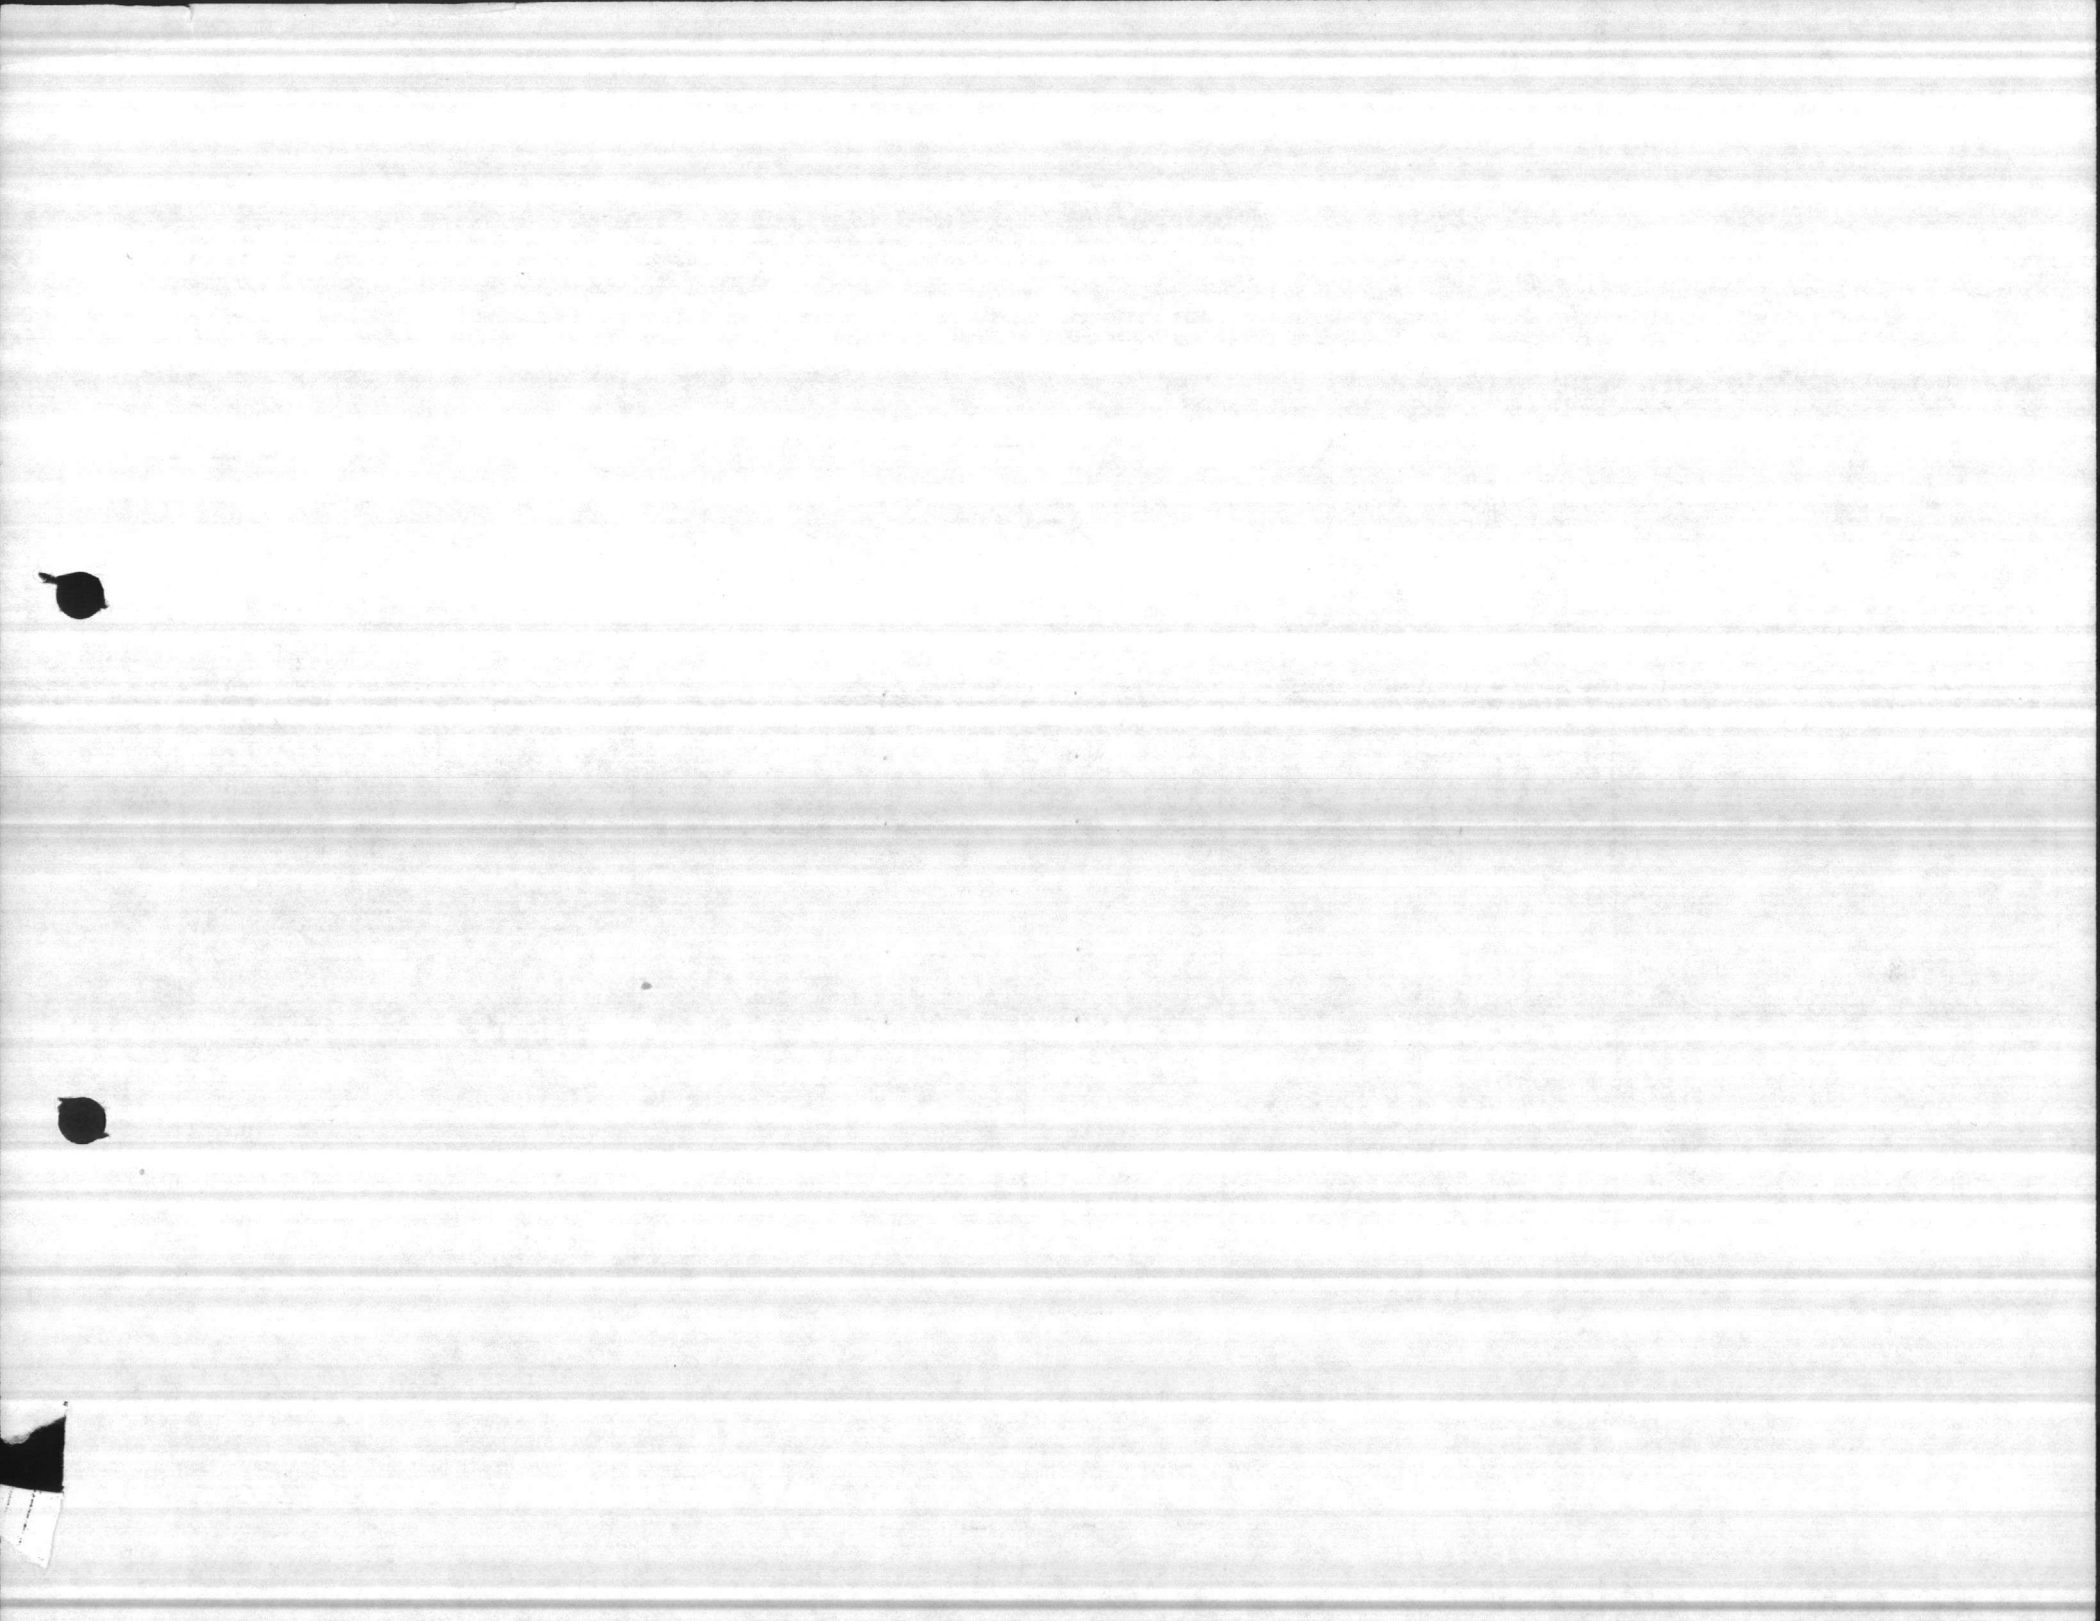

WATER TREATMENT PLANT

WATER FLOW

DATE: 4 April 1983

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	94,965	90,241	4,150	3,621	13	5,900	5,000	LIME
HOLCOMB BLVD.	33,649	30,585	1,150	1,150	3	2,304	2,000	LIME
TARAWA TERRACE	26,332	25,510	.802	.924	3	1,152	1,000	LIME
MONTFORD POINT	8,939	8,245	.622	.482	3	622	750	ZEOLITE
MCAS	33,760	26,960	2,300	1,296	3	4,081	3,500	LIME
RIFLE RANGE	9,341	8,624	.714	.310	3	648	600	ZEOLITE
COURTHOUSE BAY	12,524	11,685	.783	.457	3	864	600	ZEOLITE
ONSLow BEACH	2,770	2,658	.109	.080	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:



WATER TREATMENT PLANTWATER FLOWDATE: APRIL 1983

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	88,787	81,355	4,110	83,033	13	5,900	5,000	LIME
HOLCOMB BLVD.	34,071	31,666	1,113	1,316	3	2,304	2,000	LIME
TARAWA TERRACE	27,388	26,510	864	928	3	1,152	1,000	LIME
MONTFORD POINT	8,111	7,425	684	298	3	622	750	ZEOLITE
MCAS	29,079	27,081	2,880	1,159	3	4,081	3,500	LIME
RIFLE RANGE	8,259	7,582	673	268	3	648	600	ZEOLITE
COURTHOUSE BAY	13,373	11,086	761	487	3	864	600	ZEOLITE
ONSLow BEACH	2,744	2,377	108	103	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS :



WATER TREATMENT PLANT

WATER FLOW

DATE: MAY 1983

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	93,482	87,290	6,184	3,928	13	5,900	5,000	LIME
HOLCOMB BLVD.	48,936	47,050	1,150	2,157	3	2,304	2,000	LIME
TARAWA TERRACE	29,266	28,476	744	1,071	3	1,152	1,000	LIME
MONTFORD POINT	9,408	8,801	601	432	3	622	750	ZEOLITE
MCAS	33,764	29,683	2,640	1,245	3	4,081	3,500	LIME
RIFLE RANGE	8,867	8,164	694	332	3	648	600	ZEOLITE
COURTHOUSE BAY	11,798	11,006	768	416	3	864	600	ZEOLITE
ONSLOW BEACH	3,745	3,599	139	145	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:




WATER TREATMENT PLANTWATER FLOWDATE: JUNE 1983

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	100,512	94,968	4,389	3,773	13	5,900	5,000	LIME
HOLCOMB BLVD.	51,986	50,864	1,113	2,300	3	2,304	2,000	LIME
TARAWA TERRACE	31,792	30,923	864	1,146	3	1,152	1,000	LIME
MONTFORD POINT	10,319	9,709	601	408	3	622	750	ZEOLITE
MCAS	34,447	30,525	2,880	1,196	3	4,081	3,500	LIME
RIFLE RANGE	8,007	7,332	673	278	3	648	600	ZEOLITE
COURTHOUSE BAY	12,874	11,016	437	730	3	864	600	ZEOLITE
ONSLOW BEACH	3,152	2,953	160	173	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

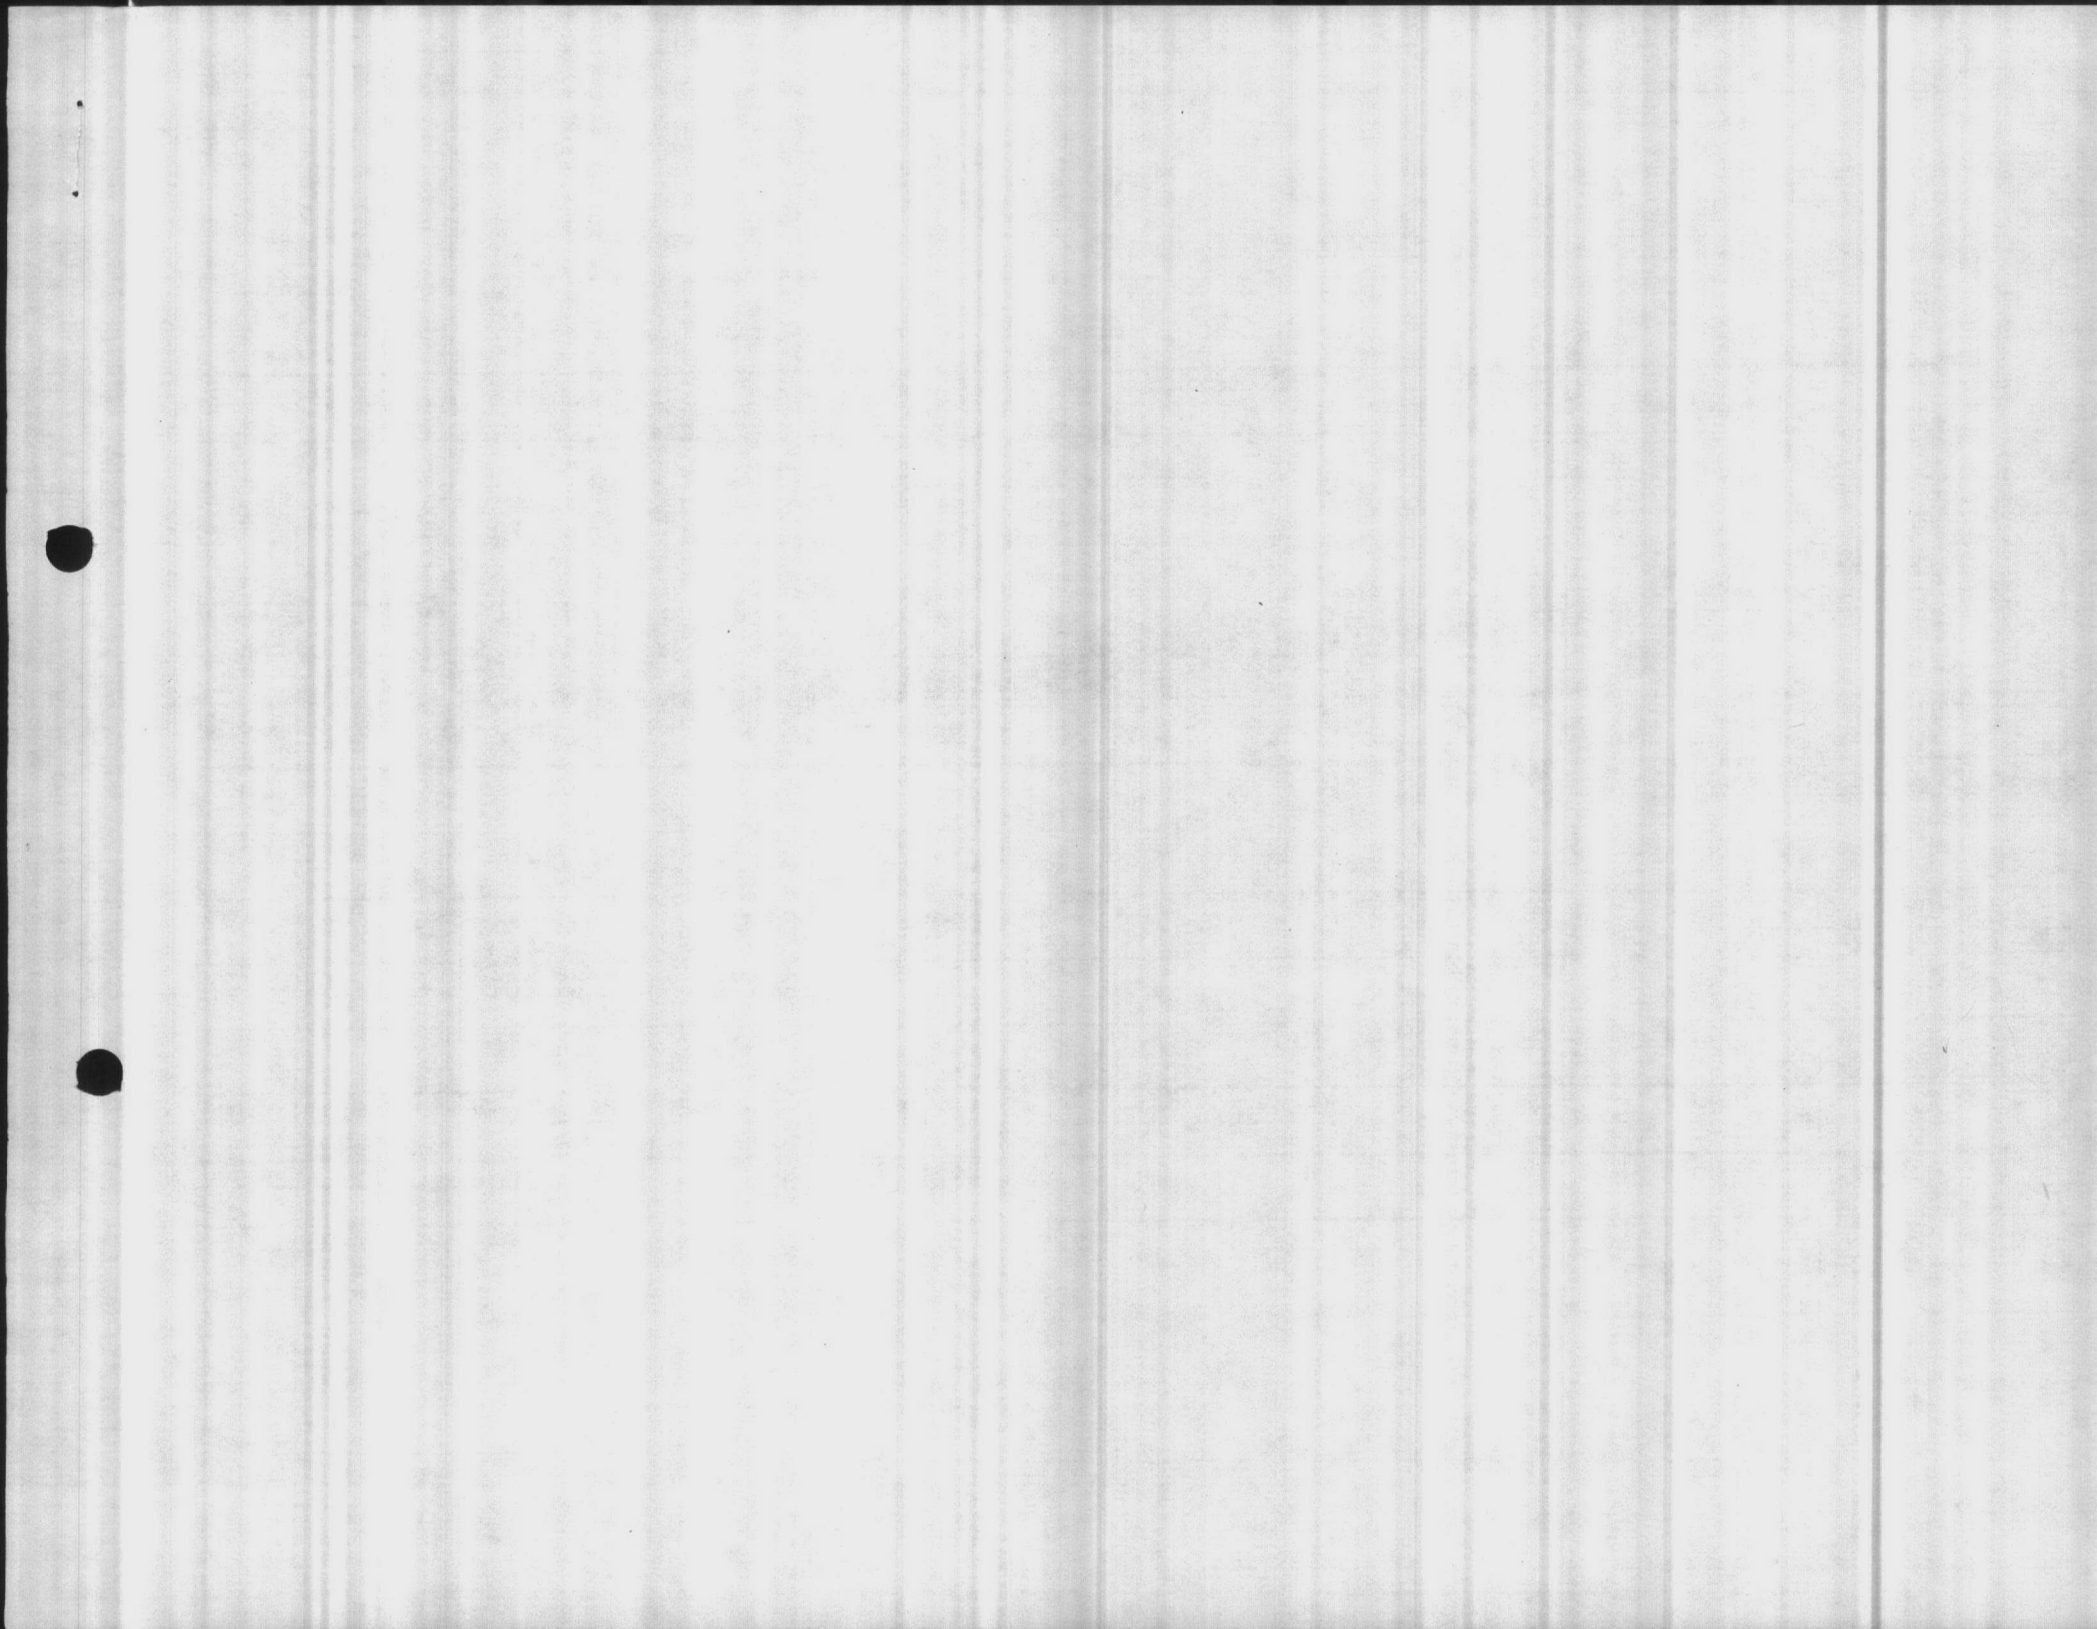


WATER TREATMENT PLANTWATER FLOWDATE: JUL 1983

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	106,298	98,596	4,632	4,300	13	5,900	5,000	LIME
HOLCOMB BLVD.	44,793	43,639	1,150	1,719	3	2,304	2,000	LIME
TARAWA TERRACE	31,879	30,978	1,892	1,207	3	1,152	1,000	LIME
MONTFORD POINT	12,979	11,790	1,602	1,552	3	622	750	ZEOLITE
MCAS	32,884	27,610	3,024	1,105	3	4,081	3,500	LIME
RIFLE RANGE	8,291	7,587	1,696	1,313	3	648	600	ZEOLITE
COURTHOUSE BAY	14,263	11,881	1,805	1,472	3	864	600	ZEOLITE
ONSLow BEACH	3,979	2,838	1,132	1,180	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

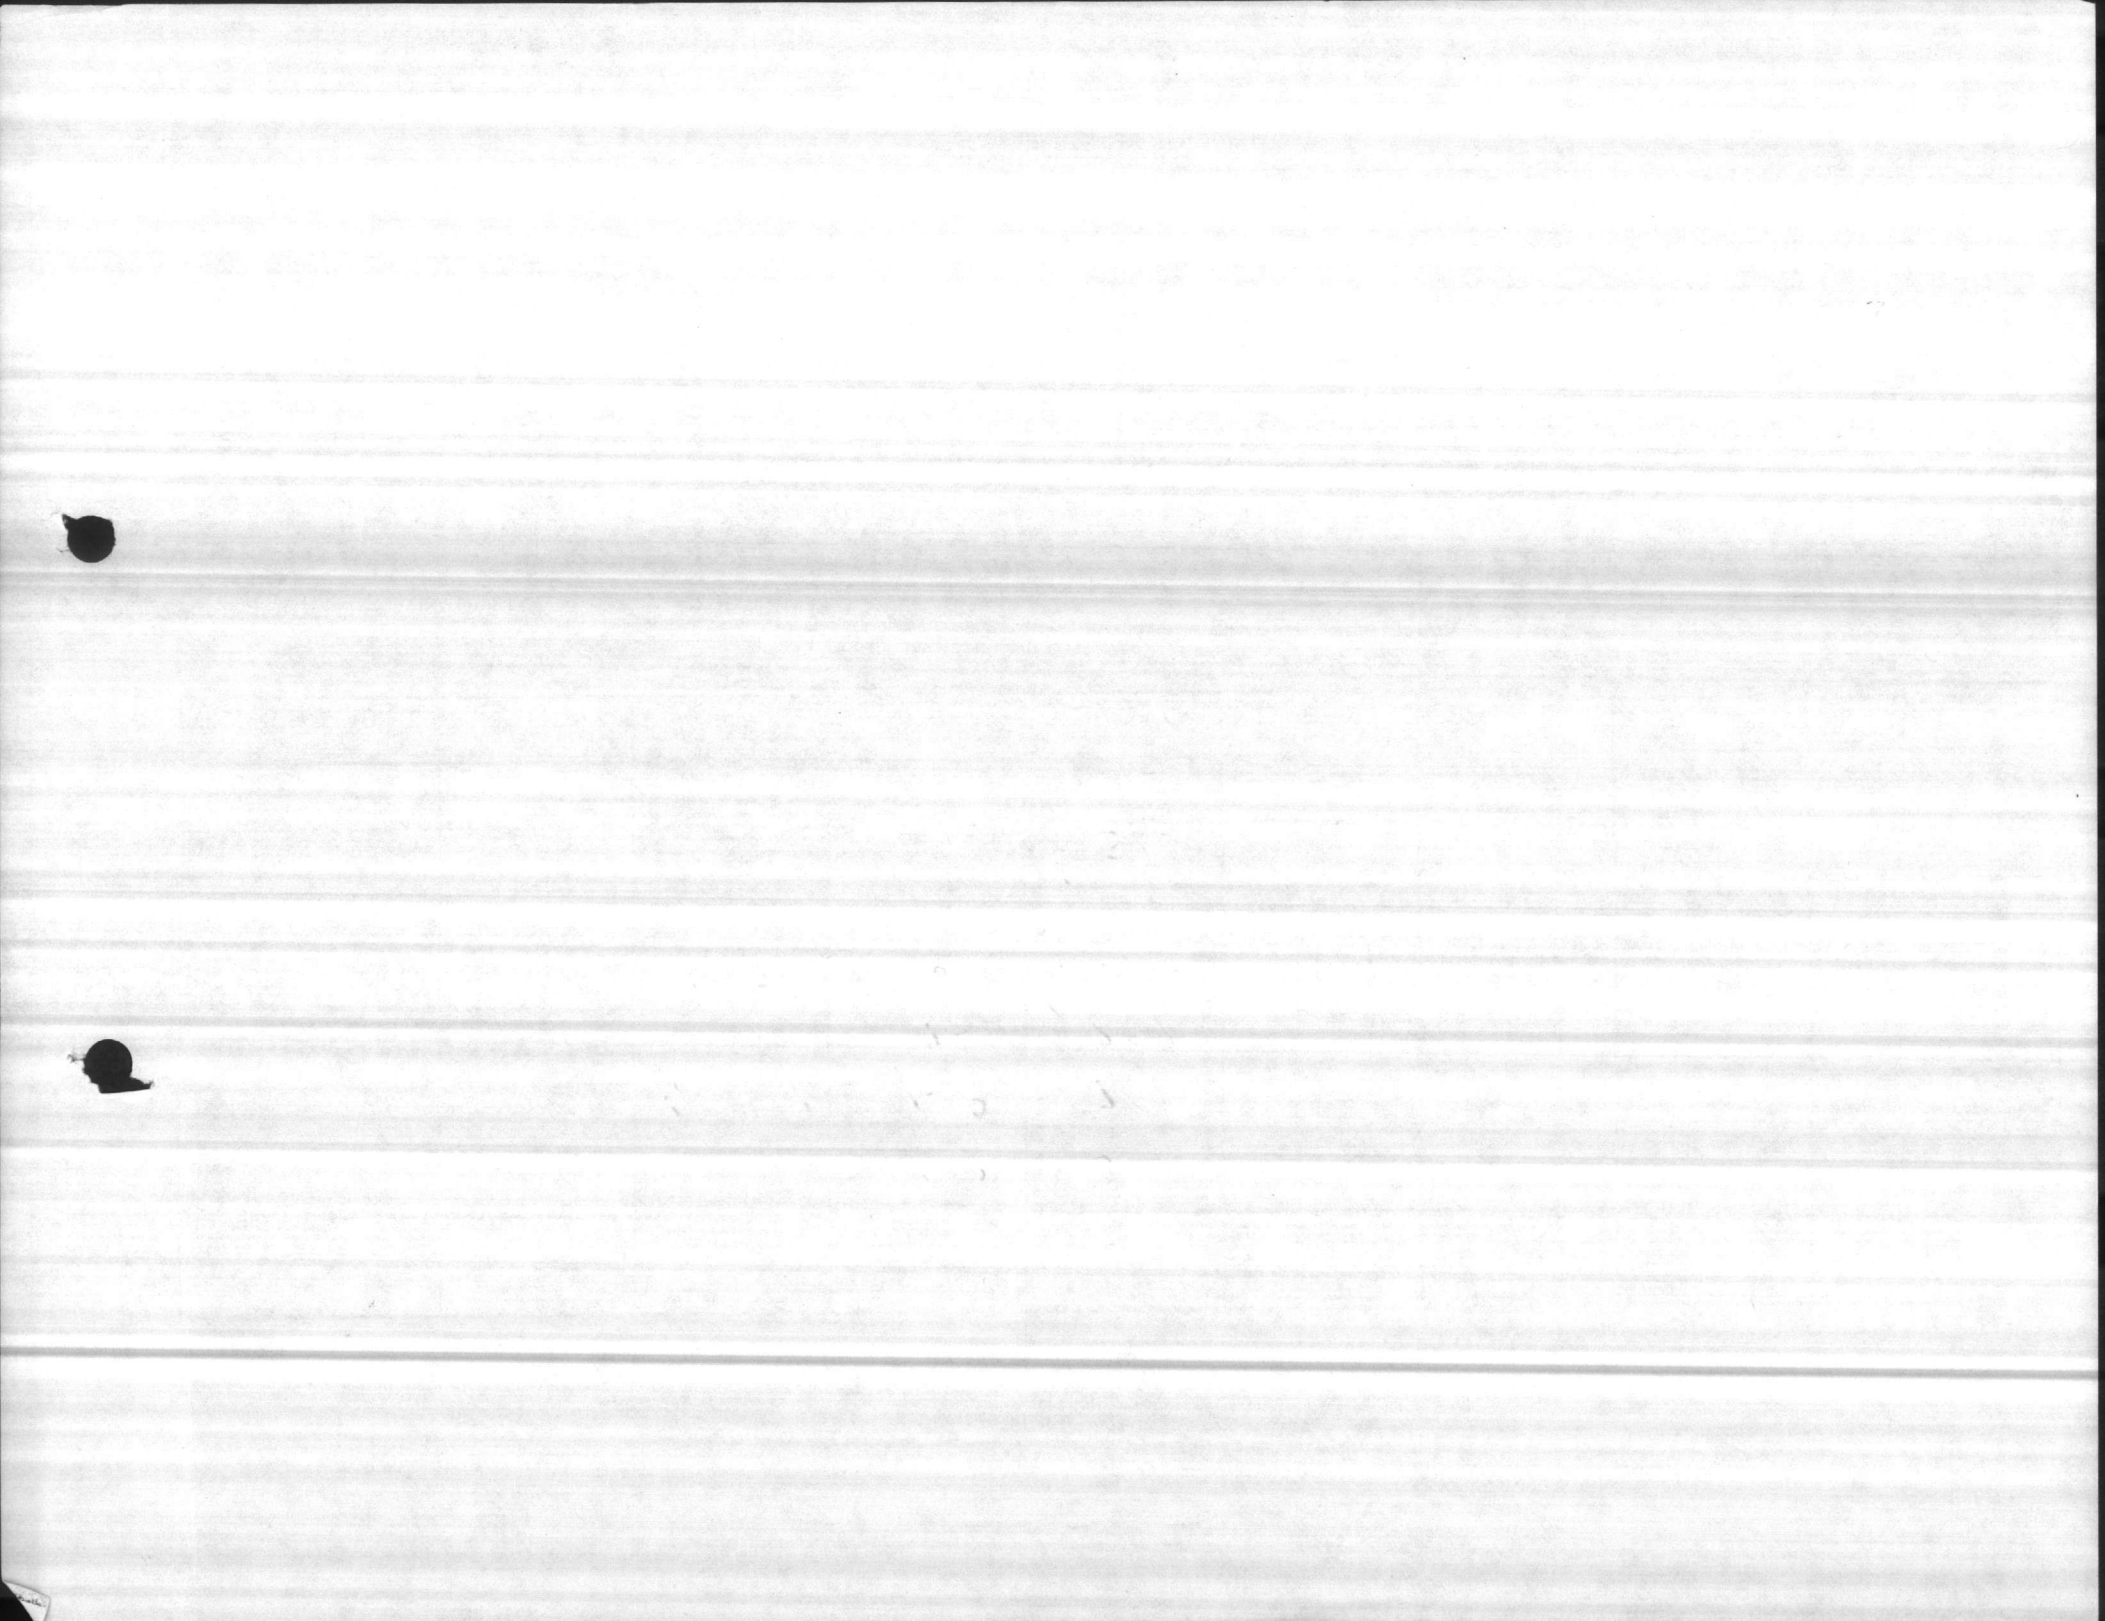


WATER TREATMENT PLANTWATER FLOWDATE: AUGUST 1983

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	108,033	101,844	6,184	3,935	13	5,900	5,000	LIME
HOLCOMB BLVD.	46,342	45,184	1,150	1,916	3	2,304	2,000	LIME
TARAWA TERRACE	33,209	32,313	.890	1,192	3	1,152	1,000	LIME
MONTFORD POINT	15,989	15,477	.506	.517	3	622	750	ZEOLITE
MCAS	33,881	30,536	2,880	1,075	3	4,081	3,500	LIME
RIFLE RANGE	8,111	7,447	.661	.307	3	648	600	ZEOLITE
COURTHOUSE BAY	15,077	13,362	.833	.523	3	864	600	ZEOLITE
ONSLOW BEACH	2,991	2,405	.154	.171	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

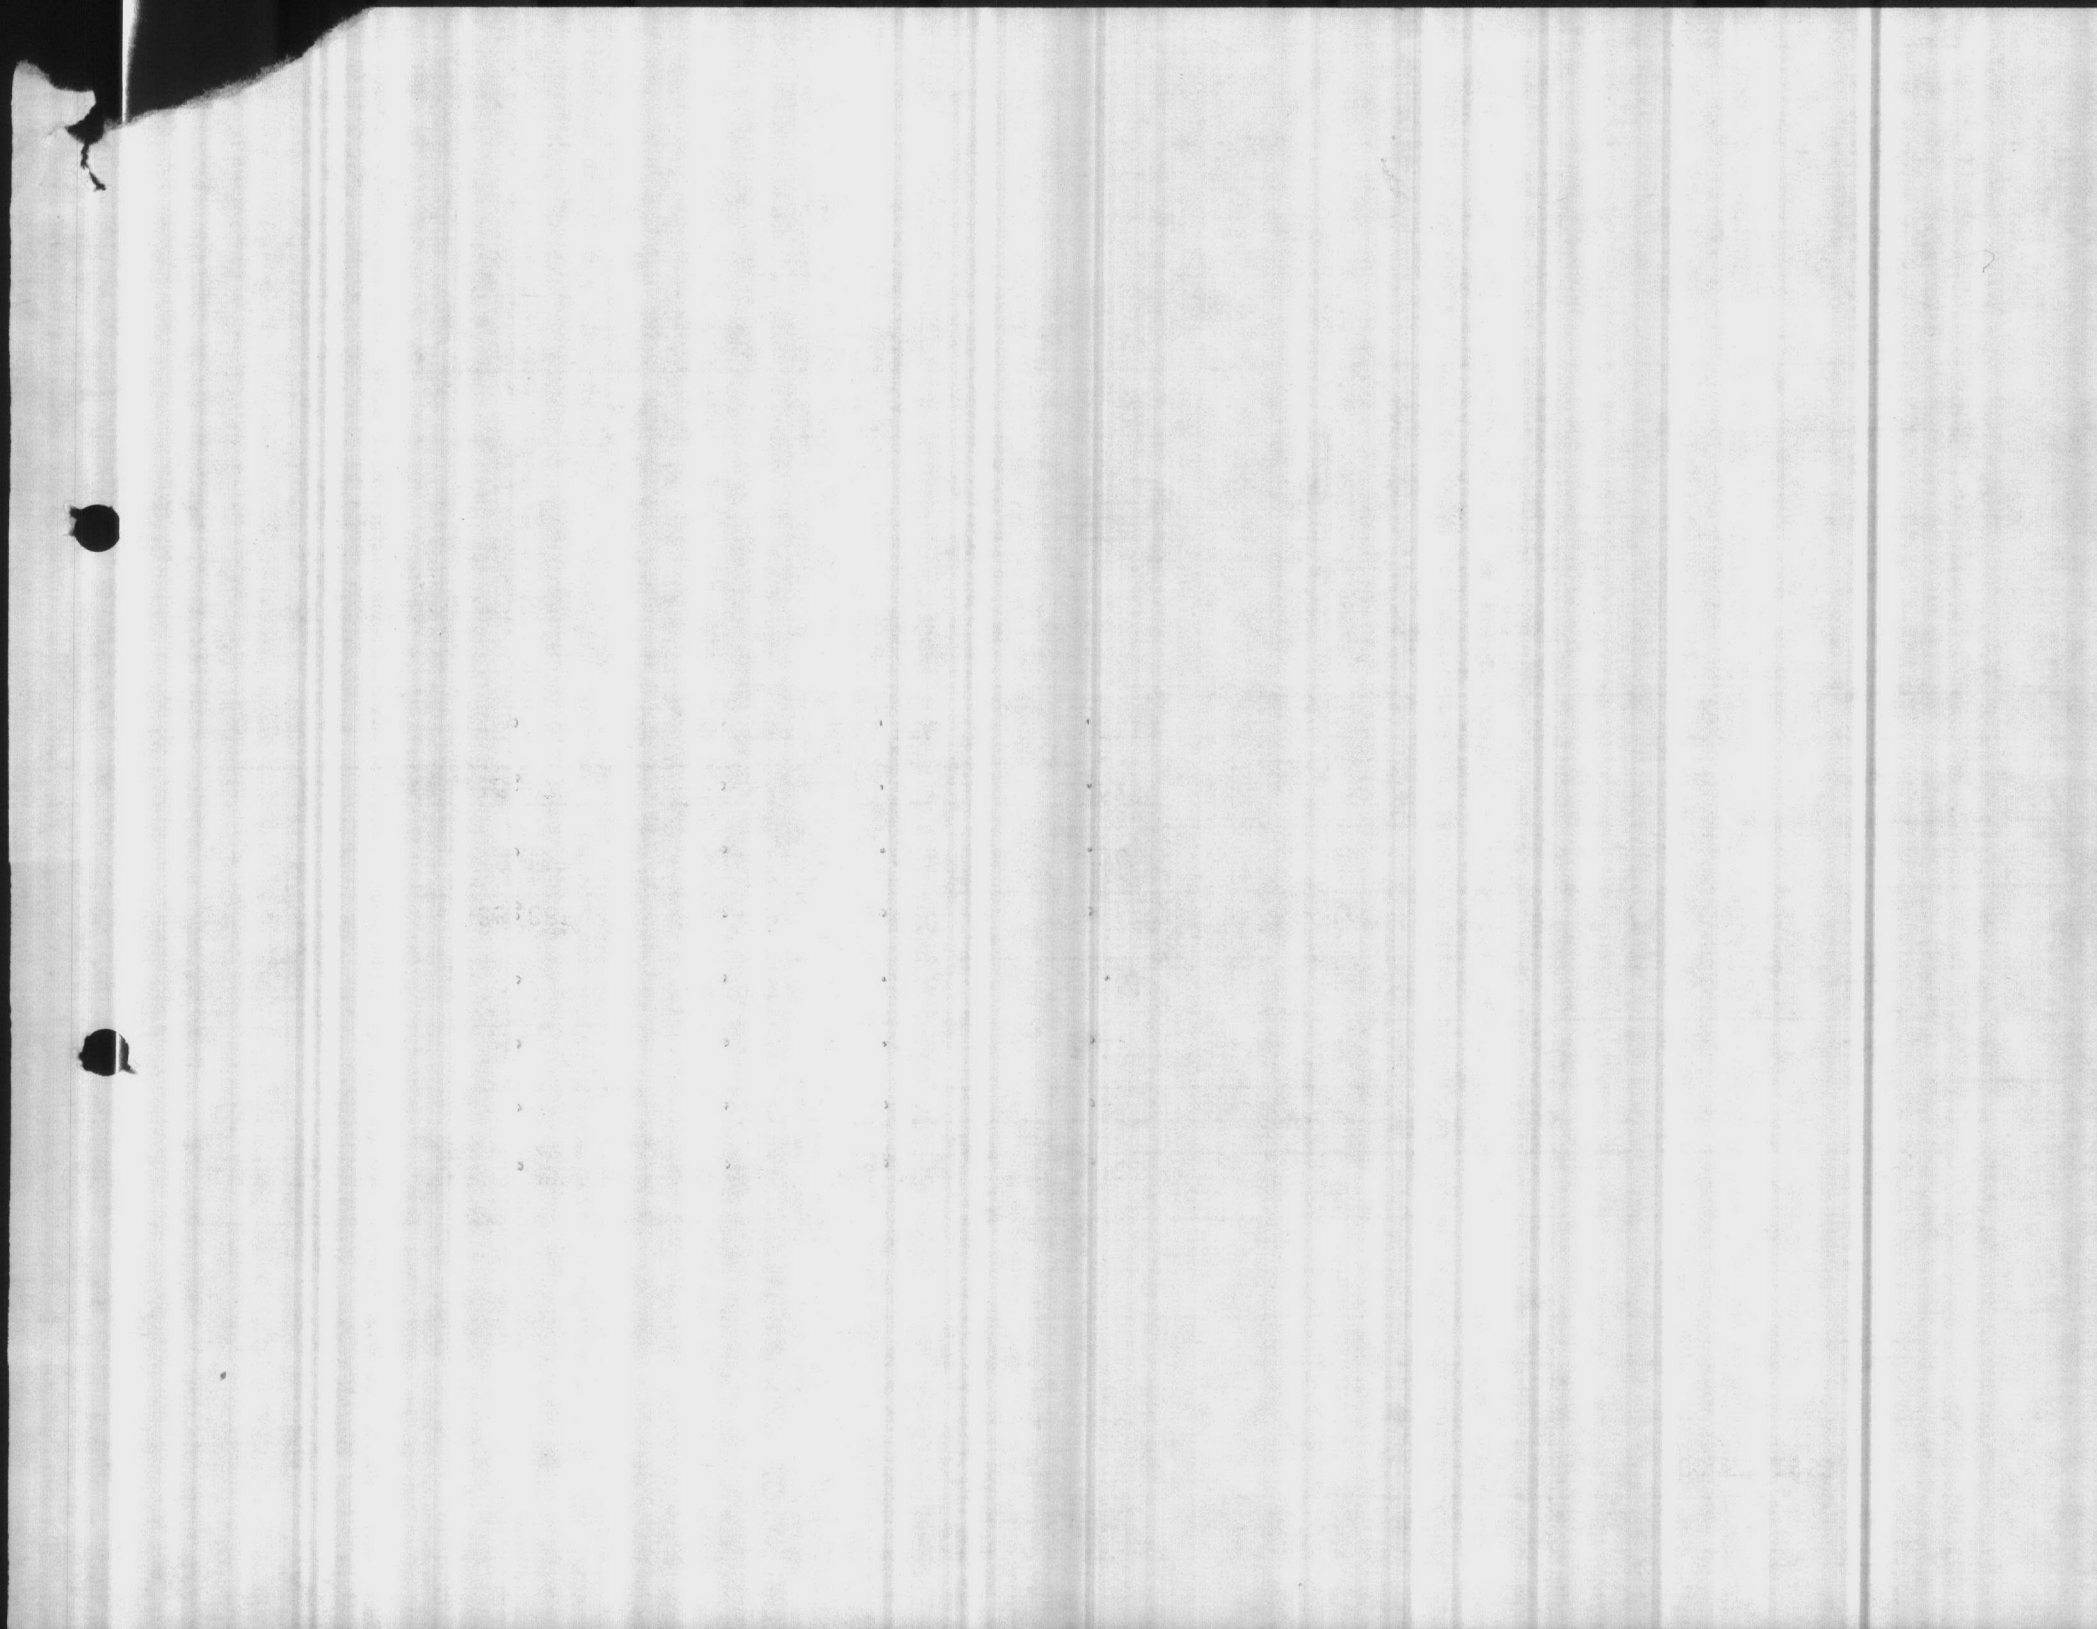


WATER TREATMENT PLANTWATER FLOWDATE: September 1983

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	92,888	88,690	4,190	3,438	13	5,900	5,000	LIME
HOLCOMB BLVD.	34,642	33,184	1,113	1,598	3	2,304	2,000	LIME
TARAWA TERRACE	28,359	27,486	864	1,065	3	1,152	1,000	LIME
MONTFORD POINT	8,600	8,111	474	489	3	622	750	ZEOLITE
MCAS	27,758	24,752	2,784	1,005	3	4,081	3,500	LIME
RIFLE RANGE	7,809	7,127	672	292	3	648	600	ZEOLITE
COURTHOUSE BAY	12,786	11,998	781	491	3	864	600	ZEOLITE
ONSLOW BEACH	2,368	2,161	109	109	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

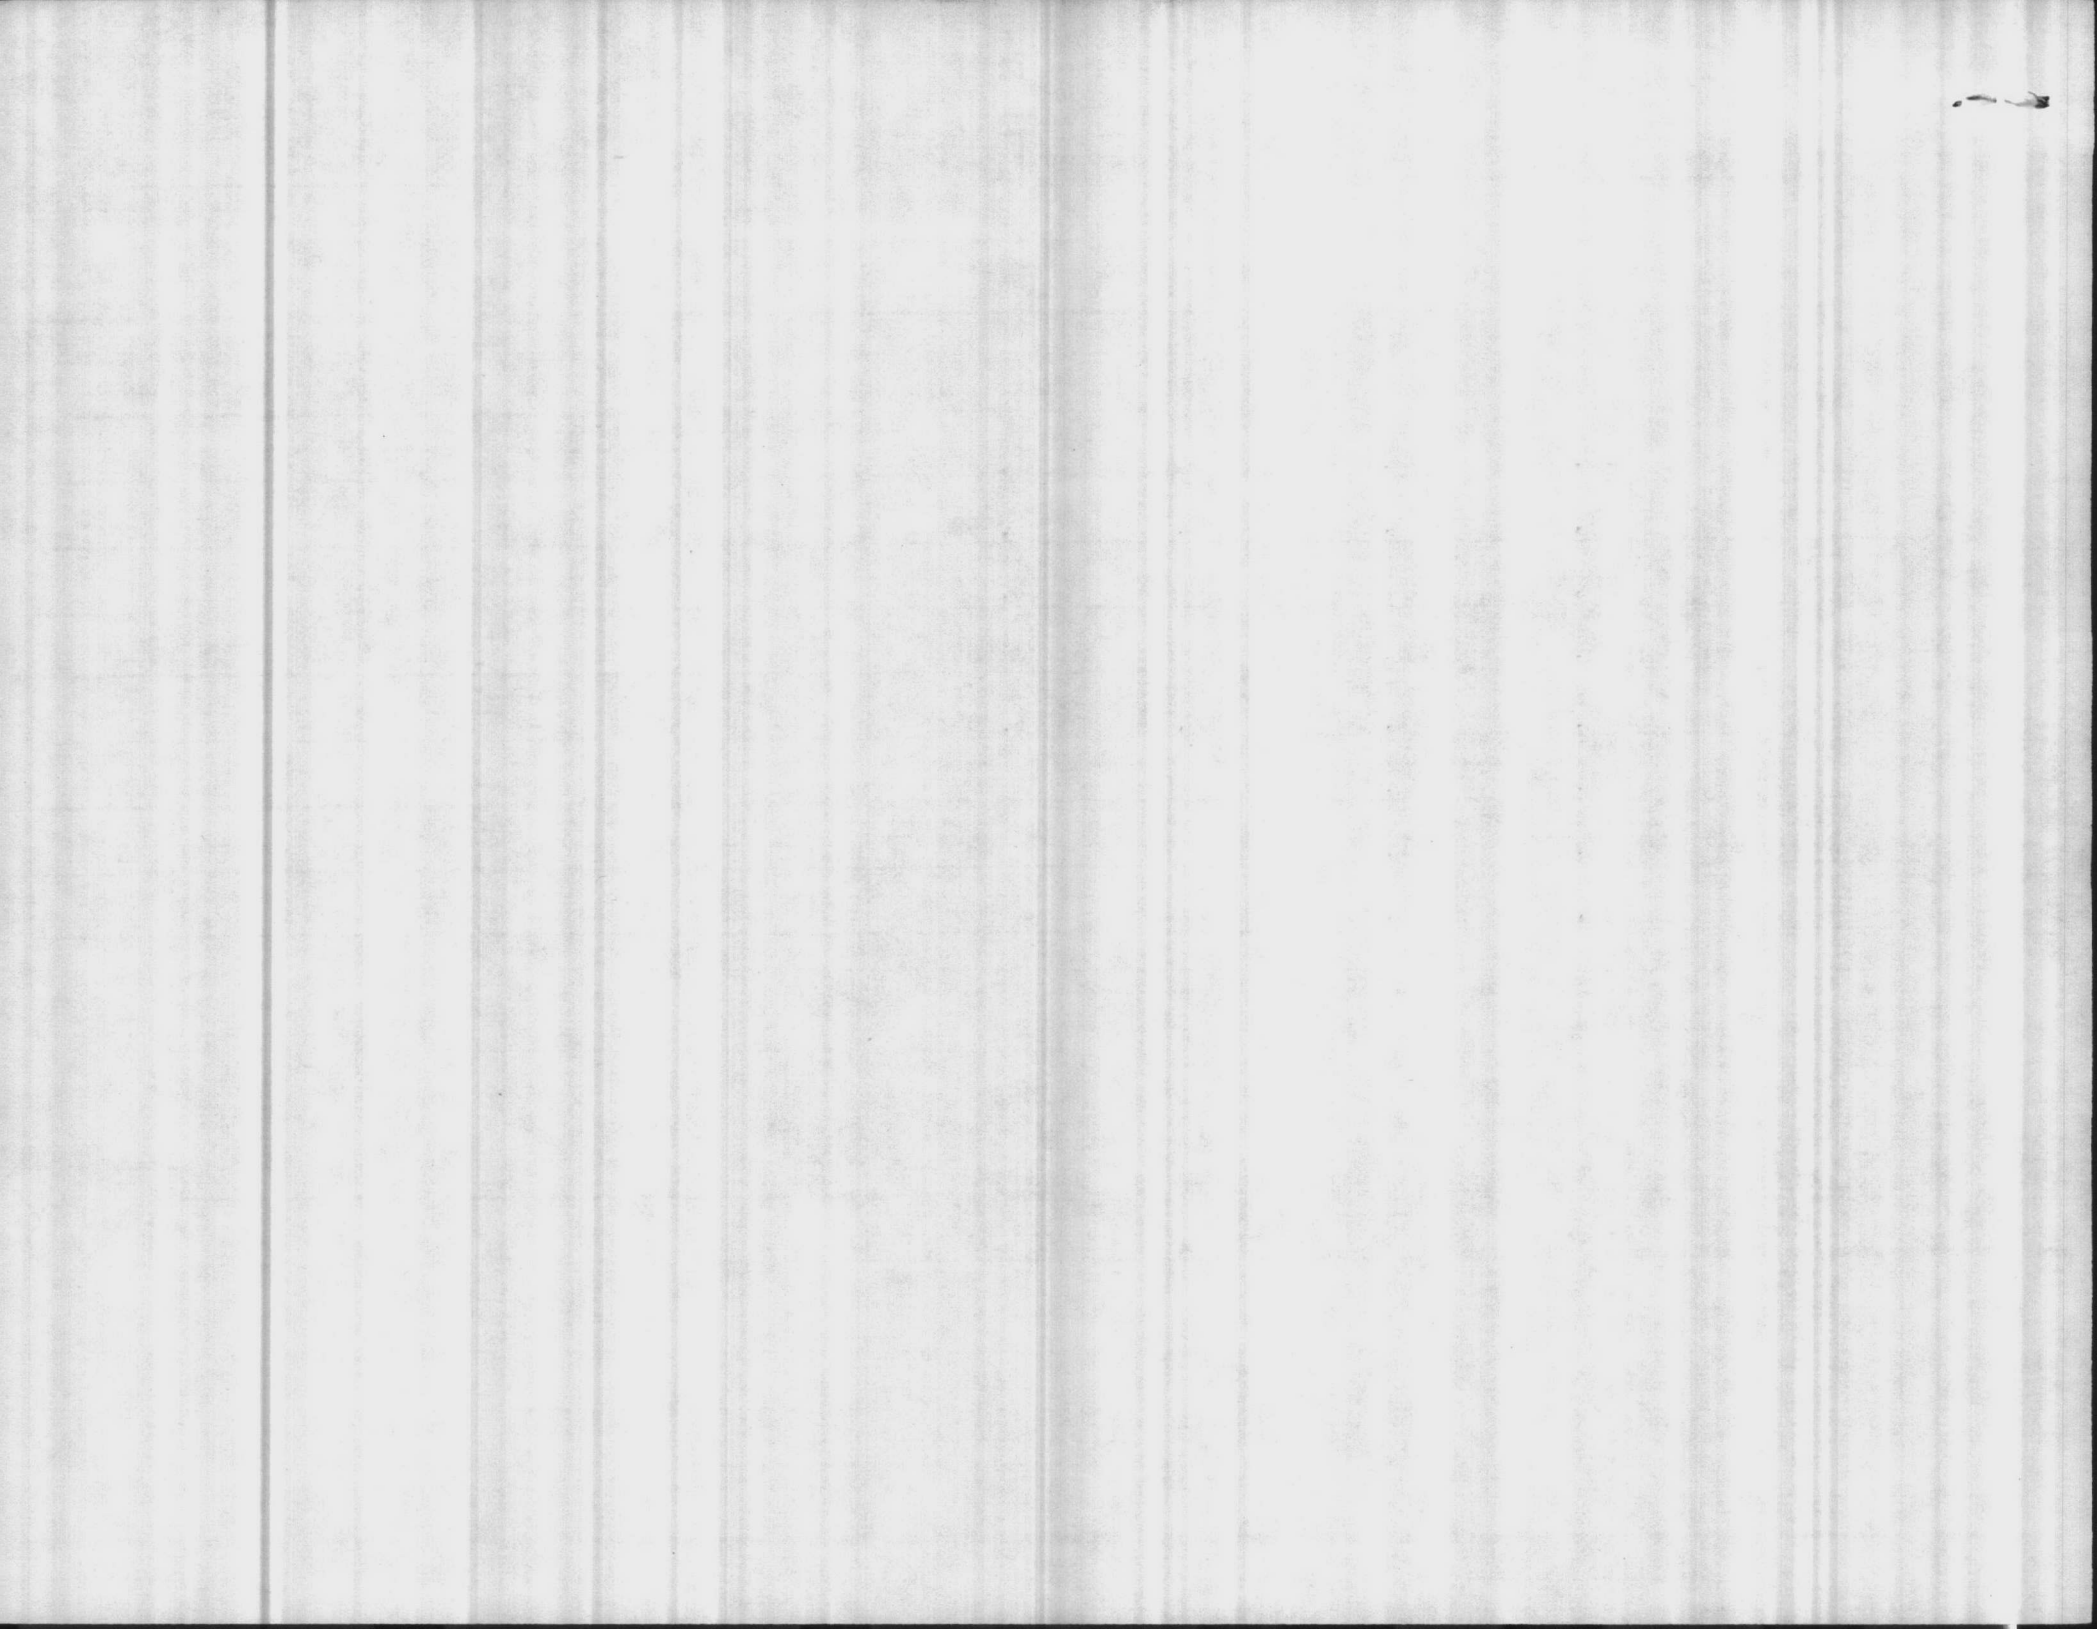


WATER TREATMENT PLANTWATER FLOWDATE: October

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	94,848	91,130	3,711	3,392	13	5,900	5,000	LIME
HOLCOMB BLVD.	32,497	28,366	1,150	1,158	3	2,304	2,000	LIME
TARAWA TERRACE	26,144	25,347	893	934	3	1,152	1,000	LIME
MONTFORD POINT	7,096	6,673	370 est	315	3	622	750	ZEOLITE
MCAS	27,529	22,508	2,928	849	3	4,081	3,500	LIME
RIFLE RANGE	8,036	7,340	691	268	3	648	600	ZEOLITE
COURTHOUSE BAY	14,482	11,371	778	495	3	864	600	ZEOLITE
ONSLOW BEACH	3,366	3,249	114	113	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

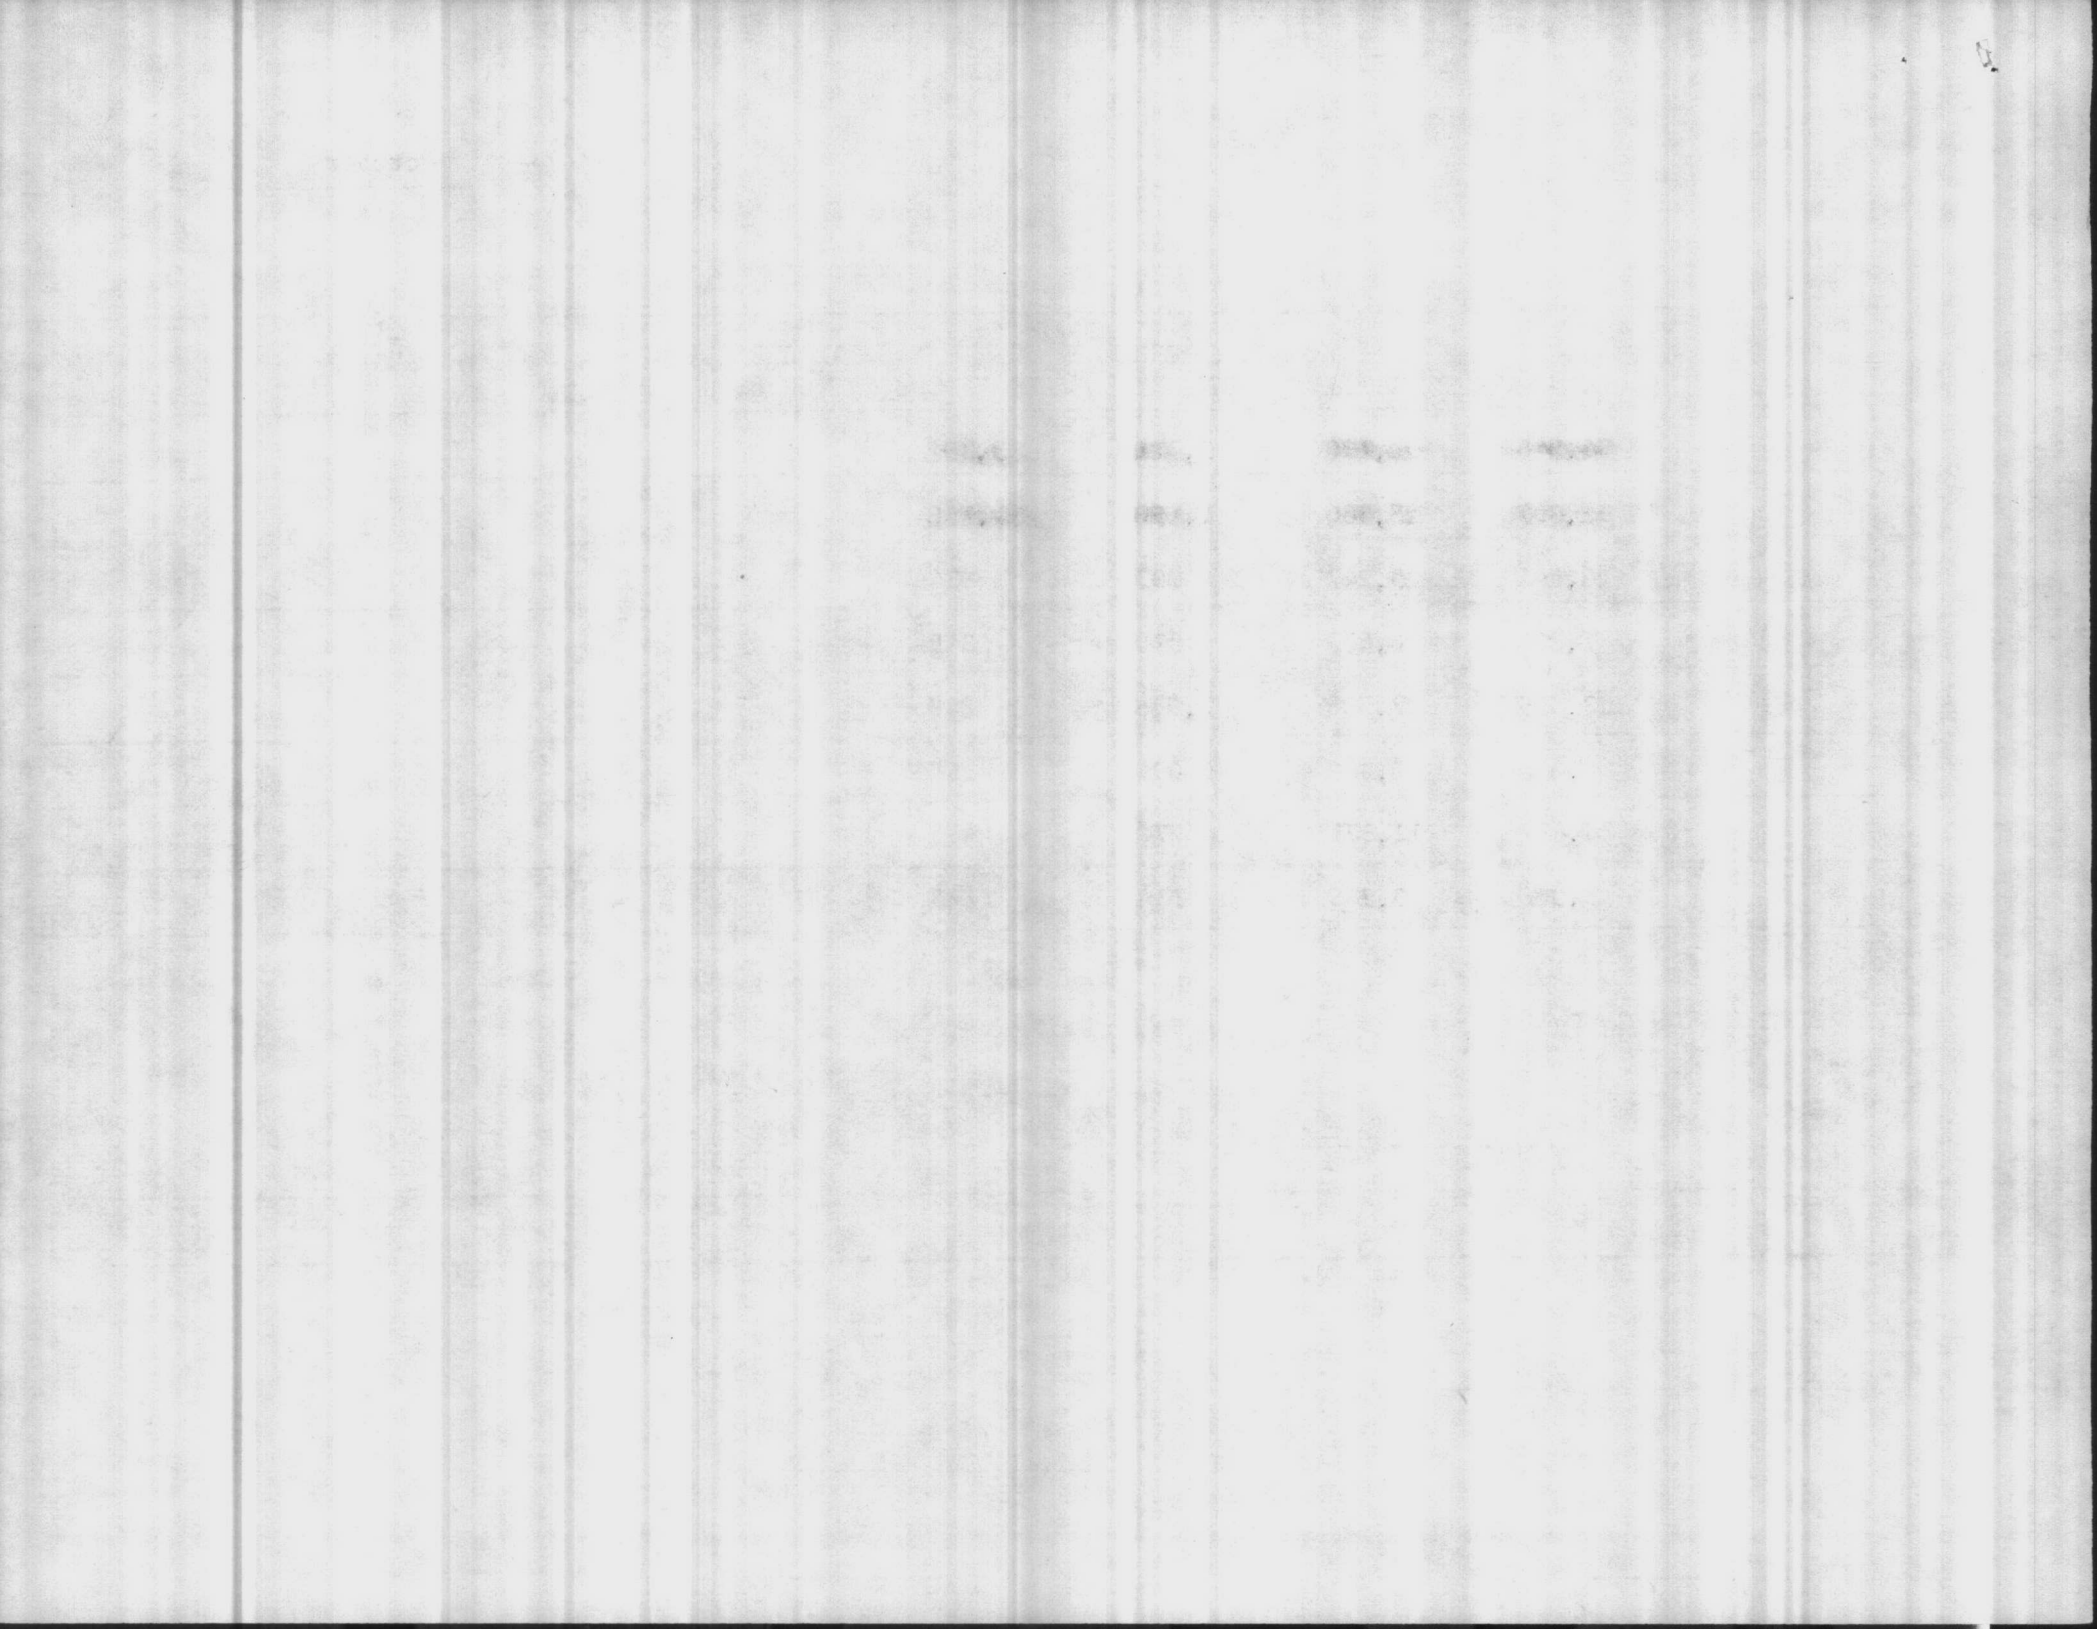

WATER TREATMENT PLANT


WATER FLOW

DATE: NOVEMBER 1983

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	93,746	88,524	4,788	3,459	13	5,900	5,000	LIME
HOLCOMB BLVD.	31,313	^{29,896} 28,896	1,113	965	3	2,304	2,000	LIME
TARAWA TERRACE	26,887	25,985	864	975	3	1,152	1,000	LIME
MONTFORD POINT	7,201	6,703	495	273	3	622	750	ZEOLITE
MCAS	28,350	25,522	2,784	1,280	3	4,081	3,500	LIME
RIFLE RANGE	7,452	6,797	650	296	3	648	600	ZEOLITE
COURTHOUSE BAY	14,310	13,520	751	484	3	864	600	ZEOLITE
ONSLOW BEACH	3,120	2,634	134	189	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

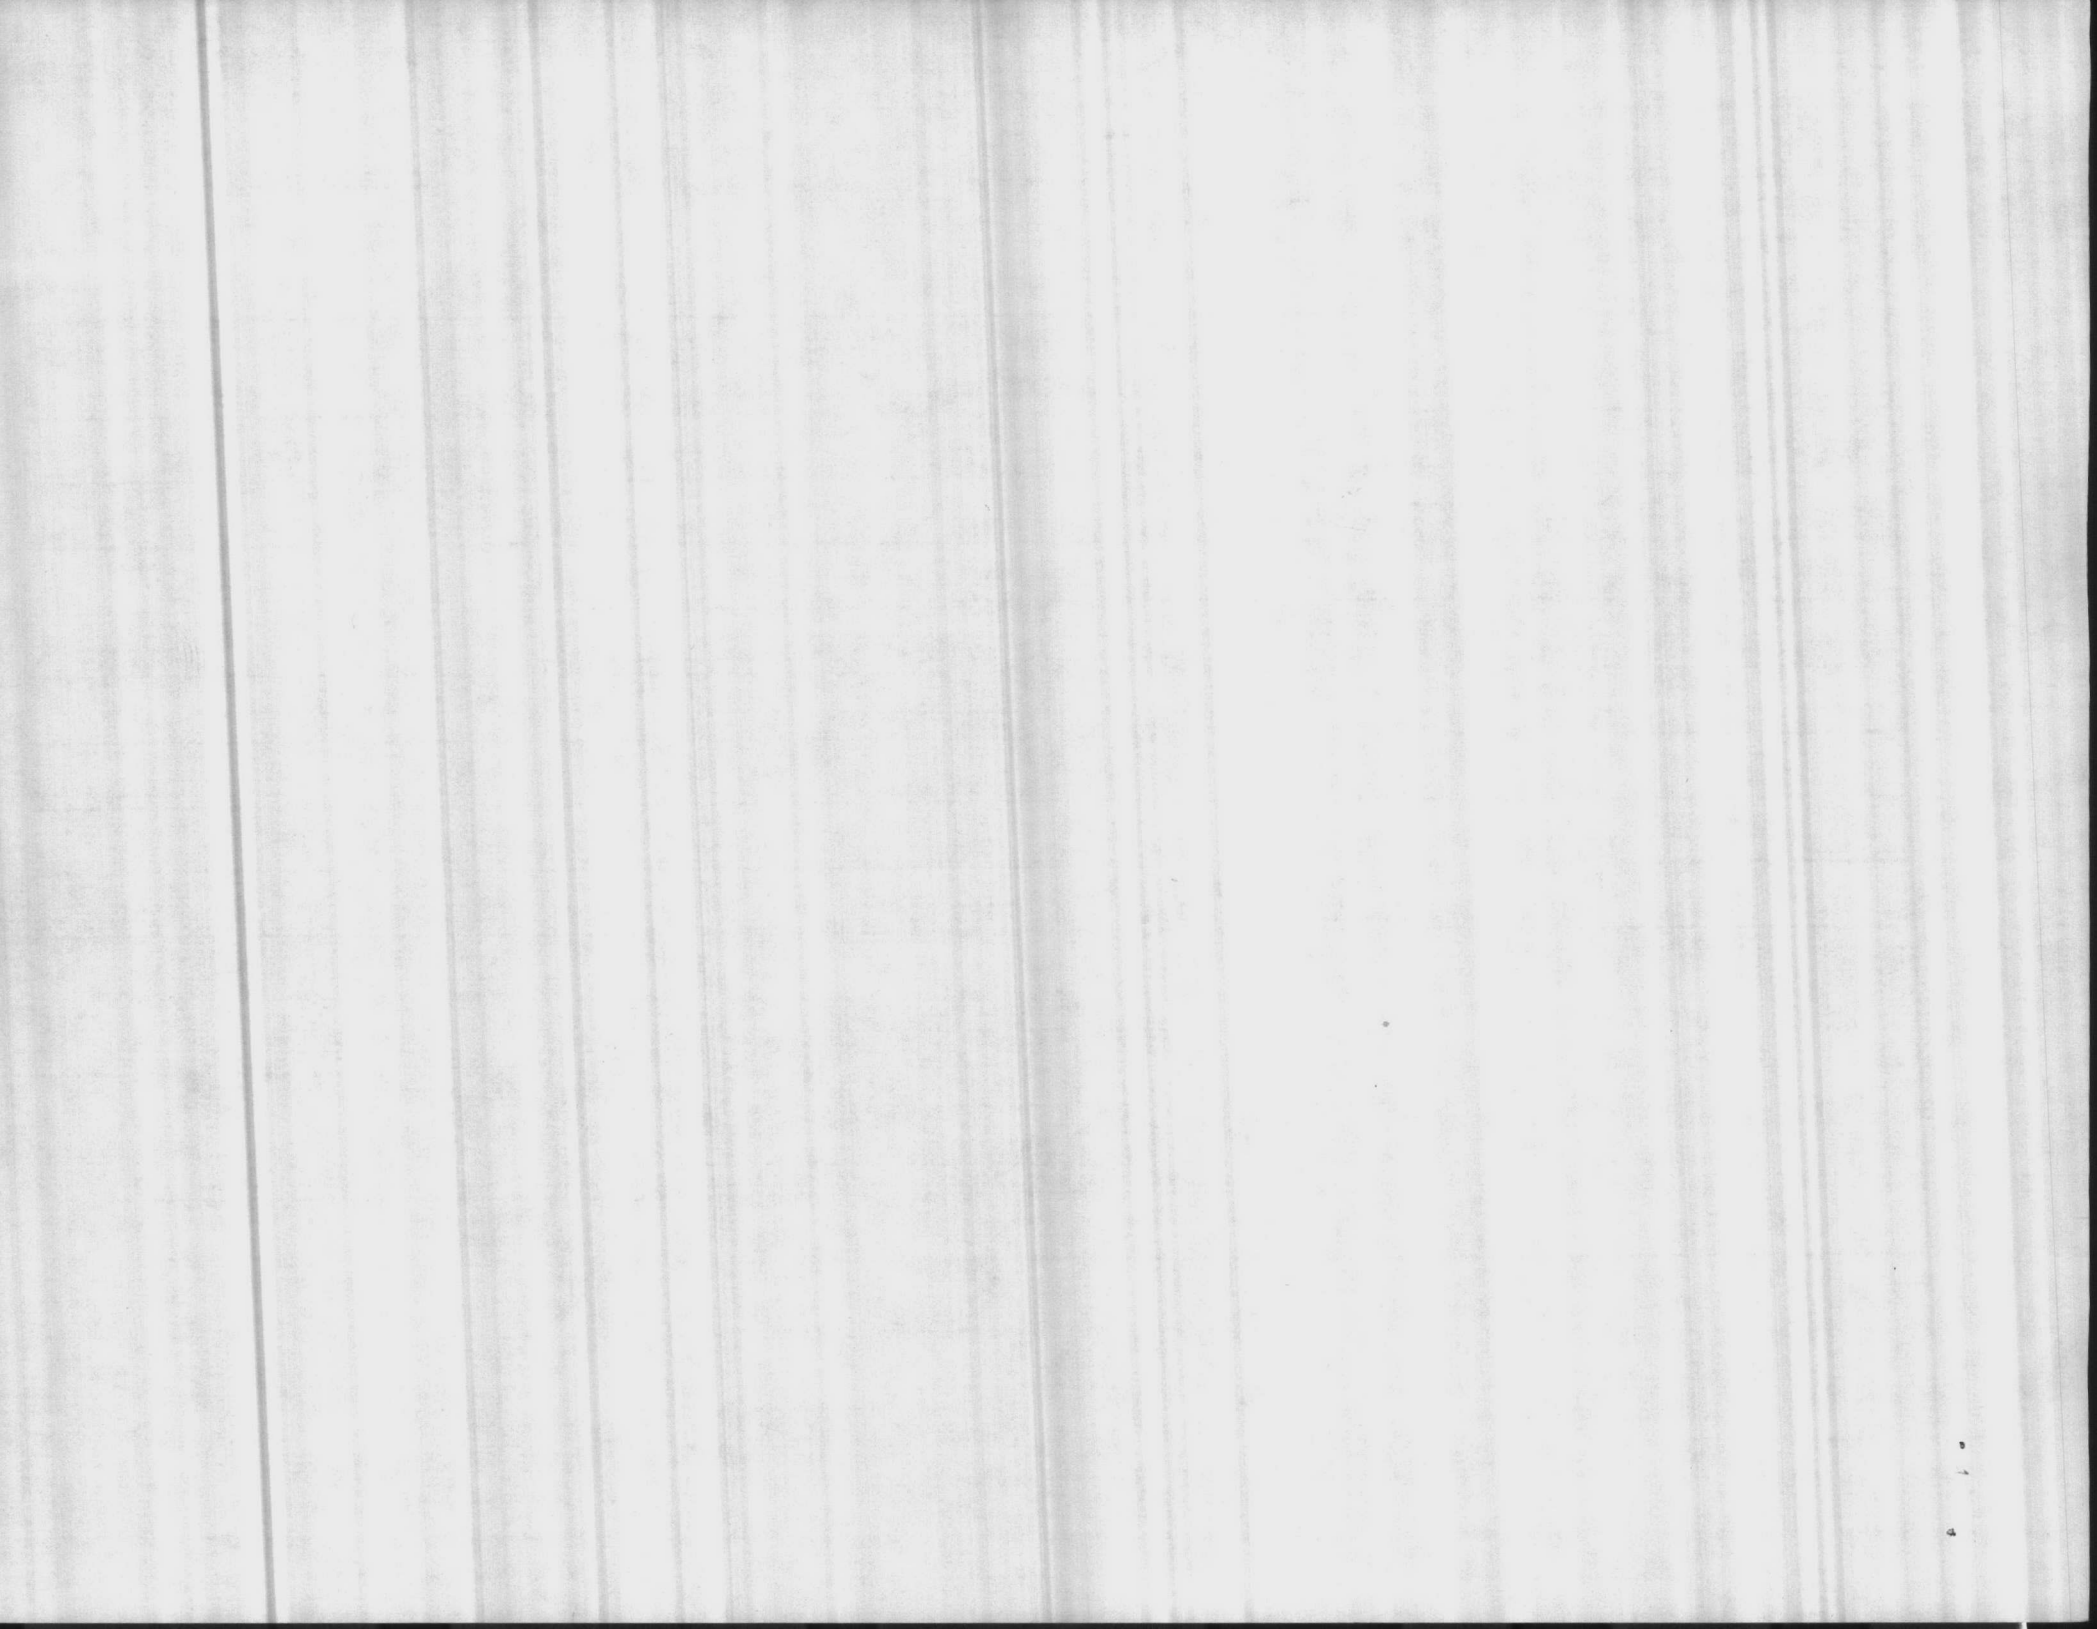

Copy

WATER TREATMENT PLANT


WATER FLOW

DATE: December 1983

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	110,866	105,911	4,948	4,260	13	5,900	5,000	LIME
HOLCOMB BLVD.	31,394	26,154	1,150	1,124	3	2,304	2,000	LIME
TARAWA TERRACE	34,171	33,273	893	1,011	3	1,152	1,000	LIME
MONTFORD POINT	10,712	10,022	636	550	3	622	750	ZEOLITE
MCAS	28,527	23,456	3,024	1,202	3	4,081	3,500	LIME
RIFLE RANGE	8,399	7,727	666 est	341	3	648	600	ZEOLITE
COURTHOUSE BAY	14,575	13,750	812	657	3	864	600	ZEOLITE
ONSLOW BEACH	3,161	2,876	140	202	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

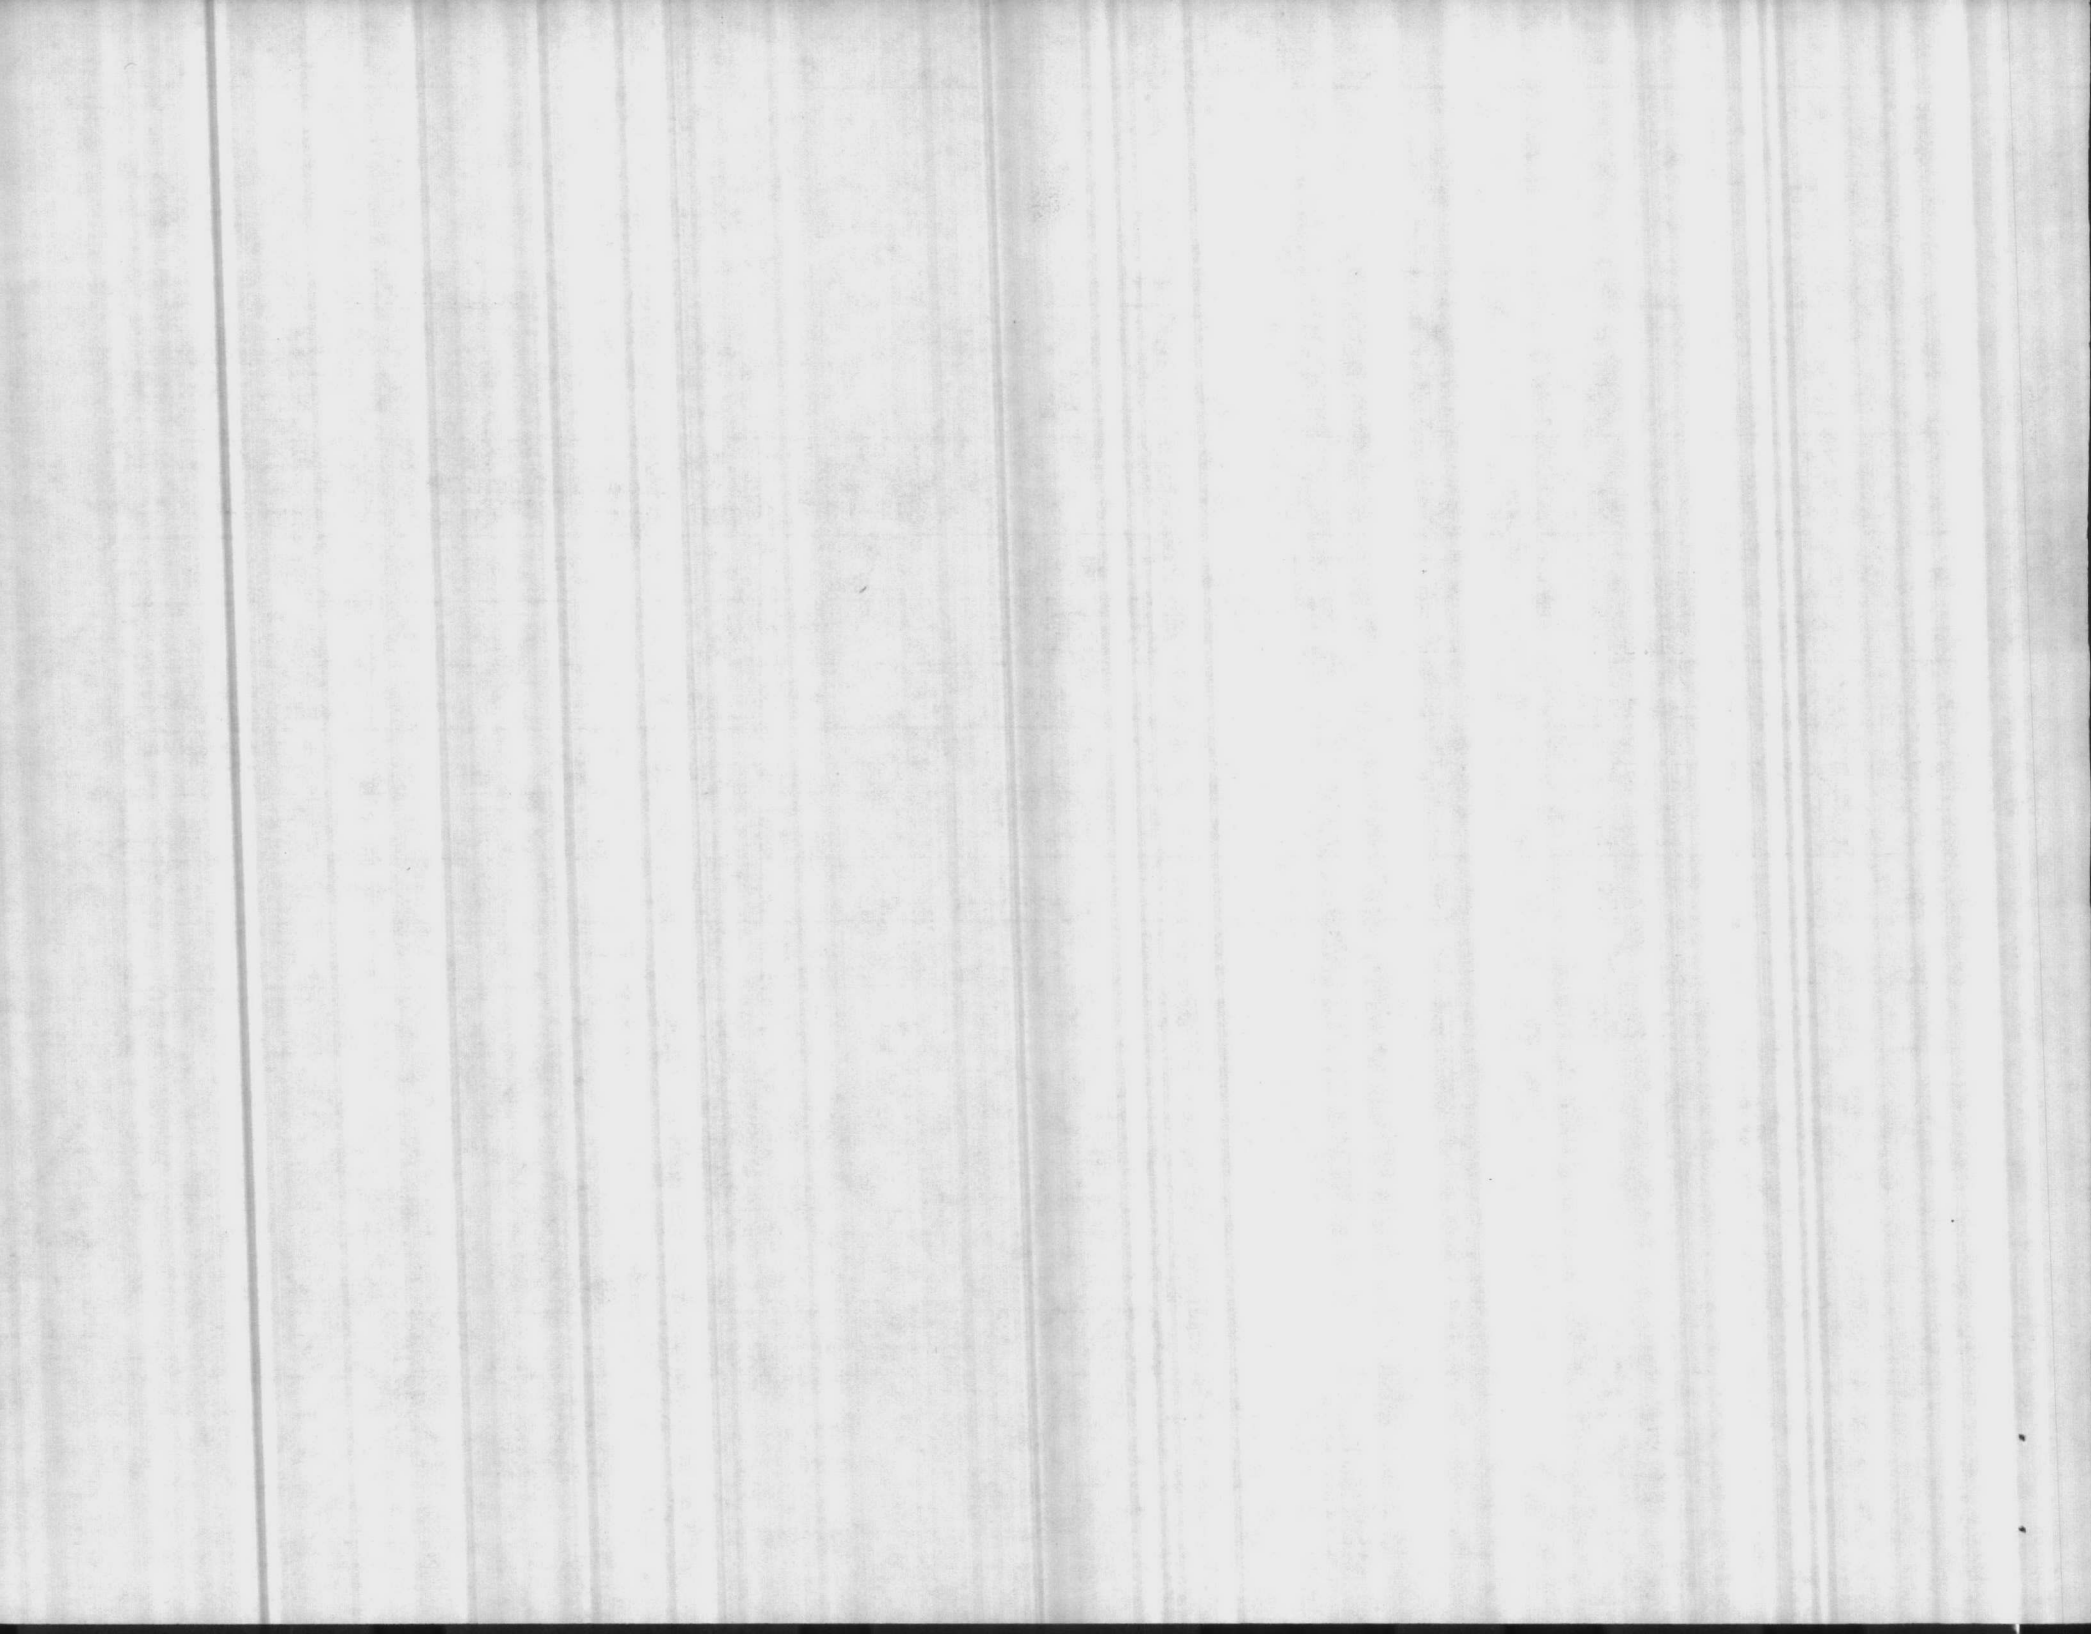


WATER TREATMENT PLANTWATER FLOWDATE: JANUARY 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
MADNOT POINT	113,655	108,549	4,589	4,046	13	5,900	5,000	LIME
HOLCOMB BLVD.	29,622	28,297	1,224	1,259	3	2,304	2,000	LIME
TARAWA TERRACE	23,991	23,088	.893	.869	3	1,152	1,000	LIME
MONTFORD POINT	11,865	10,571	.660	.449	3	622	750	ZEOLITE
MCAS	32,704	26,490	3,552	1,095	3	4,081	3,500	LIME
RIFLE RANGE	9,544	8,840	.698 Est.	.321	3	648	600	ZEOLITE
COURT HOUSE BAY	16,745	15,896	.842	.560	3	864	600	ZEOLITE
ON SLOW BEACH	3,229	3,095	.128	.138	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

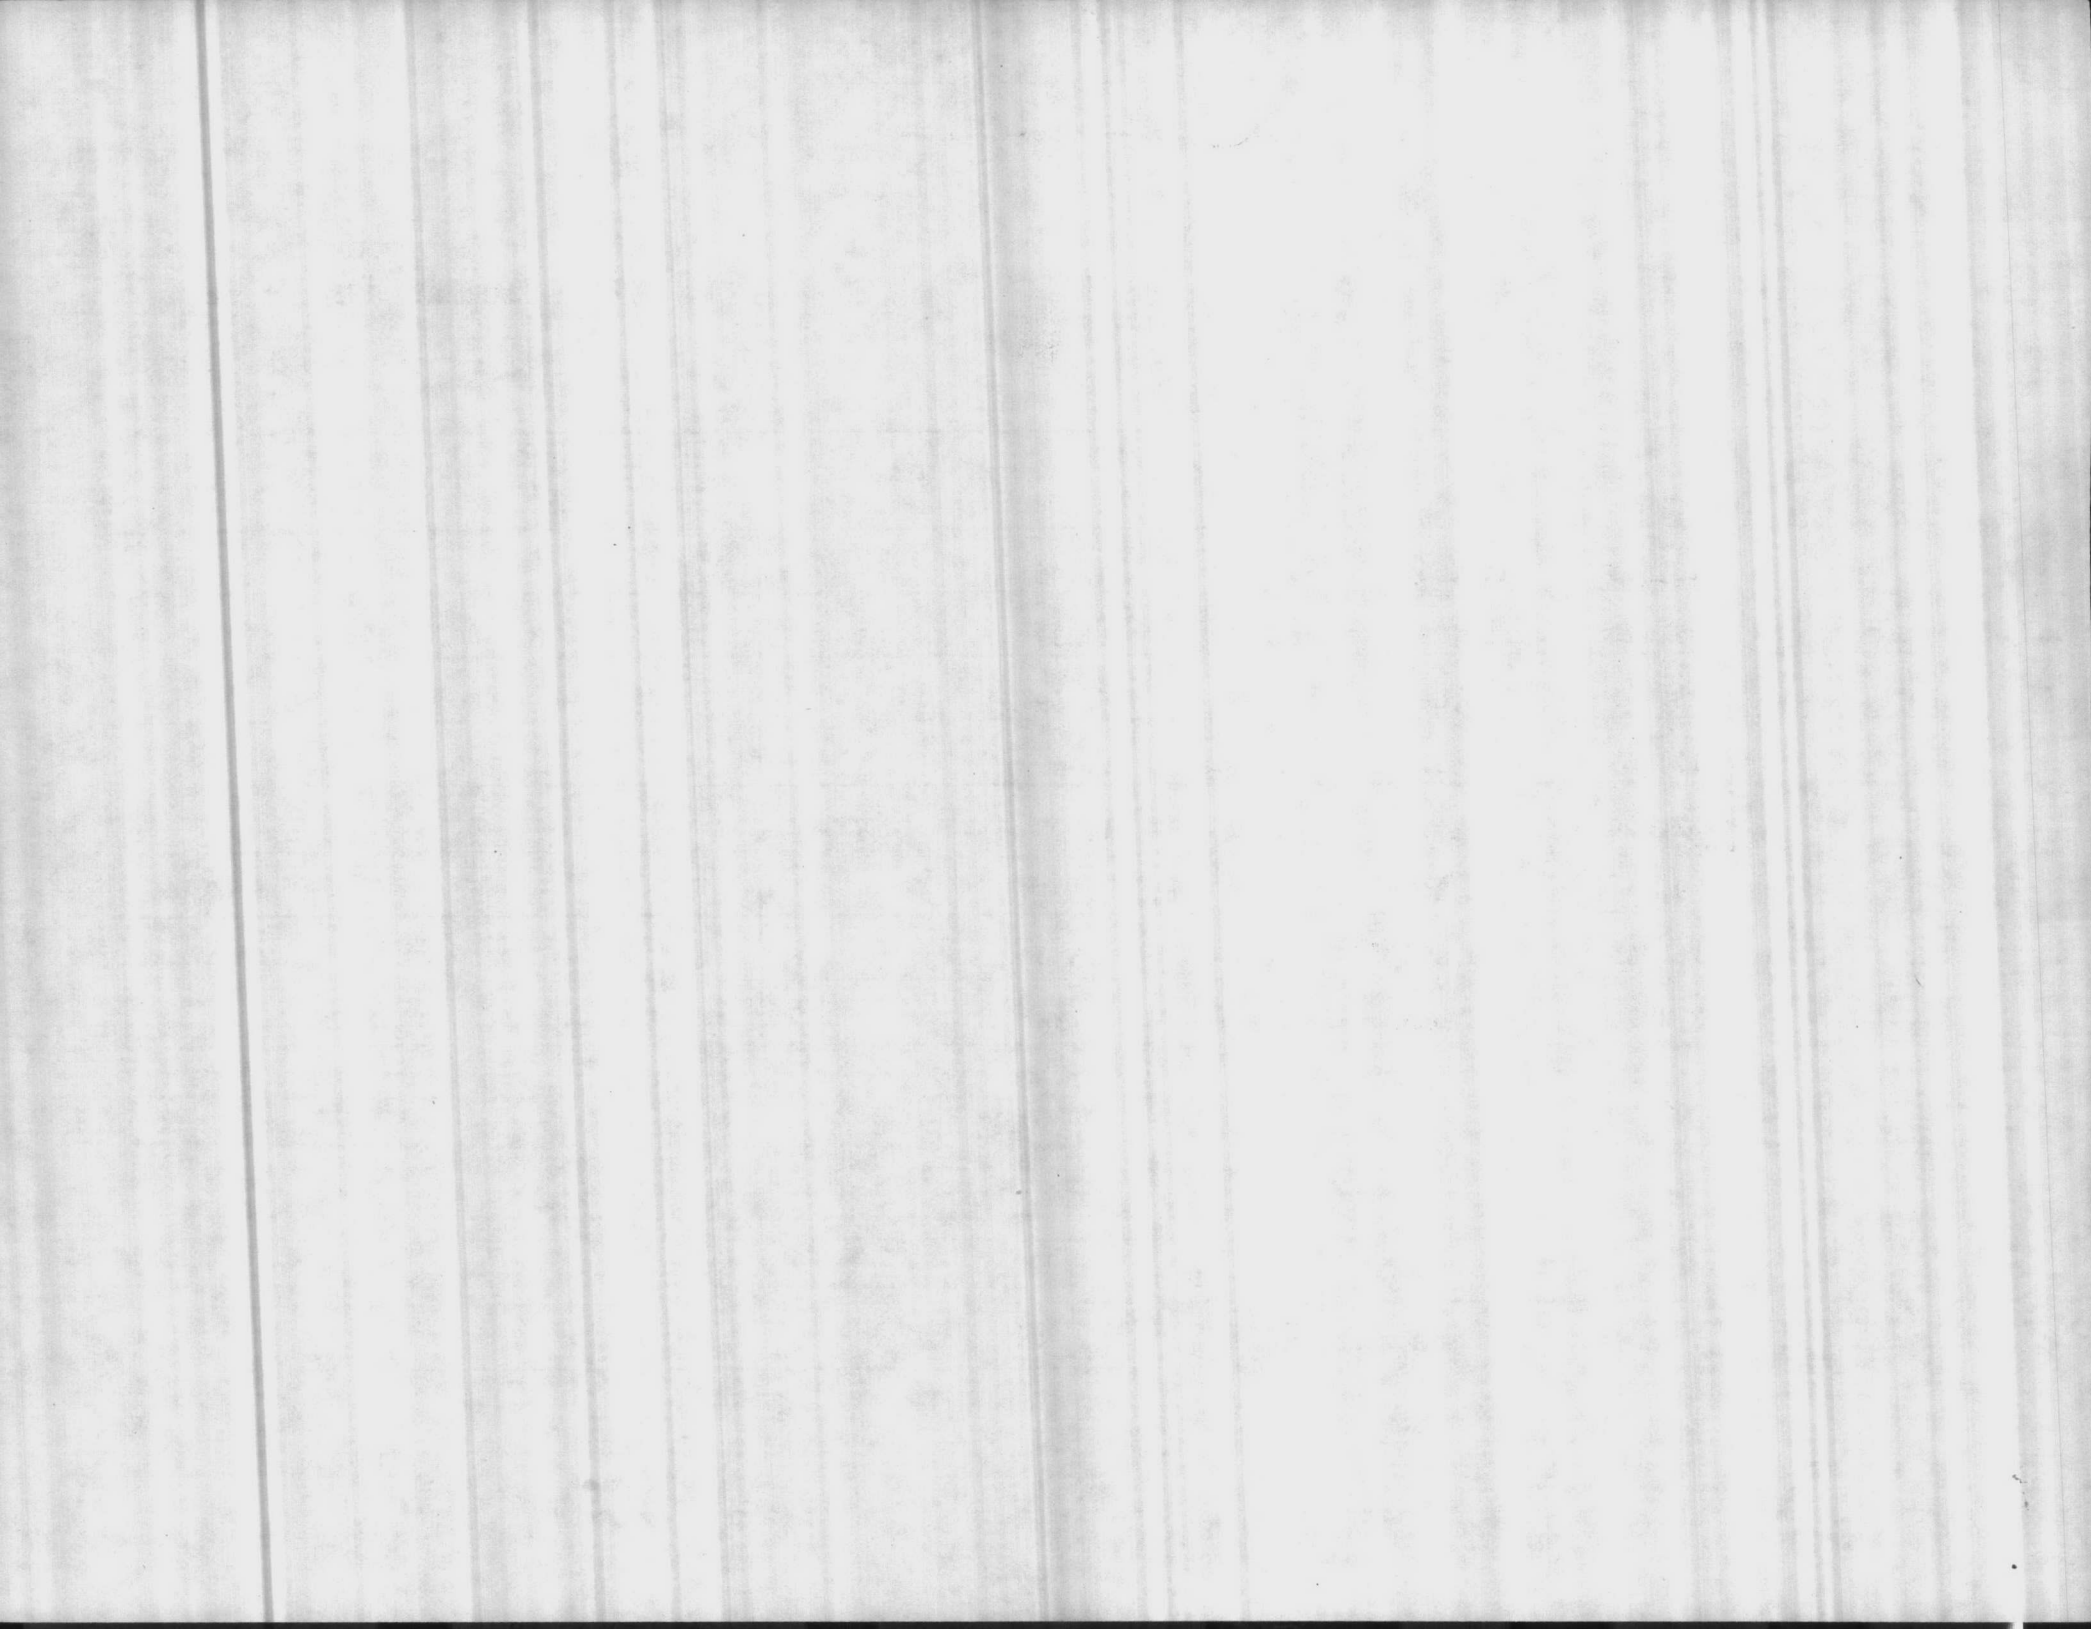


WATER TREATMENT PLANTWATER FLOWDATE: February 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
WADSWORTH POINT	104,409	99,721	4,628	3,972	13	5,900	5,000	LIME
HOLCOMB BLVD.	32,971	31,891	1,076	1,200	3	2,304	2,000	LIME
TARAWA TERRACE	24,443	23,605	835	888	3	1,152	1,000	LIME
MONTFORD POINT	9,380	8,891	465	421	3	622	750	ZEOLITE
MCAS	25,180	22,479	2,496	1,015	3	4,081	3,500	LIME
RIFLE RANGE	10,371	9,670	699	271	3	648	600	ZEOLITE
COURTHOUSE BAY	16,299	15,524	756	655	3	864	600	ZEOLITE
ONSLow BEACH	2,690	2,637	114	133	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

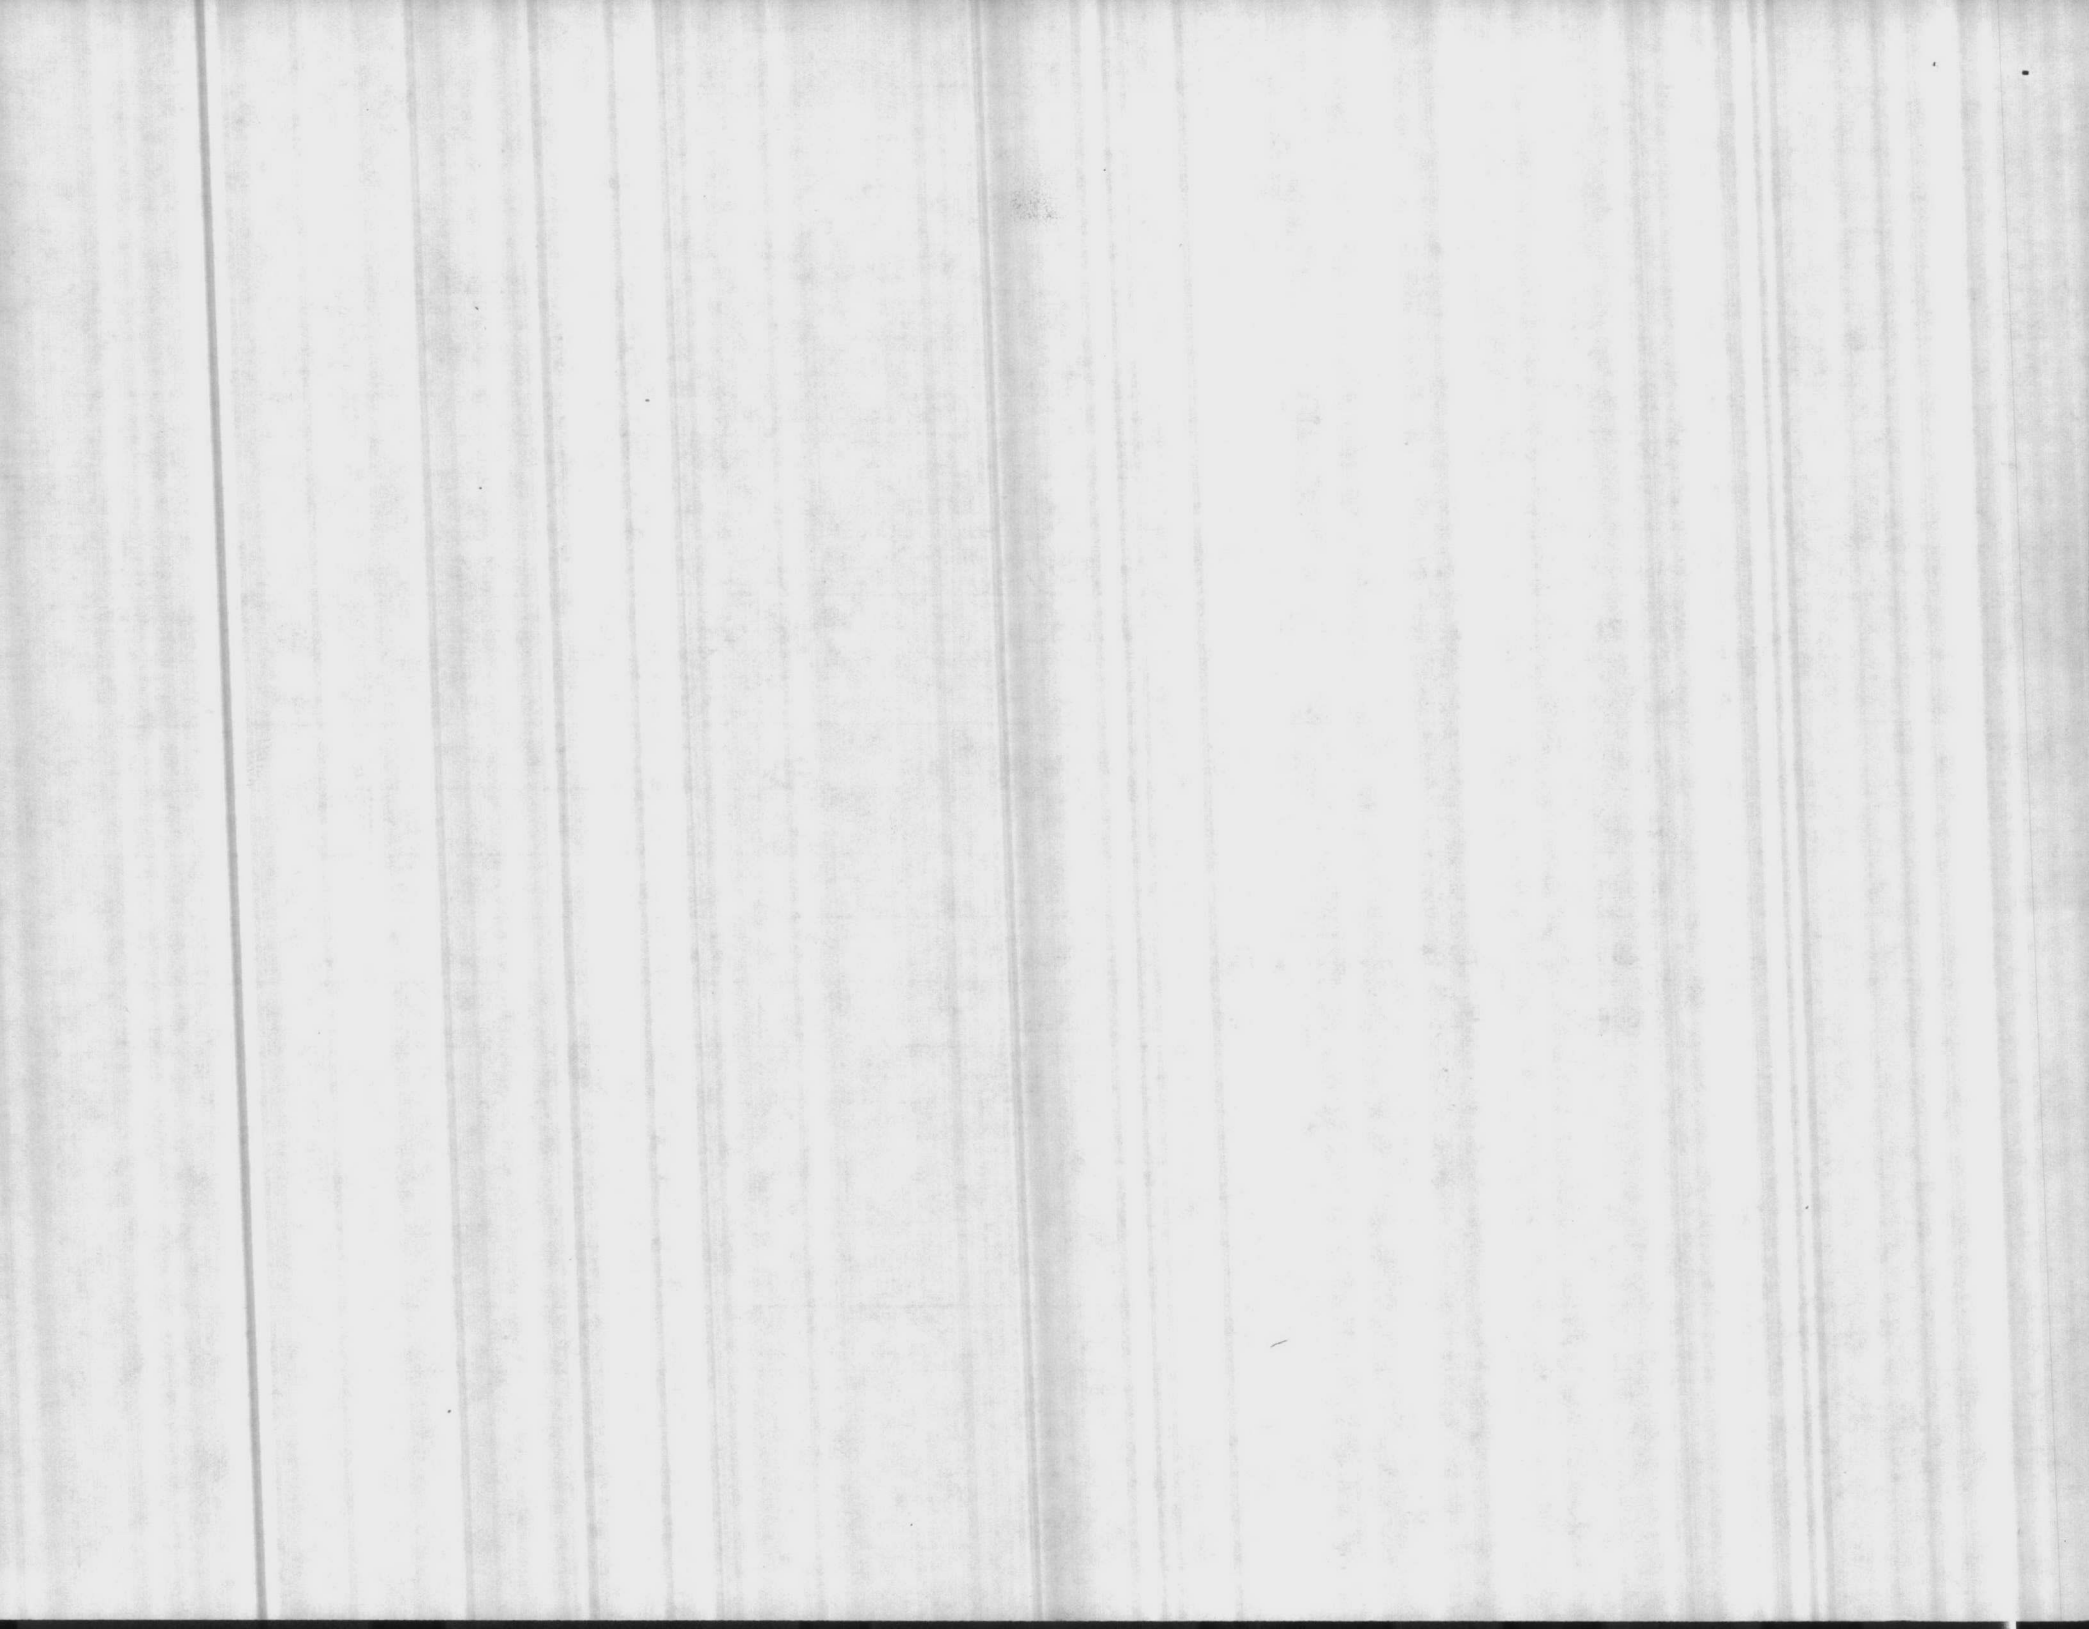


WATER TREATMENT PLANTWATER FLOWDATE: MARCH 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
MADNOT POINT	104,165	100,251	3,910	3,581	13	5,900	5,000	LIME
HOLCOMB BLVD.	37,627	36,473	1,150	1,412	3	2,304	2,000	LIME
TARAWA TERRACE	25,108	24,211	893	906	3	1,152	1,000	LIME
MONTFORD POINT	11,340	10,830	508	374	3	622	750	ZEOLITE
MCAS	26,806	24,162	2,640	945	3	4,081	3,500	LIME
RIFLE RANGE	5,899	5,462	430 EST.	243	3	648	600	ZEOLITE
COURTHOUSE BAY	12,495	11,689	796	627	3	864	600	ZEOLITE
ONSLOW BEACH	2,639	2,404	119	107	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

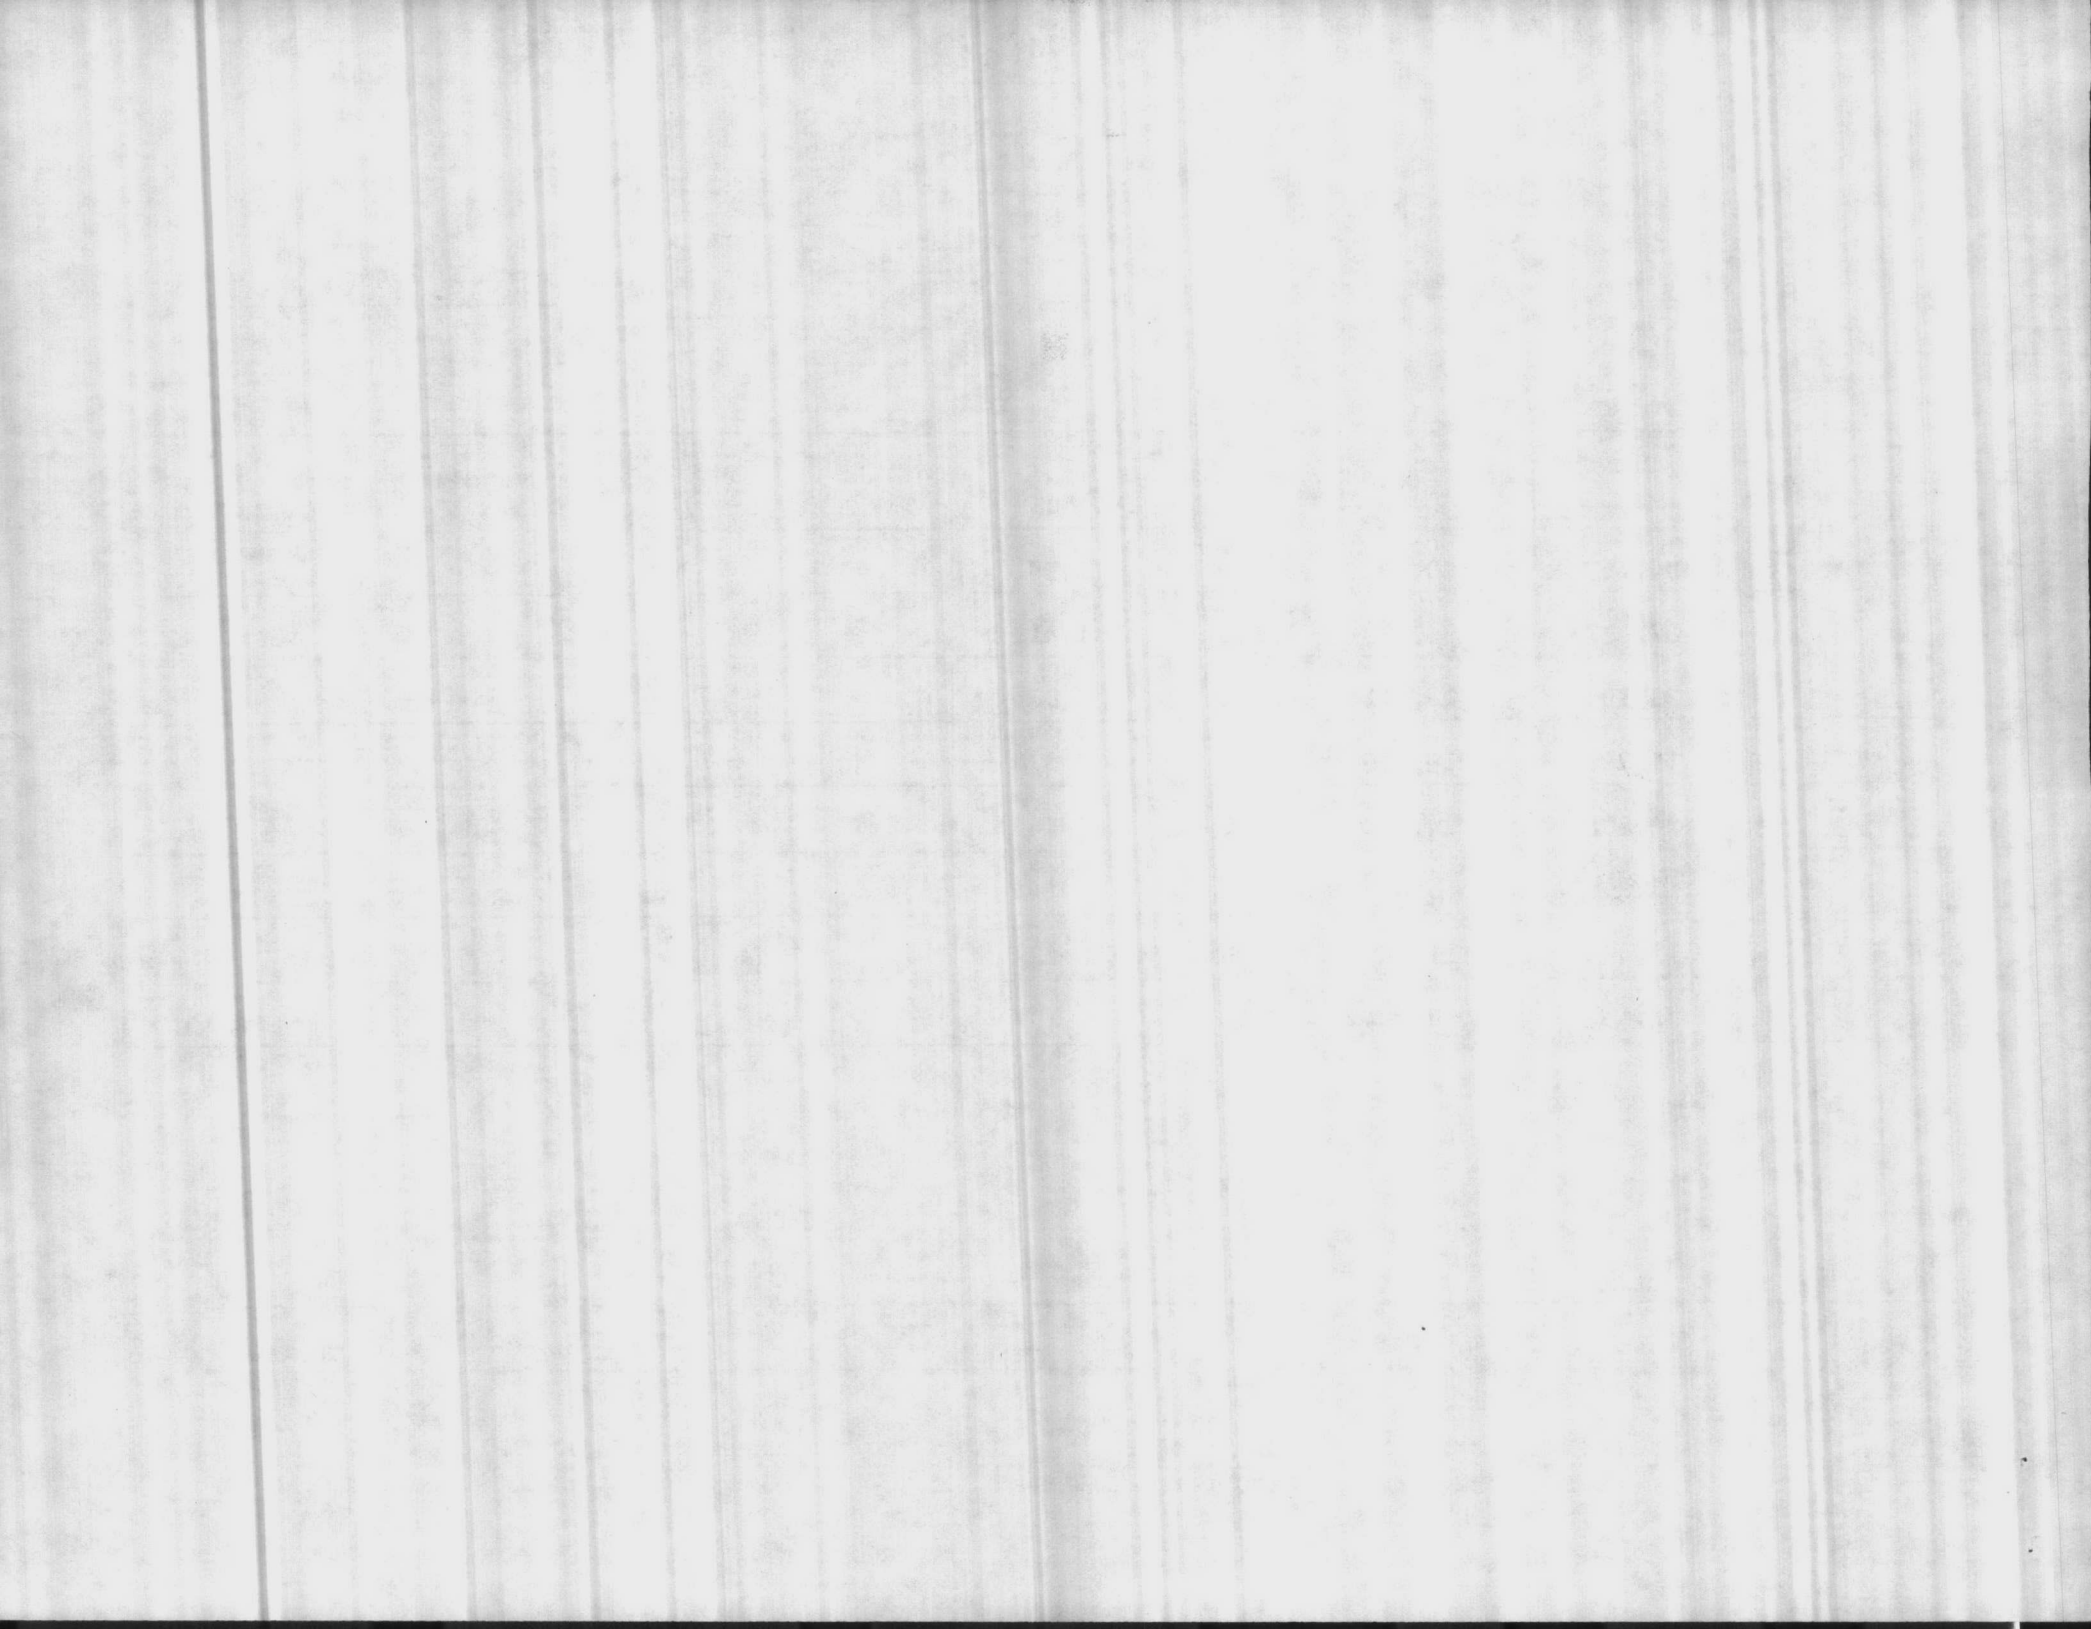


WATER TREATMENT PLANTWATER FLOWDATE: APRIL 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
MADNOT POINT	104,070	100,476	3,591	3,764	13	5,900	5,000	LIME
HOLCOMB BLVD.	33,057	31,654	1,113	1,298	3	2,304	2,000	LIME
TARAWA TERRACE	25,120	24,395	720	986	3	1,152	1,000	LIME
MONTFORD POINT	8,915	8,767	462	391	3	622	750	ZEOLITE
MCAS	23,407	20,909	2,544	811	3	4,081	3,500	LIME
RIFLE RANGE	6,669	6,146	520 est.	310	3	648	600	ZEOLITE
COURTHOUSE BAY	15,811	15,034	774	588	3	864	600	ZEOLITE
ONNSLOW BEACH	2,769	2,189	116	102	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

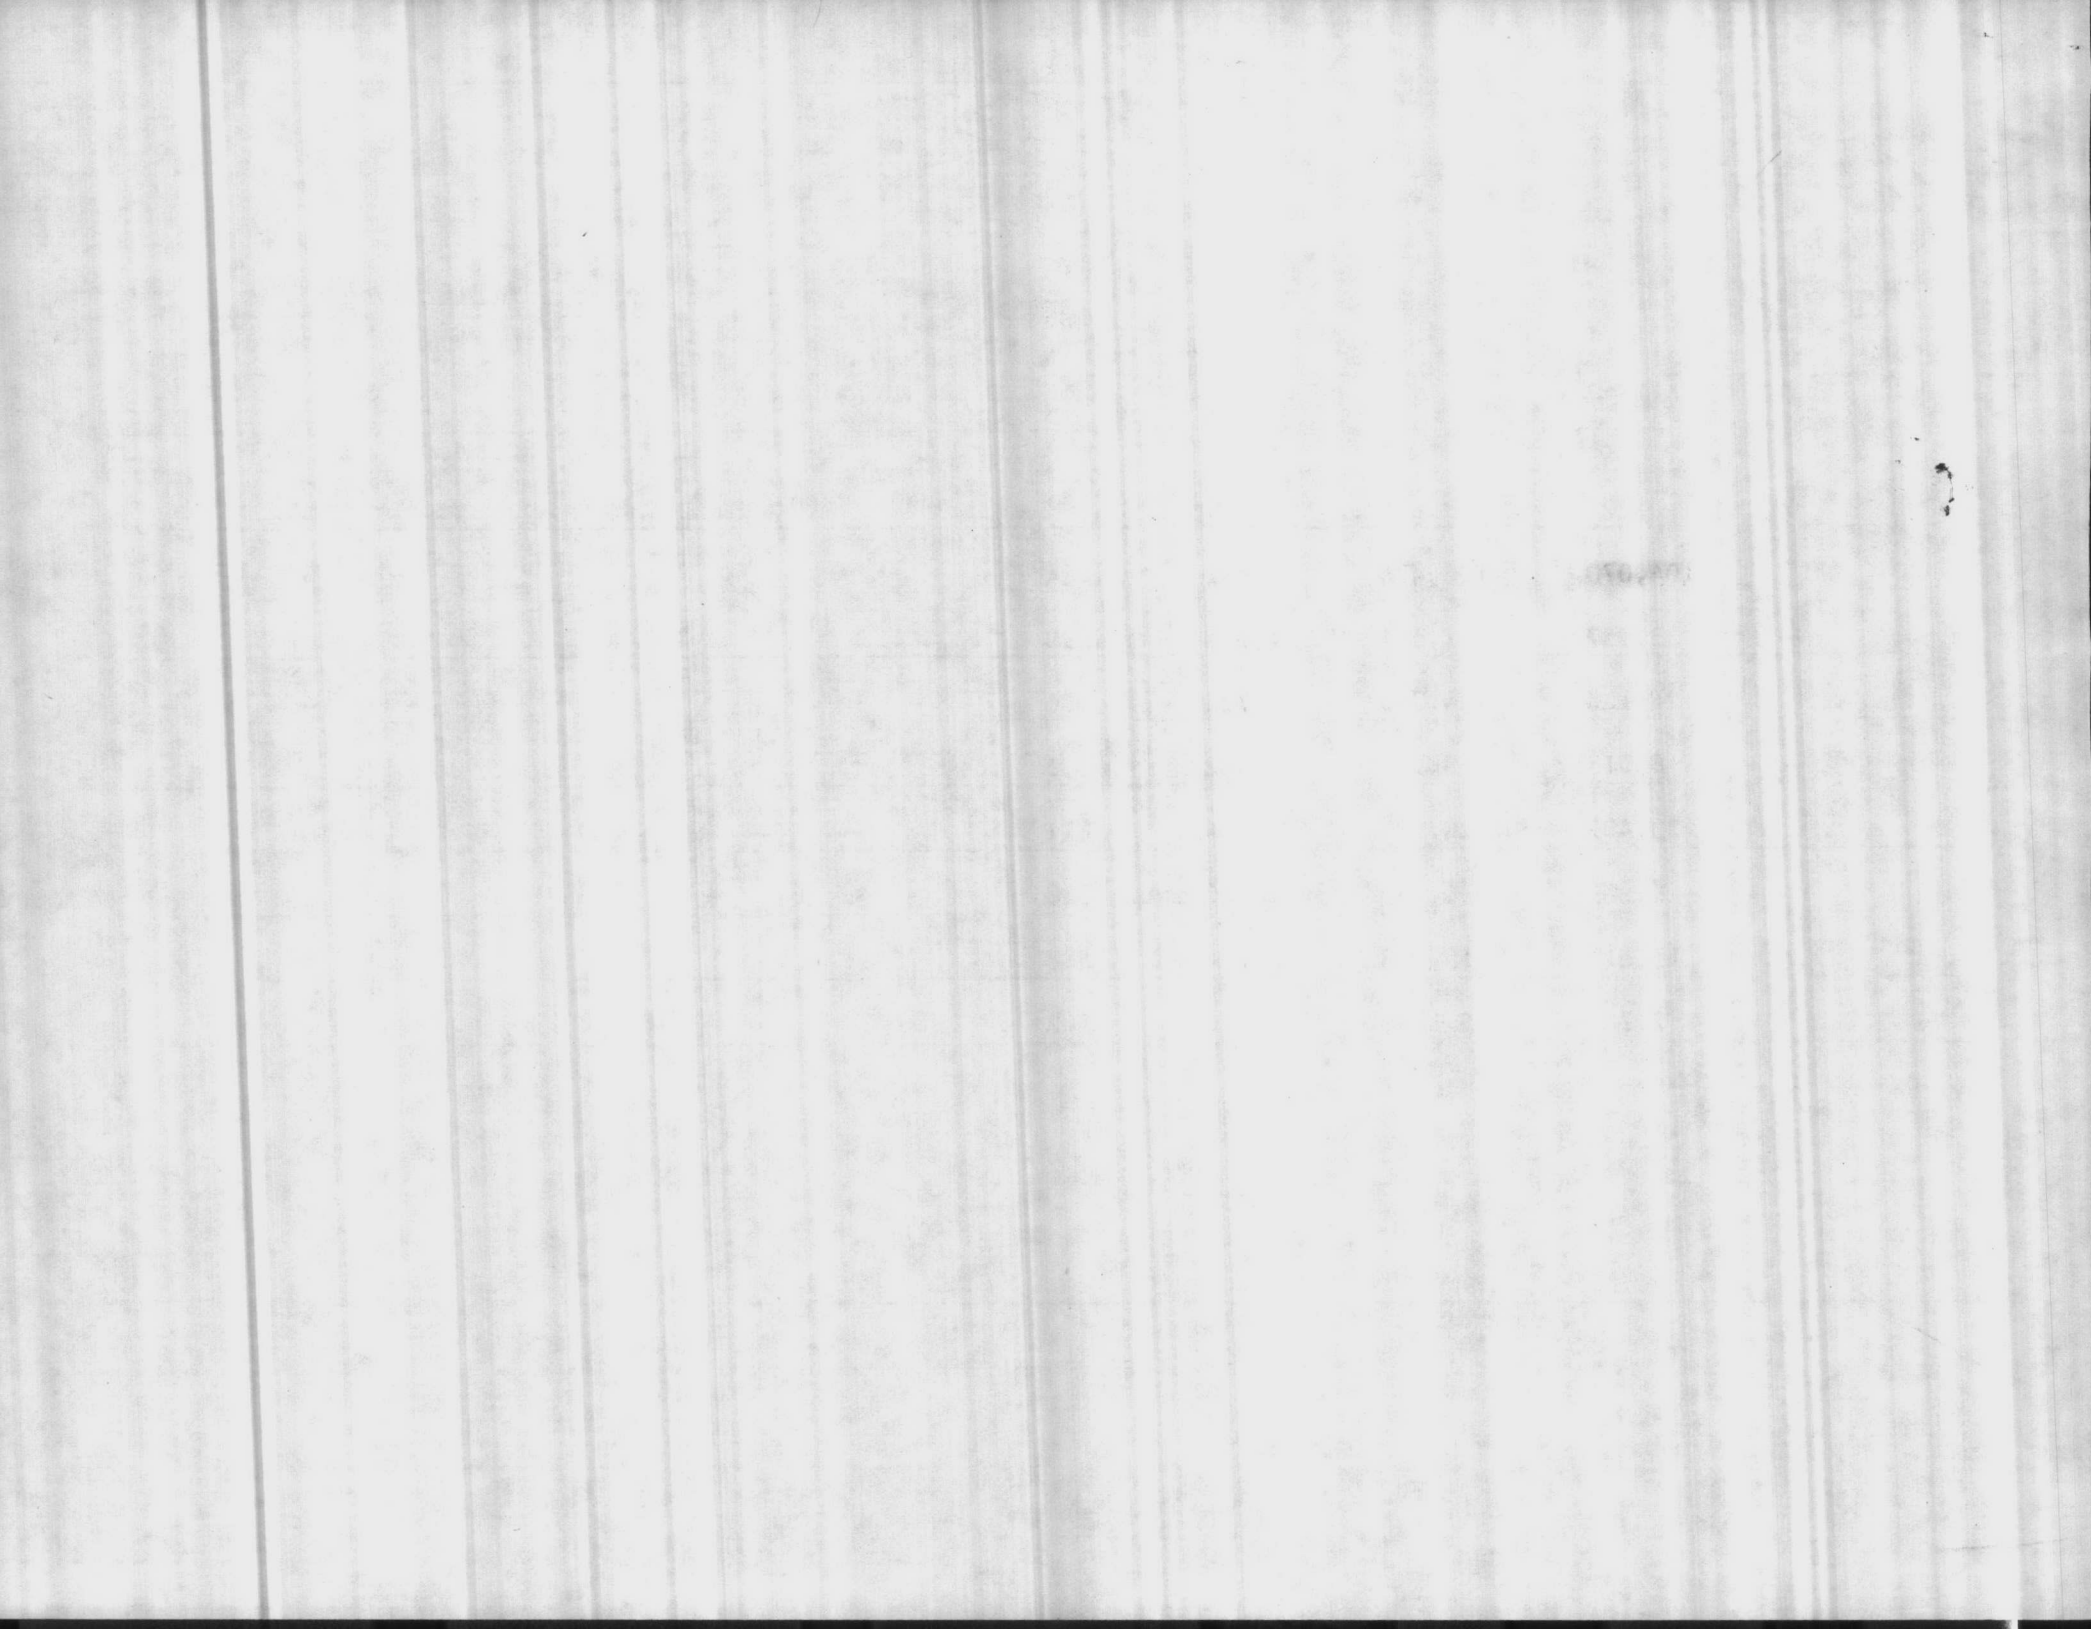


WATER TREATMENT PLANTWATER FLOWDATE: MAY 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	114,782	110,229	4,548	3,922	13	5,900	5,000	LIME
HOLCOMB BLVD.	41,176	39,407	1,150	1,773	3	2,304	2,000	LIME
TARAWA TERRACE	28,084	27,187	893	1,078	3	1,152	1,000	LIME
MONTFORD POINT	9,979	9,936	515	393	3	622	750	ZEOLITE
NCAS	26,680	24,227	2,448	1,009	3	4,081	3,500	LIME
RIFLE RANGE	6,764	Est 6,642	577	220	3	648	600	ZEOLITE
COURT HOUSE BAY	14,155	13,383	770	664	3	864	600	ZEOLITE
ON SLOW BEACH	2,408	2,270	134	89	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

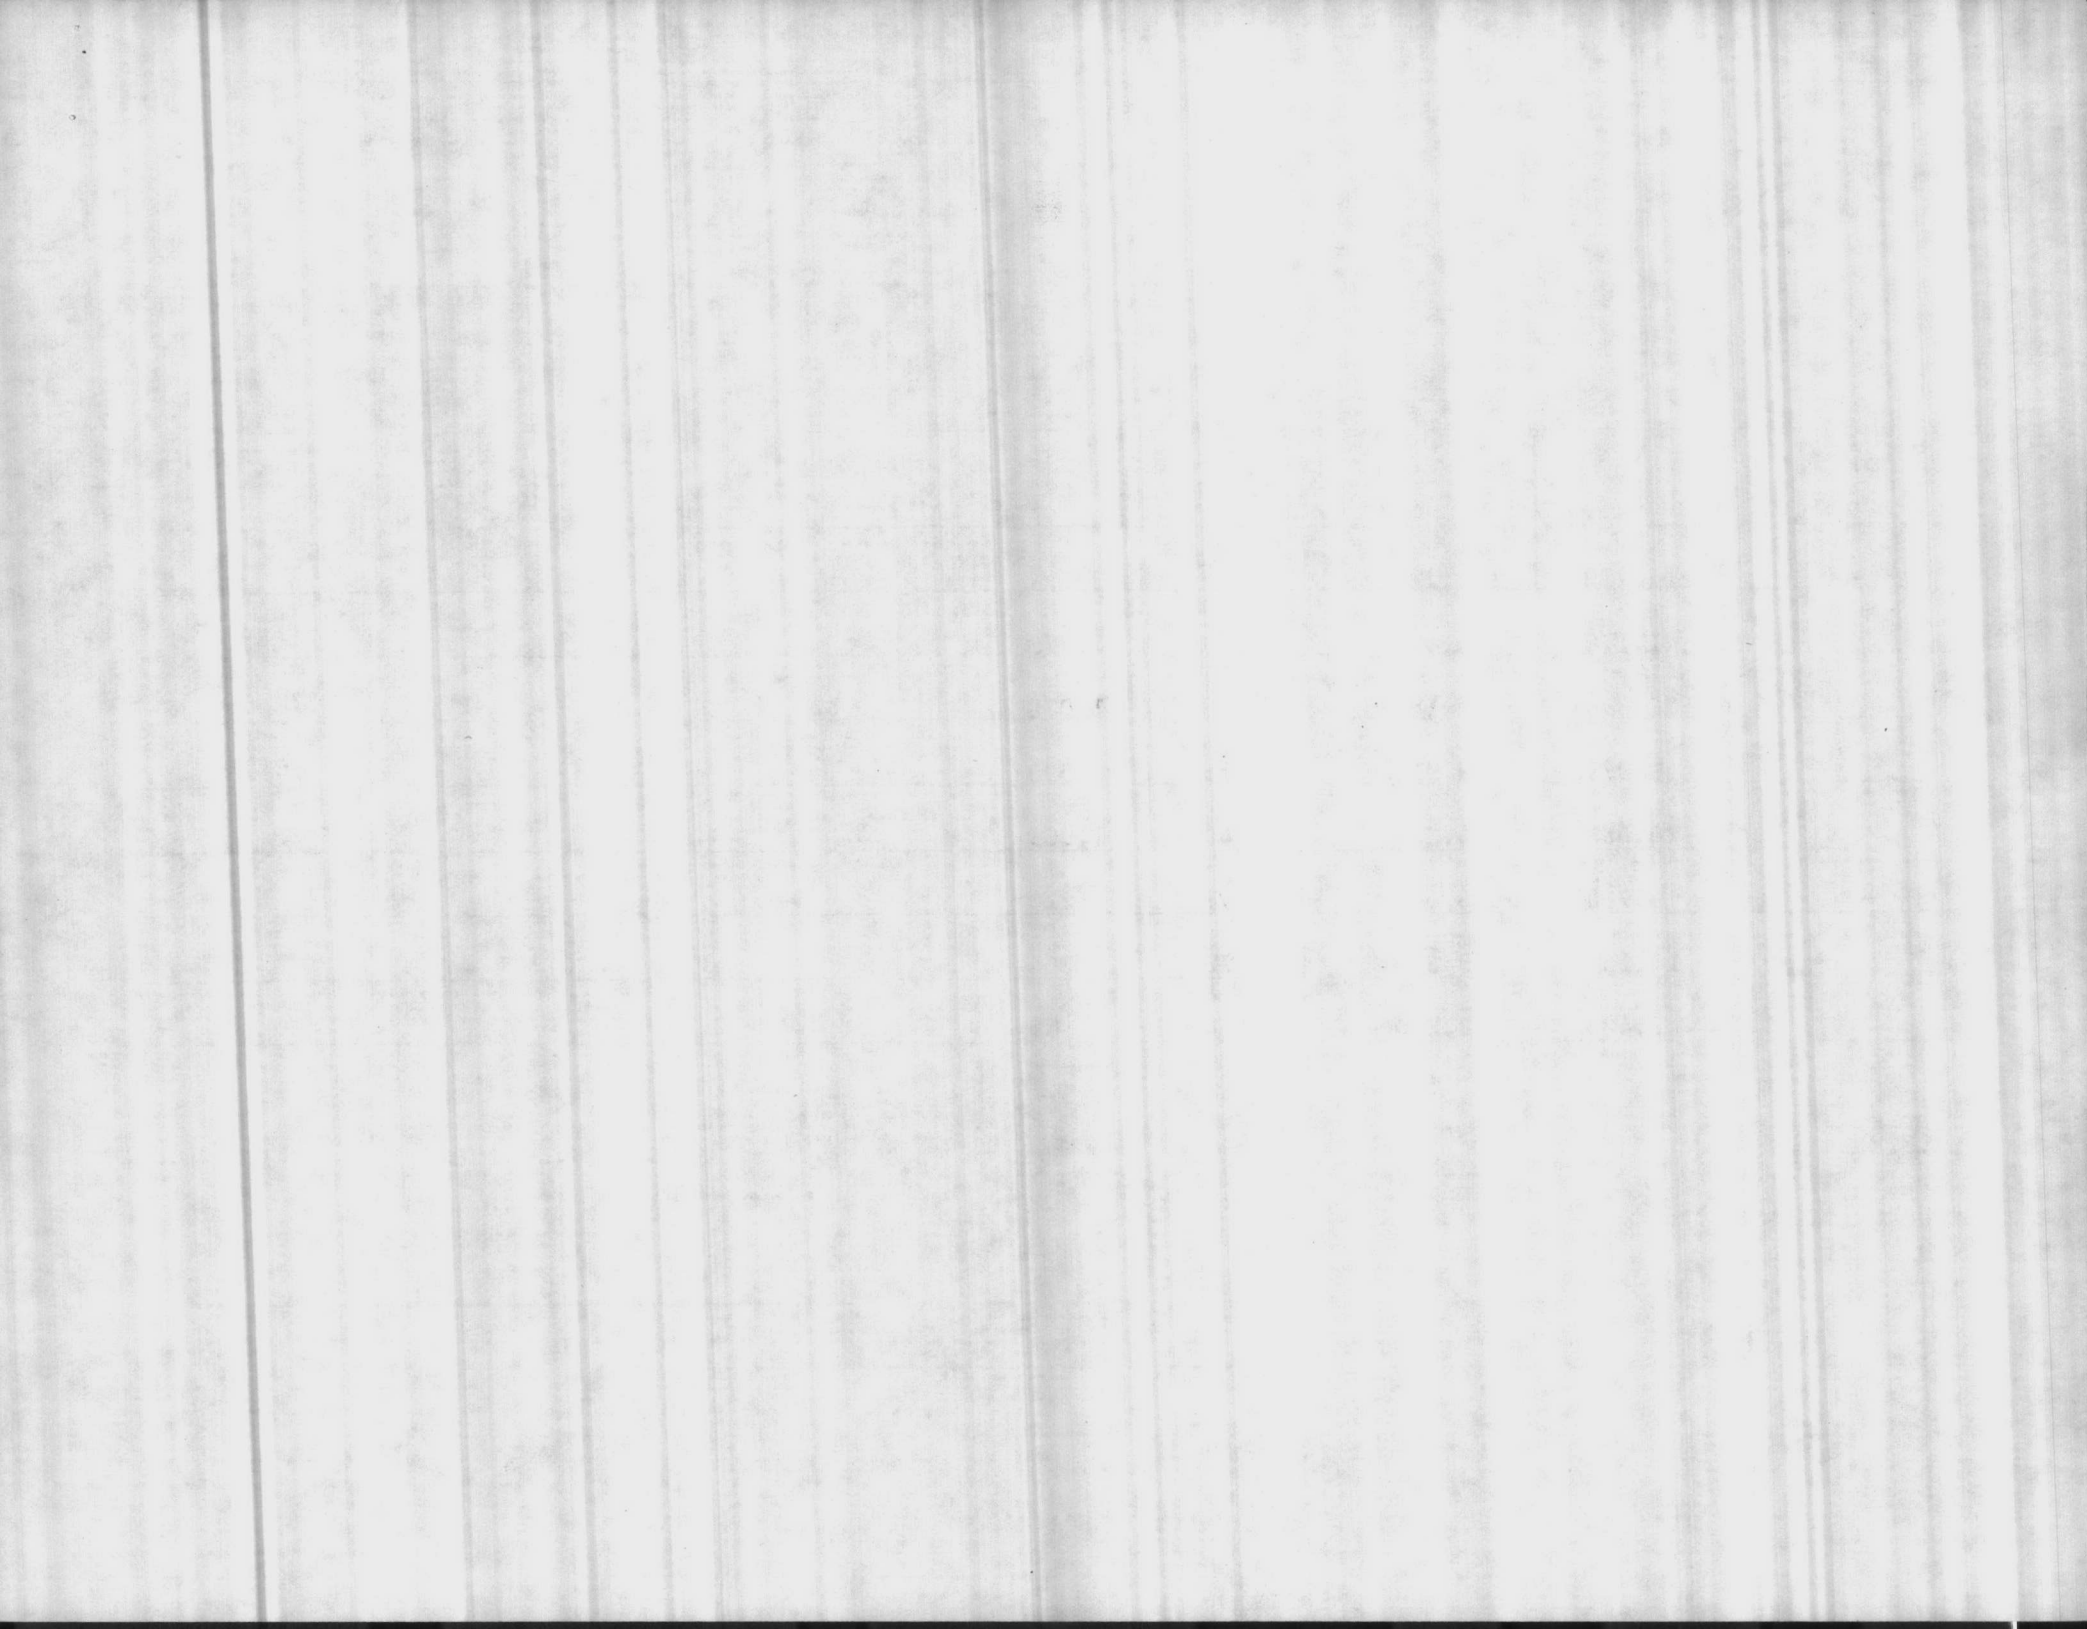

WATER TREATMENT PLANT

WATER FLOW

DATE: June 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	115,074	110,275	4,788	4,989	13	5,900	5,000	LIME
HOLCOMB BLVD.	48,442	47,310	1,113	1,828	3	2,304	2,000	LIME
TARAWA TERRACE	26,123	25,243	864	1,082	3	1,152	1,000	LIME
MONTFORD POINT	11,059	11,012	574	647	3	622	750	ZEOLITE
MCAS	32,744	27,576	2,832	1,137	3	4,081	3,500	LIME
RIFLE RANGE	10,531	10,157	579 est.	395	3	648	600	ZEOLITE
COURTHOUSE BAY	15,877	15,078	789	575	3	864	600	ZEOLITE
ONSLOW BEACH	3,296	3,154	134	147	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:



WATER TREATMENT PLANT

WATER FLOW

DATE: JULY 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
MADNOT POINT	111,473	Est. 107,260	4,947	4,213	13	5,900	5,000	LIME
HOLCOMB BLVD.	44,189	42,822	1,367	1,542	3	2,304	2,000	LIME
TARAWA TERRACE	25,830	24,938	892	1,467	3	1,152	1,000	LIME
MONTFORD POINT	11,232	11,108	580	358	3	622	750	ZEOLITE
NCAS	31,868	25,686	4,468	1,058	3	4,081	3,500	LIME
RIFLE RANGE	6,861	6,628	525	255	3	648	600	ZEOLITE
COURTHOUSE BAY	16,582	14,995	810	584	3	864	600	ZEOLITE
ONSLOW BEACH	3,947	2,293	128	163	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:



WATER TREATMENT PLANT


WATER FLOW

August 1984
DATE: 9-4-84

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	115,213	110,242	4,948	4,289	13	5,900	5,000	LIME
HOLCOMB BLVD.	43,658	42,408	1,150	1,594	3	2,304	2,000	LIME
TARAWA TERRACE	28,771	27,868	893	1,029	3	1,152	1,000	LIME
MONTFORD POINT	9,996	9,480	510	380, 380	3	622	750	ZEOLITE
MCAS	30,092	27,530	2,496	923	3	4,081	3,500	LIME
RIFLE RANGE	7,739	7,104	615	291	3	648	600	ZEOLITE
COURT HOUSE BAY	17,251	16,407	814	575	3	864	600	ZEOLITE
OSLOW BEACH	3,454	3,277	147	343	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

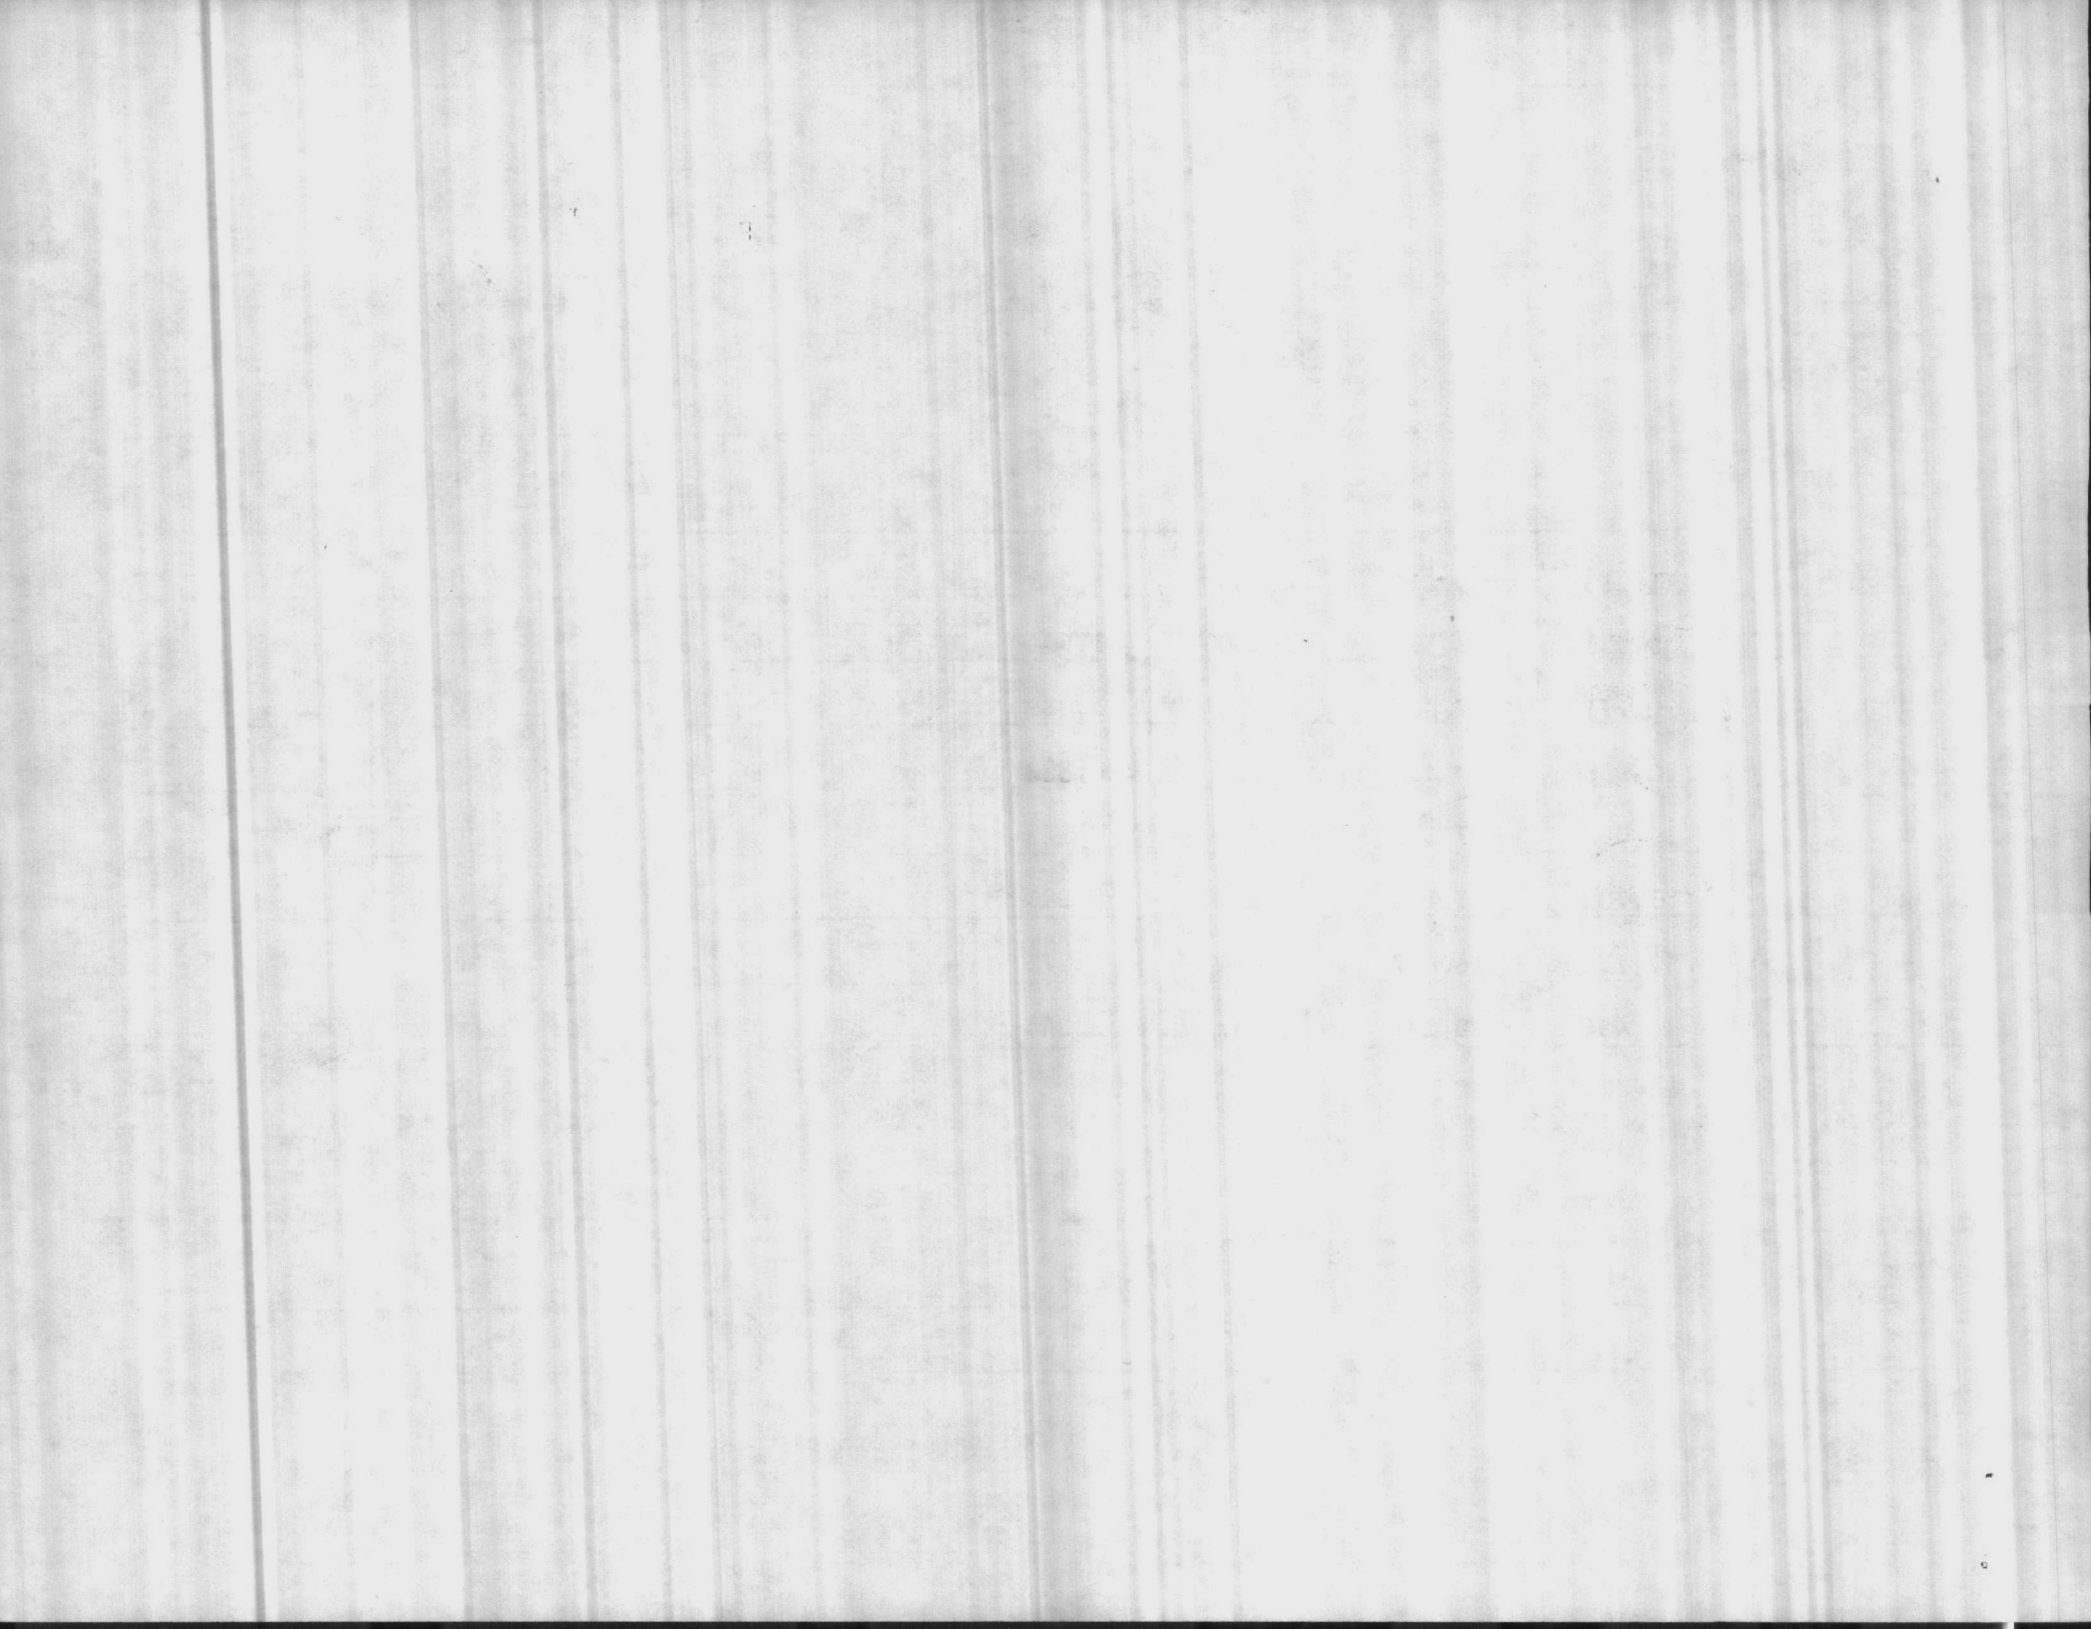


WATER TREATMENT PLANTWATER FLOWDATE: SEPTEMBER 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	103,732	100,137	3,591	3,506	13	5,900	5,000	LIME
HOLCOMB BLVD.	37,755	36,390	1,113	1,652	3	2,304	2,000	LIME
TARAWA TERRACE	25,359	24,482	864	945	3	1,152	1,000	LIME
MONTFORD POINT	8,509	7,860	636	329	3	622	750	ZEOLITE
MCAS	28,593	26,949	1,632	1,044	3	4,081	3,500	LIME
RIFLE RANGE	7,430	6,851	562	292	3	648	600	ZEOLITE
COURTHOUSE BAY	15,534	14,766	749	580	3	864	600	ZEOLITE
ONSLOW BEACH	3,569	3,561	109	113	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

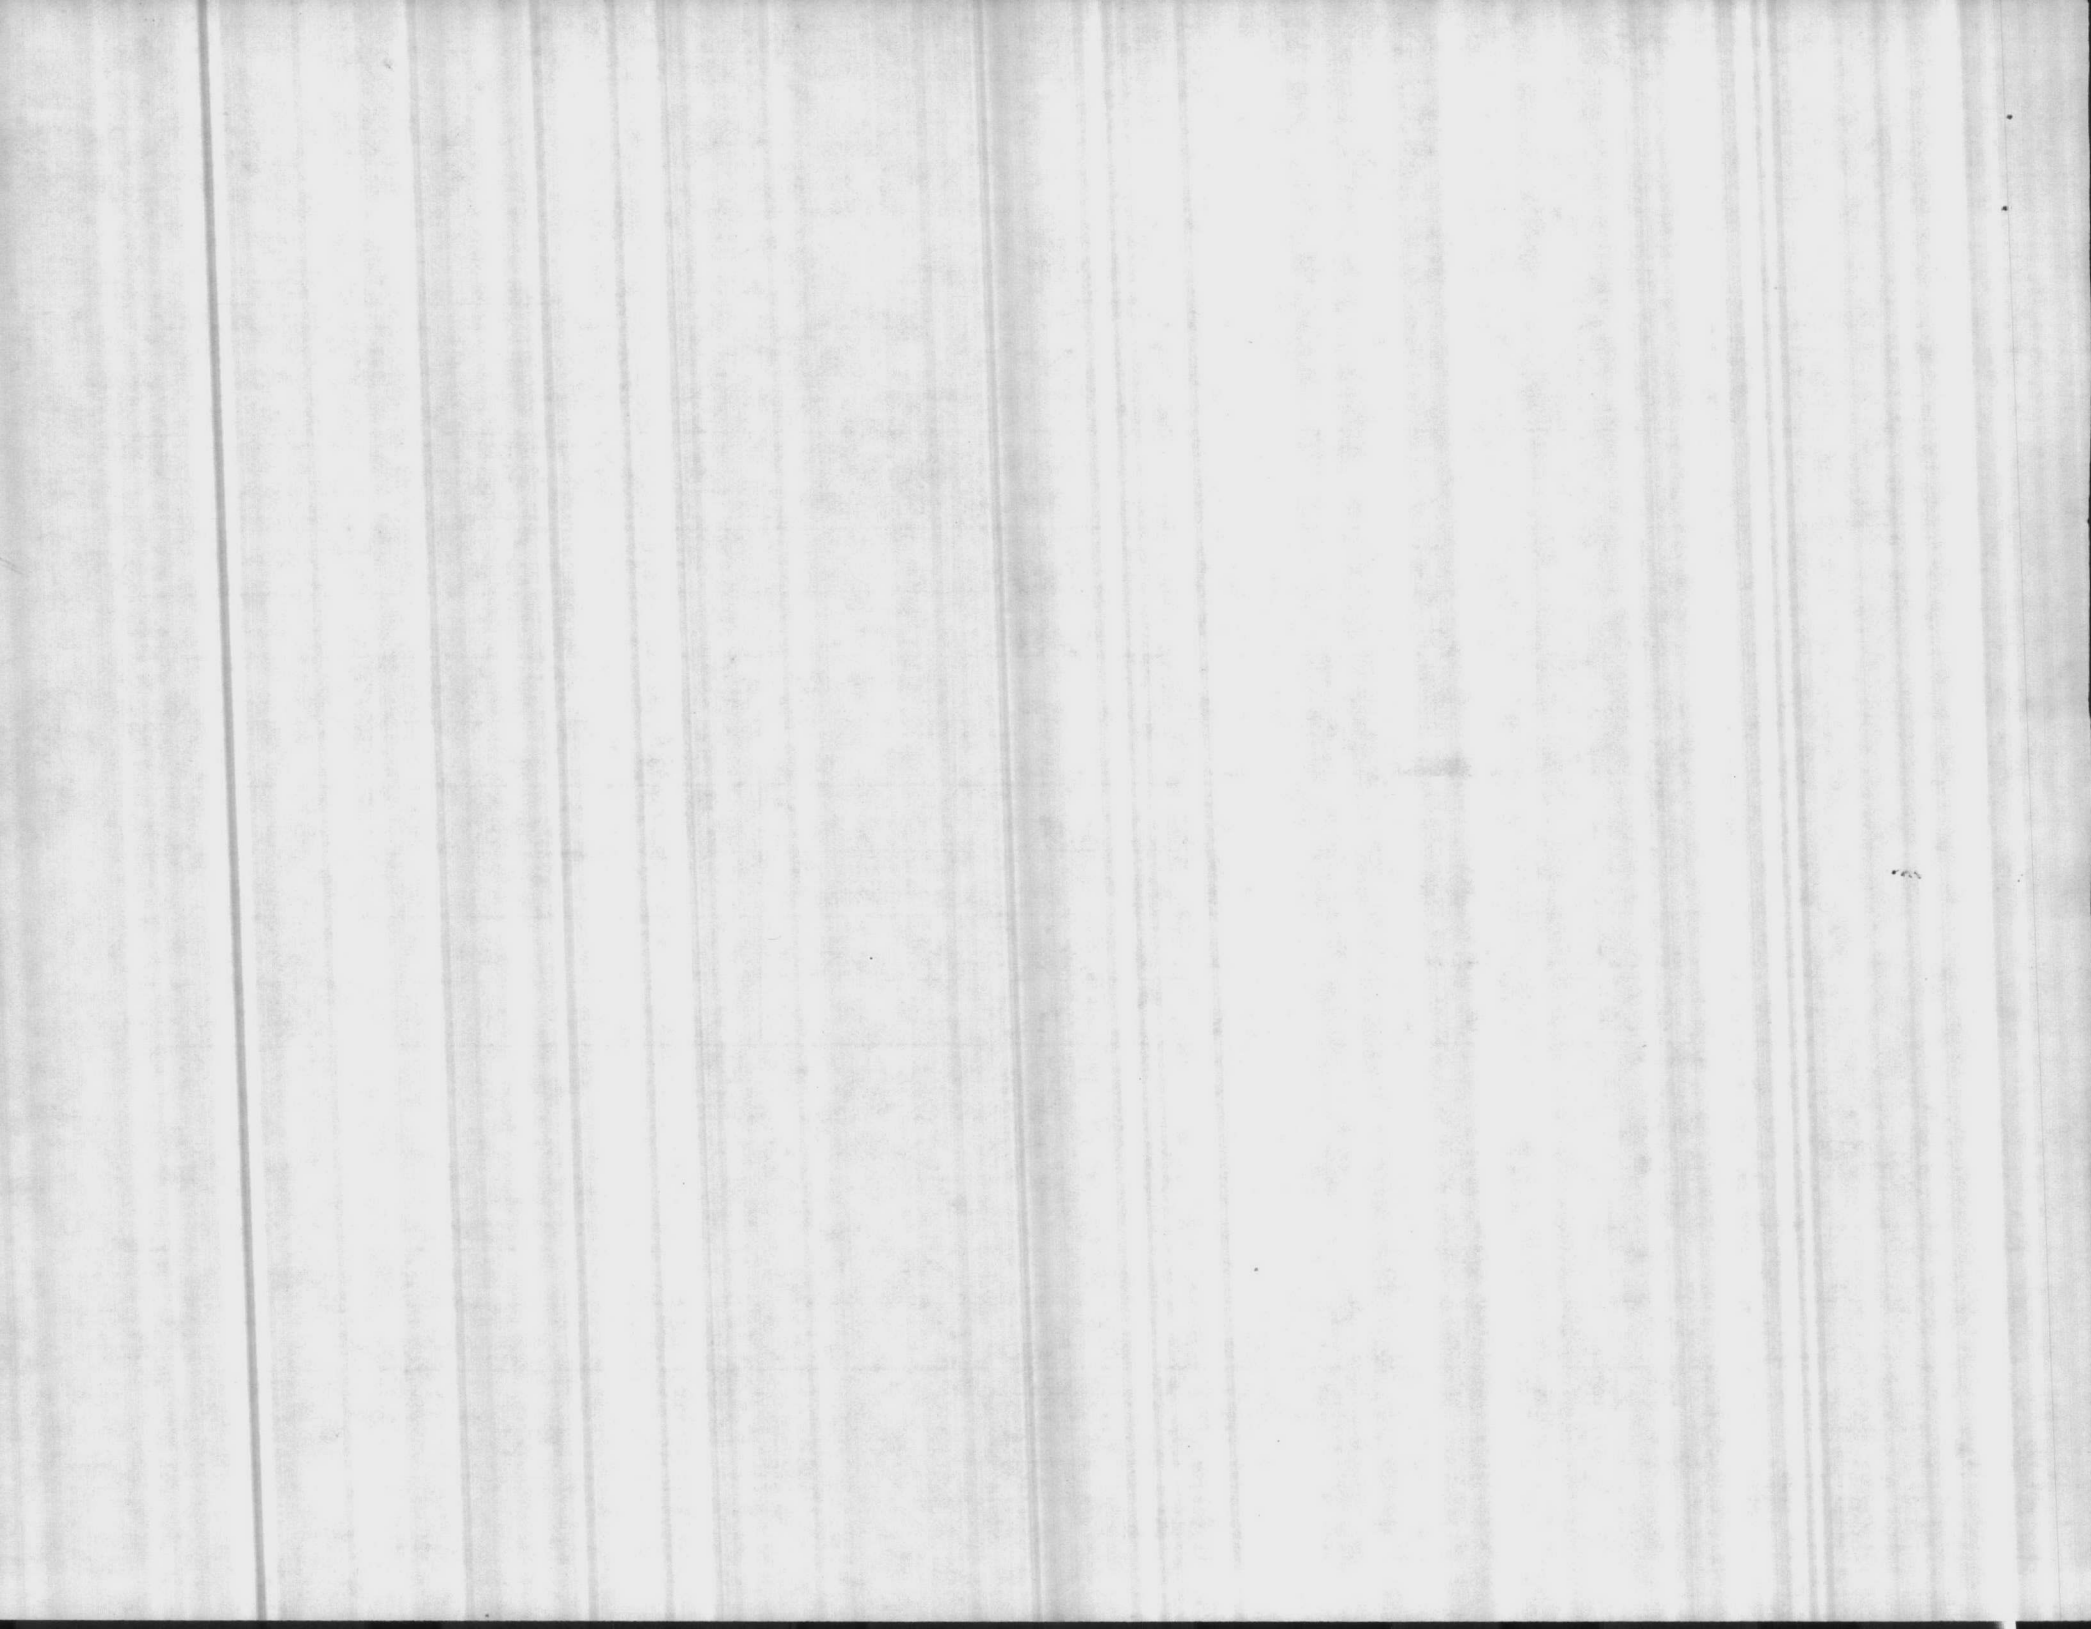

WATER TREATMENT PLANT


WATER FLOW

DATE: OCTOBER 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	112,502	107,555	4,947	4,027	13	5,900	5,000	LIME
HOLCOMB BLVD.	34,371	33,215	1,150	1,350	3	2,304	2,000	LIME
TARAWA TERRACE	26,791	25,886	.893	.939	3	1,152	1,000	LIME
MONTFORD POINT	8,670	8,152	.481	.462	3	622	750	ZEOLITE
MCAS	30,620	25,711	1,488	.987	3	4,081	3,500	LIME
RIFLE RANGE	6,721	6,221	.500	.244	3	648	600	ZEOLITE
COURTHOUSE BAY	15,098	14,145	.804	.556	3	864	600	ZEOLITE
ONISLOW BEACH	3,792	3,611	.173	.122	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

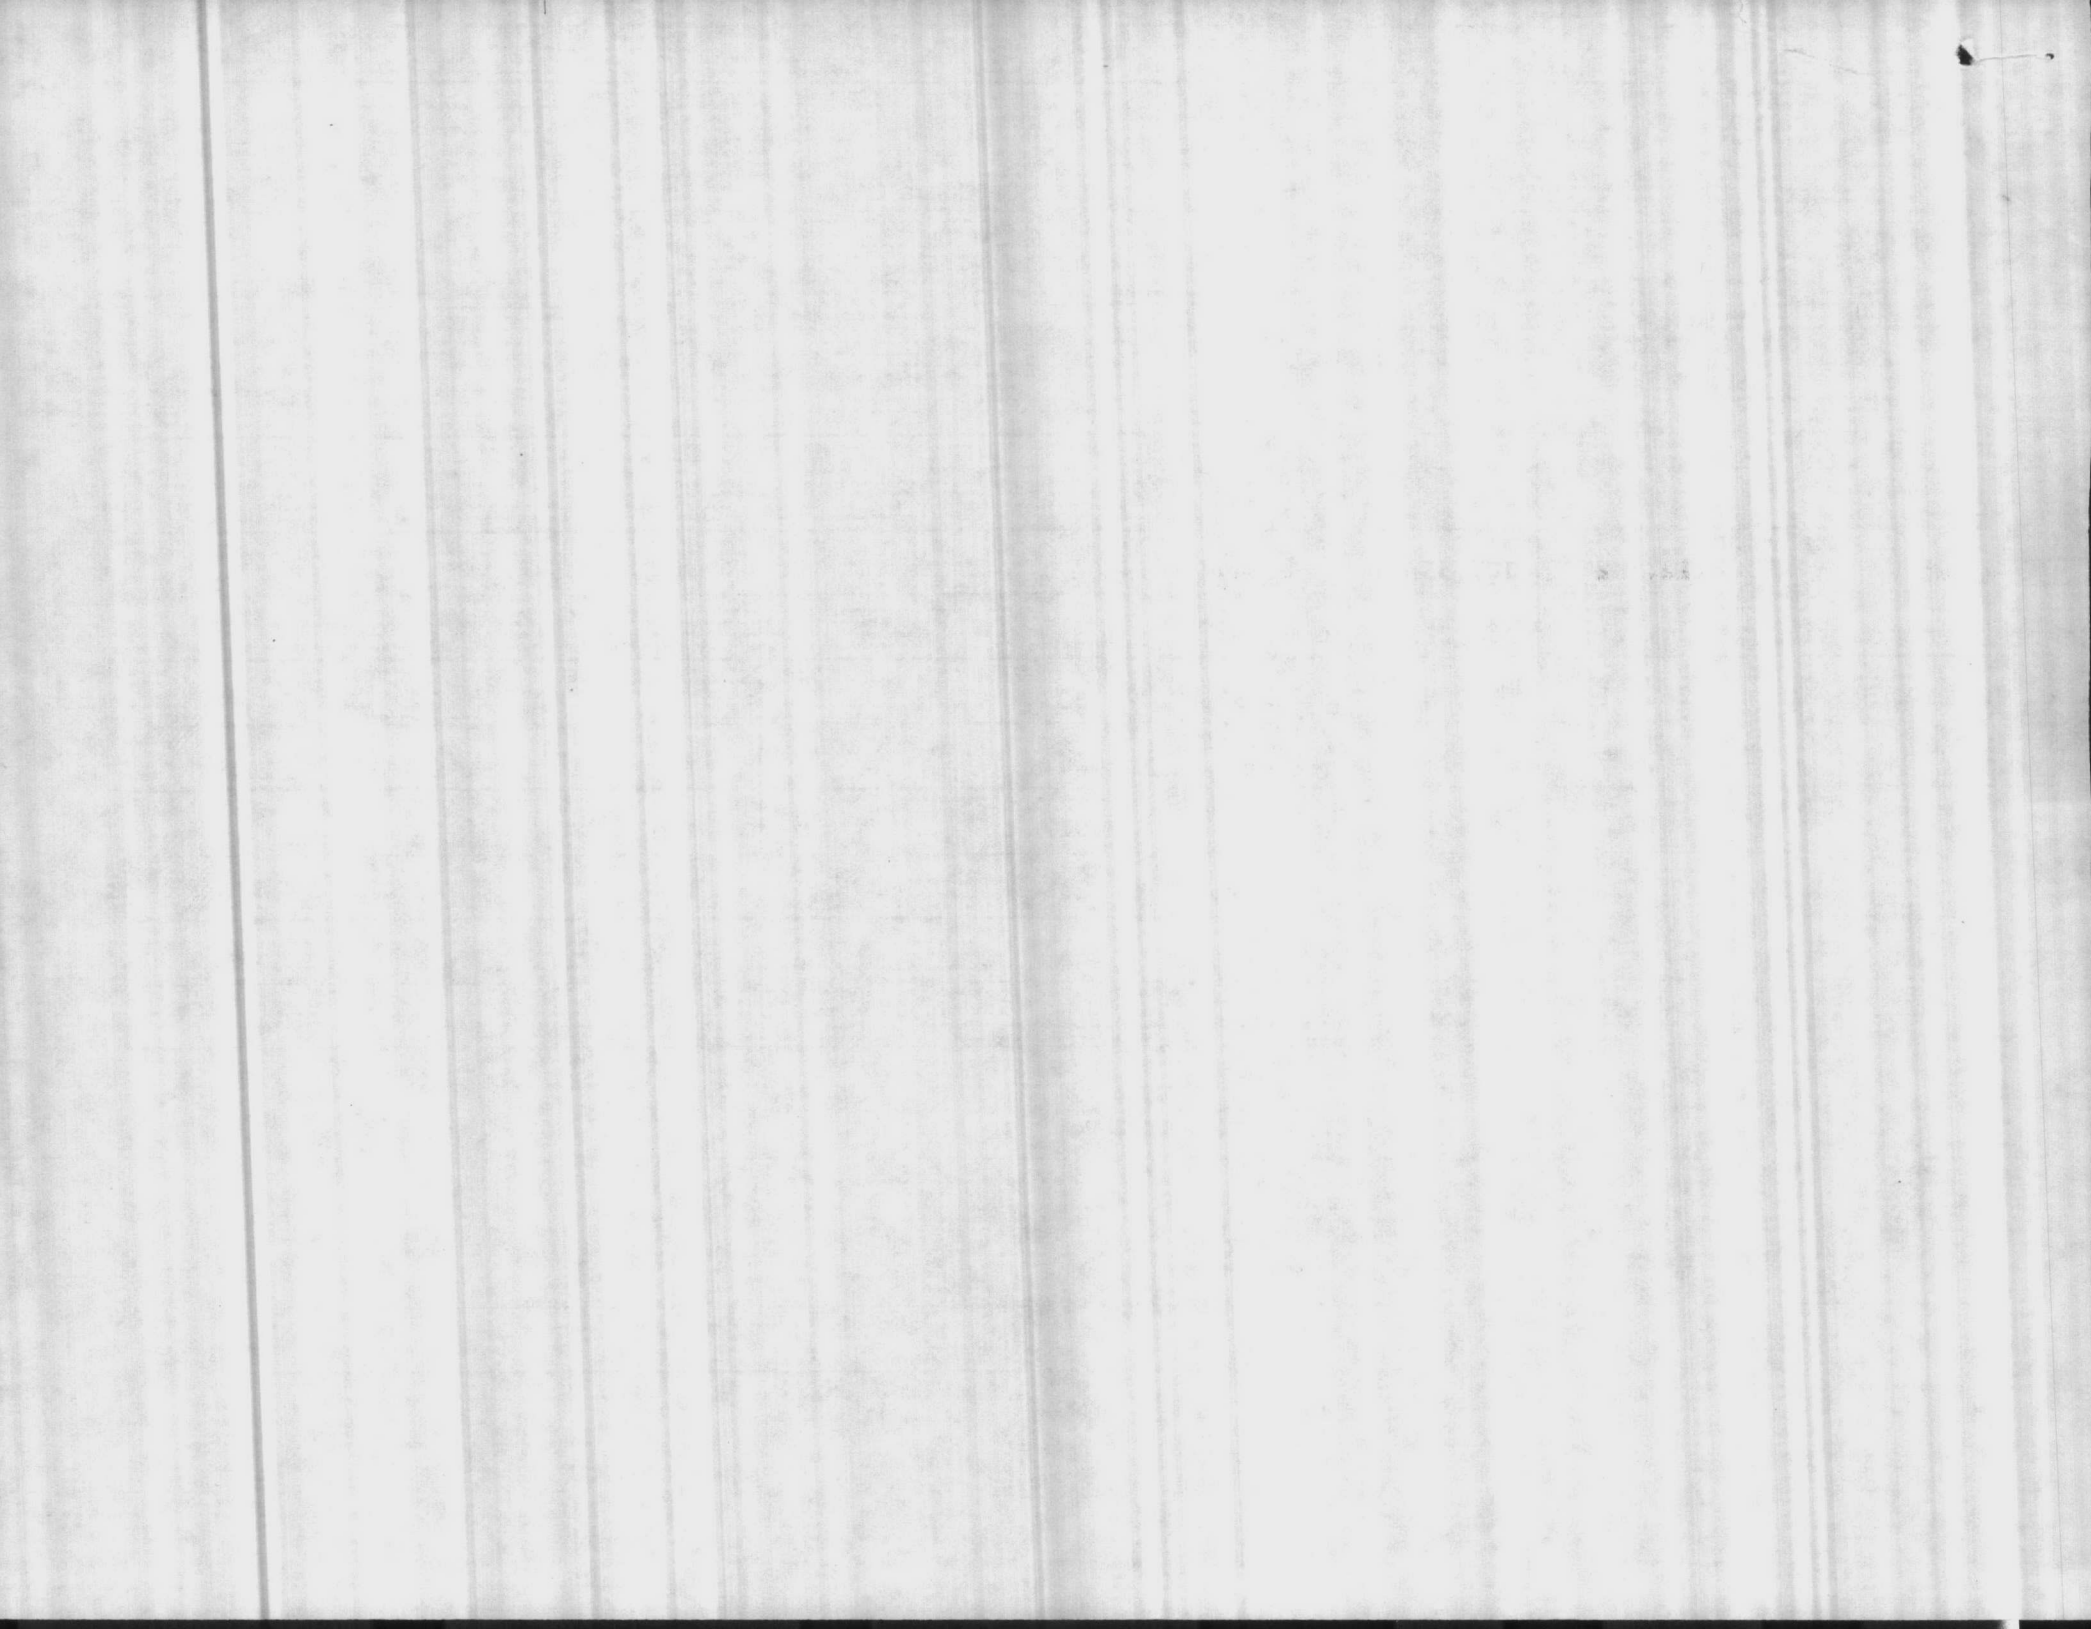

WATER TREATMENT PLANTWATER FLOWDATE: NOVEMBER 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	93,584	91,704	1,875	3,958	13	5,900	5,000	LIME
HOLCOMB BLVD.	31,309	30,342	.963	1,113	3	2,304	2,000	LIME
TARAWA TERRACE	25,531	24,573	.947	.907	3	1,152	1,000	LIME
MONTFORD POINT	8,294	7,839	.455	.358	3	622	750	ZEOLITE
MCAS	24,932	23,489	1,440	.957	3	4,081	3,500	LIME
RIFLE RANGE	7,712	7,122	.585 Est.	.317	3	648	600	ZEOLITE
COURTHOUSE BAY	15,713	14,915	.788	.622	3	864	600	ZEOLITE
ONSLOW BEACH	4,700	4,556	.140	.137	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:



WATER TREATMENT PLANTWATER FLOWDATE: DECEMBER 1984

PLANT	RAW	DELIVERED	WASHING FILTERS	MAX. DEL.	POTABLE WATER USED	WELLS MAX. SAFE YIELD/DAY	PLANT CAPACITY DAY	TREATMENT
HADNOT POINT	99,745	98,464	1,276	3,710	13	5,900	5,000	LIME
HOLCOMB BLVD.	30,699	29,695	995	1,108	3	2,304	2,000	LIME
TARAWA TERRACE	25,092	24,000	978	1,104	3	1,152	1,000	LIME
MONTFORD POINT	9,578	9,165	409	456	3	622	750	ZEOLITE
MCAS	25,101	23,559	1,536	901	3	4,081	3,500	LIME
RIFLE RANGE	7,797	7,193 est.	600	325	3	648	600	ZEOLITE
COURTHOUSE BAY	14,977	14,152	810	560	3	864	600	ZEOLITE
ON SLOW BEACH	4,182	4,048	132	131	3	250	250	ZEOLITE

WATER IN MILLION GALLONS

REMARKS:

Rifle Range delivered water meter out of service



MONTHLY REPORT WATER
FLOW - 1980

