



TYPICAL DEVICE CONNECTIONS

SEC. 16722
PARA. 152


PULL STATION 2099-9201

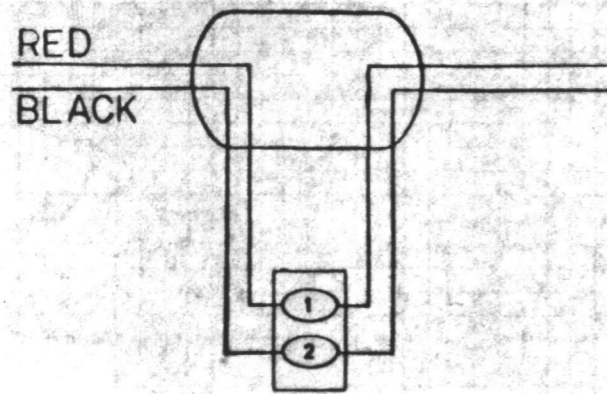


BELL 2901-9320

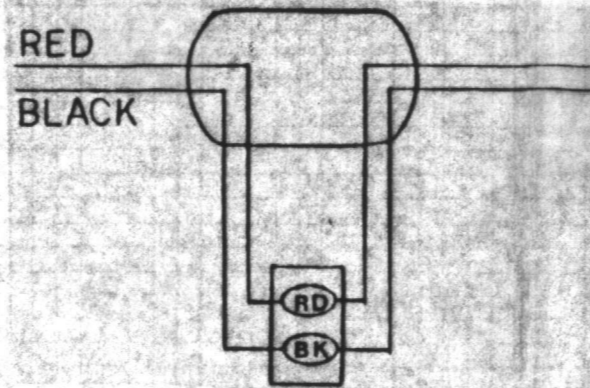

DUCT DETECTOR
2098-9634

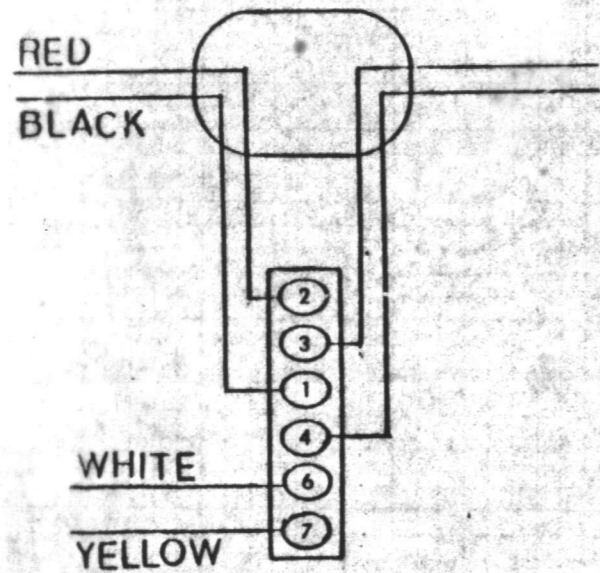

HORN 2901-9806

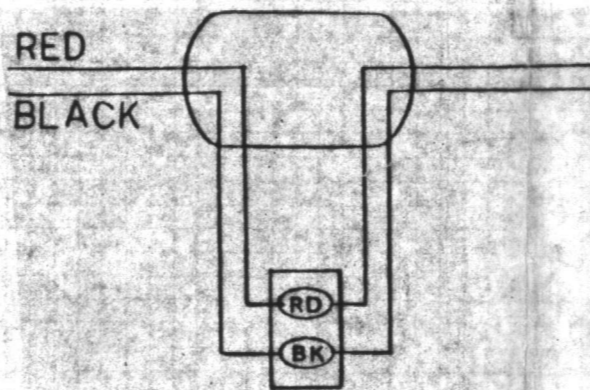

SYMBOL LIST

	PULL STATION 2099-9201
	HORN 2901-9806
	DUCT DETECTOR 2098-9634
	BELL 2901-9320
	FIRE ALARM CONTROL PANEL

GENERAL NOTES

1. ALL WIRING ABOVE 30 VAC MUST BE IN SEPARATE CONDUIT FROM ANY WIRING OF 28 VDC OR BELOW.
2. ALL CONDUCTORS MUST TEST FREE OF ALL OPENS, GROUNDS, AND/OR SHORTS.
3. ALL CIRCUIT WIRING TO BE #14 A.W.G. SINGLE CONDUCTOR UNLESS OTHERWISE NOTED.
4. ALL CONTROL EQUIPMENT GROUNDING CONDUCTORS TO BE #12 A.W.G. SINGLE CONDUCTOR UNLESS OTHERWISE NOTED. GROUNDING CONDUCTORS TO BE CARRIED TO AND BONDED TO A GROUNDING ELECTRODE PER N.E.C. ARTICLE 250. CONDUIT GROUNDING OF CONTROL EQUIPMENT WILL NOT BE CONSIDERED EQUAL TO THE ABOVE DESCRIBED METHOD.

	PROJECT	DWG NO.	REV.
	4433 Beryl Road Raleigh, NC (919) 829-0555	LOCATION EXCHANGE FRANK TURNER ELEC	1
BRANCH OFFICE	4433 Beryl Road Raleigh, NC (919) 829-0555	ORDER NO.	
LOCATION		RPO NO.	
TEL NO.		DRN BY	APPVD. BY

DUPLICATE
3088

RED
BLACK




WHITE
YELLOW

NOTES

NOTICE: THIS DOCUMENT IS THE PROPERTY OF THE
FEDERAL BUREAU OF INVESTIGATION AND IS LOANED TO YOU.
IT IS TO BE RETURNED TO THE OFFICE OF ORIGIN UPON
REQUEST. IT IS NOT TO BE REPRODUCED OR
DISTRIBUTED OUTSIDE YOUR AGENCY WITHOUT THE
APPROPRIATE AUTHORITY.

LOCK
FLANK
FBI
WASHINGTON, DC
(810) 550-088

FILED
OFFICE
LOCATION
TEL NO.

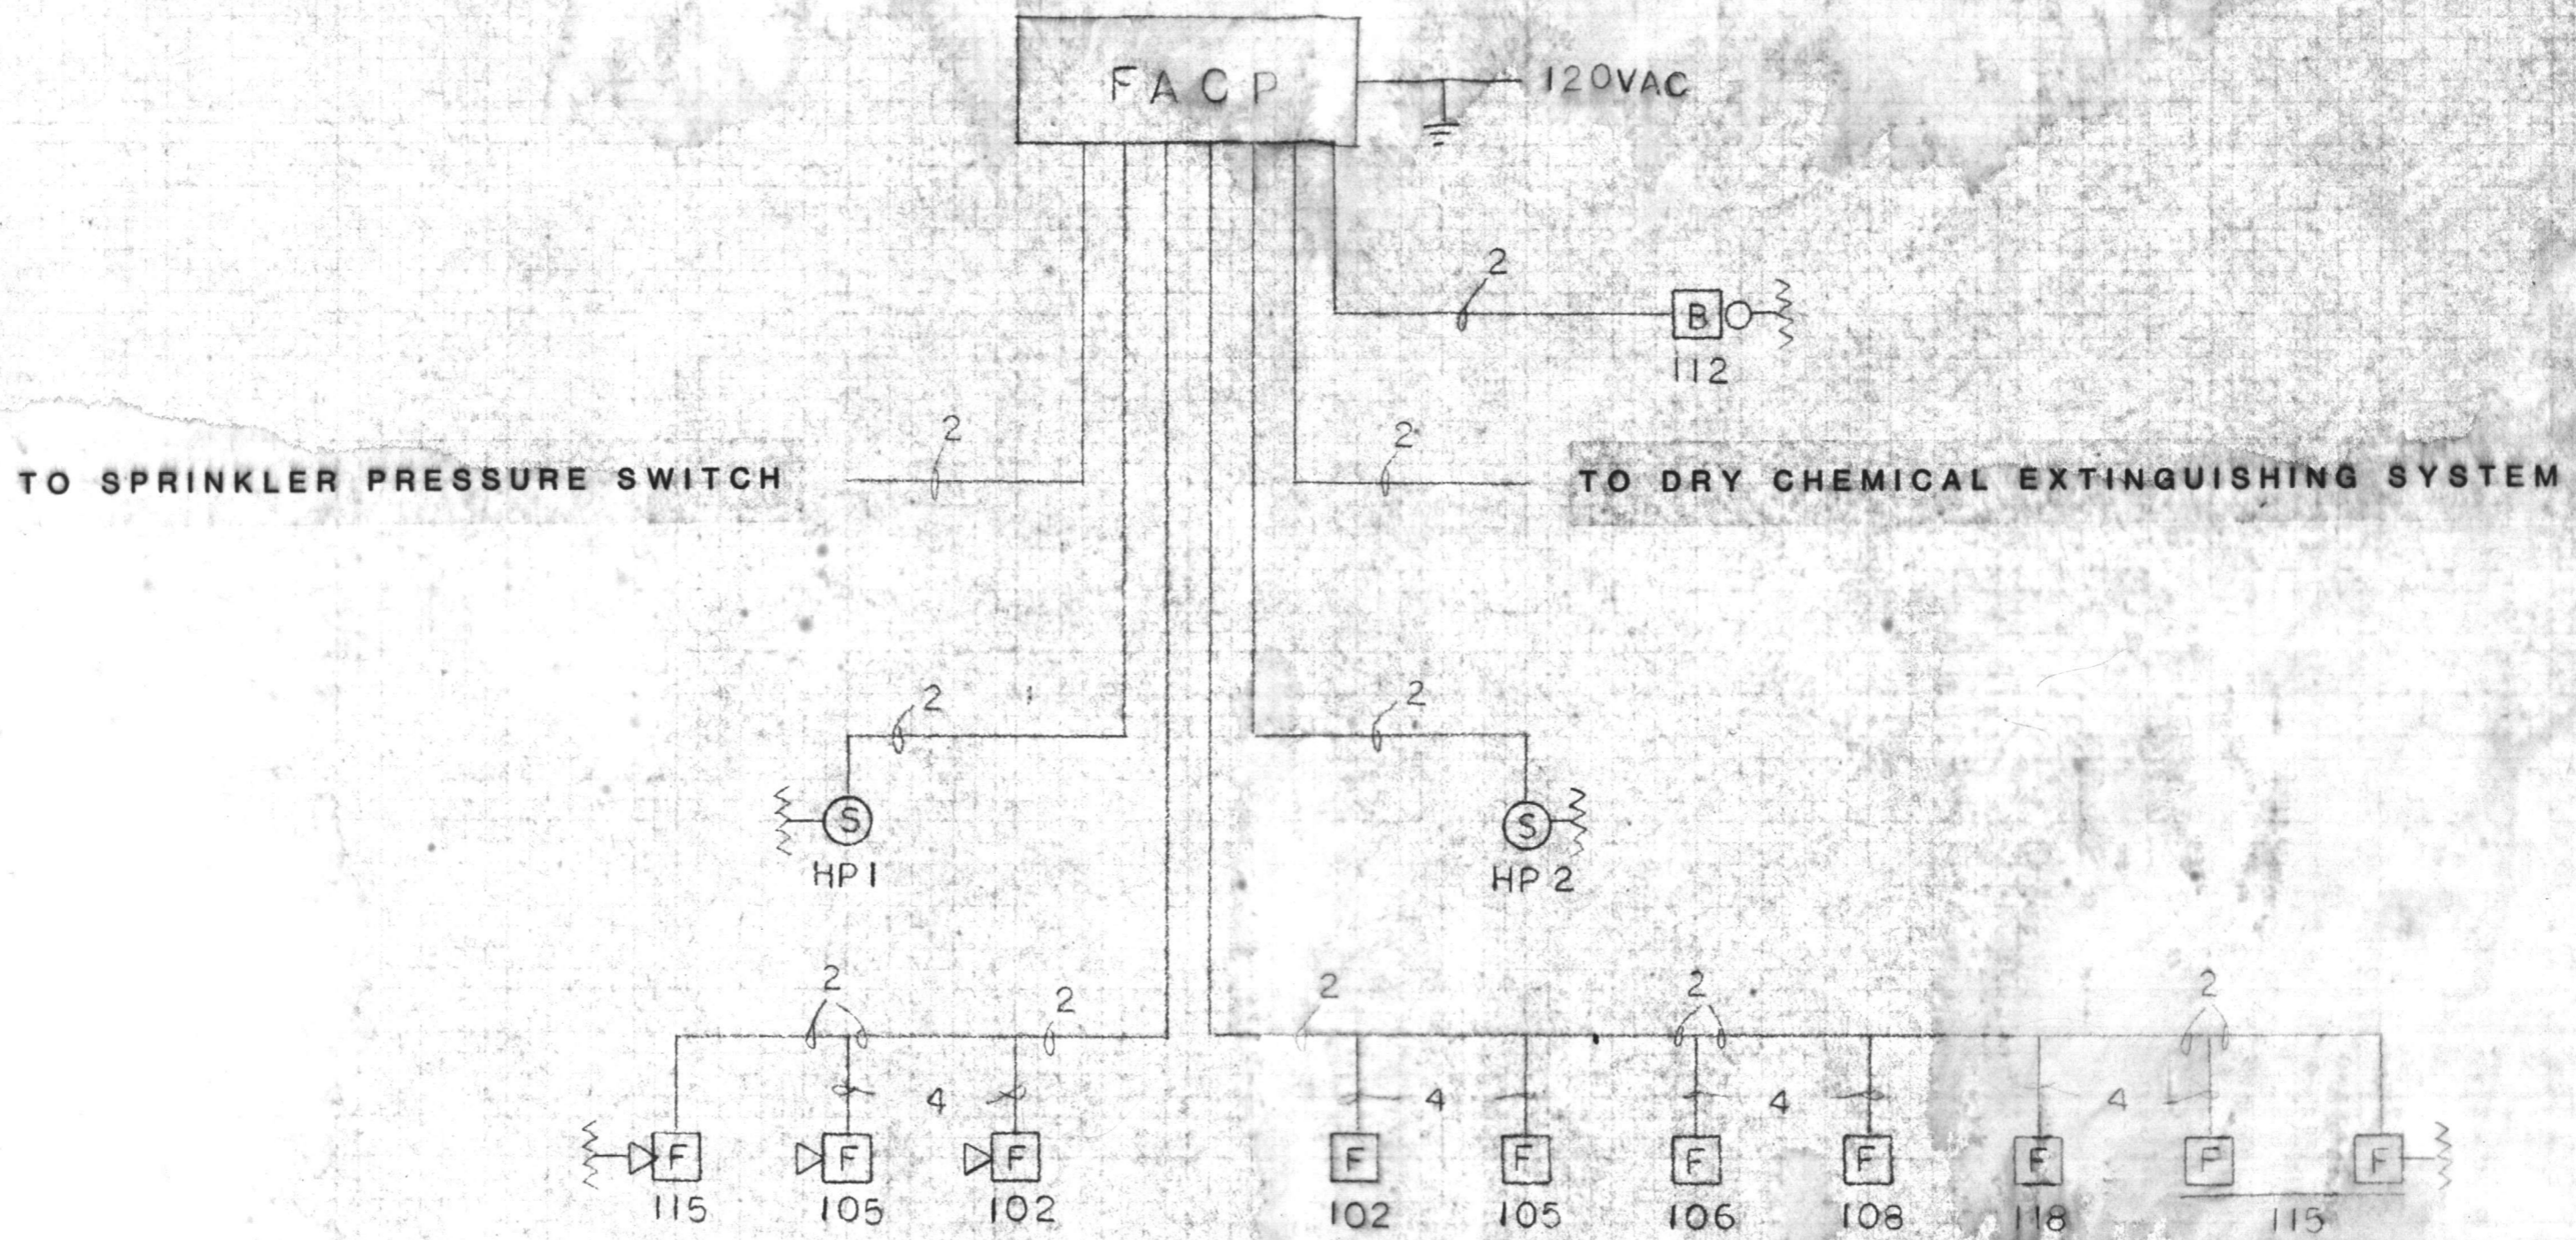

		PROJECT	DWG NO.	REV.
BRANCH OFFICE 4433 Beryl Road Raleigh, NC		LOCATION EXCHANGE FRANK TURNER ELEC	2	
LOCATION TEL. NO (919) 829-0555		ORDER NO. RPO NO.		
DRN BY		APPVD BY		

TO SPRINKLER PRESSURE

TO SPRINKLER PRESSURE

LOG
FRANK

112 Beryl Road
Raleigh, NC
919) 822-0822

TE. NO.
LOCATE
OFFICE
BRANCH