

DATE OF INSPECTION

4 MAY - 13 MAY 1982

TYPE OF INSPECTION

A  INTERNAL & EXTERNAL

B  INTERNAL & EXTERNAL WITH PRESSURE TEST

C  OPERATIONAL

1. FROM **BASE MAINT. OFFICER  
 CAMP LEJEUNE, N. C.**

14. CERTIFICATE ISSUED  YES  NO  
 EXPIRES 25 NOV. 1982

2. TO **NAVFACENCOM  
 NORFOLK, VA.**

15. BOILER INSPECTOR

*Thomas L. Lanier*  
 NAVY OR NATIONAL BOARD NO.

**NAVFAC 239**

16. REASON FOR NOT ISSUING CERTIFICATE

BOILER DATA

3. MANUFACTURER

**FITZ GIBBONS**

4. PROPERTY NO.

**28**

5. MFG. SERIAL NO.

**36464**

6. MFG. MODEL NO.

**---**

7. BUILDING NO.

**TT-48**

8. YEAR BUILT

**1959**

9. CAPACITY

**1,000,000 BTU/HR.**

10. FUEL (Check)

COAL  OIL  GAS

11. PRESSURE

DESIGNED

**30**

psi

OPERATING

**12**

psi

TEST

**45**

psi

12. FEED WATER TREATMENT

SATISFACTORY  UNSATISFACTORY

13. TYPE

WATER TUBE

FIRE TUBE

C. I.

17. BOILER USE

**HEATING**

18. COMBUSTION CONTROL (Mfg. Name)

**HONEYWELL**

19. COMBUSTION

\_\_\_\_\_ % CO<sub>2</sub>

\_\_\_\_\_ % EXCESS O<sub>2</sub>

20. FLUE GAS TEMPERATURE

AFTER BOILER \_\_\_\_\_ °F

: AFTER HEAT TRAP \_\_\_\_\_ °F

SAFETY DEVICES

SAFETY VALVES

21. MANUFACTURER

**McDONNELL MILLER**

22. NUMBER AND SIZE

**1-1" 1-1/2"**

23. PSI SETTING

**30**

24. CONDITION

STEAM PRESSURE GAUGE

25. MANUFACTURER

**ASME STD.**

26. CORRECTIONS

WATER LEG CONSTANT \_\_\_\_\_ psi

OTHER \_\_\_\_\_ psi

27. REASON IF NOT TESTED

FIRING EQUIPMENT

ITEM	IN SERVICE	ALTERNATE
28. MANUFACTURER	<b>AUTOMATIC BURNER CORP.</b>	
29. TYPE	<b>NOZZLE SPRAY</b>	
30. FUEL GRADE	<b>#2</b>	

28. MANUFACTURER

**AUTOMATIC BURNER CORP.**

29. TYPE

**NOZZLE SPRAY**

30. FUEL GRADE

**#2**

31. INSPECTOR'S COMMENTS

**OK**

32. ATTACHMENT(S) (Check)

COPY OF INSPECTOR'S REPORT

SPECIAL COMMENTS

33. SIGNATURE

*R.M. Allen*

BY DIRECTION



INSPECTION REPORT-BOILERS

NAVFAC 9-11014/41 (3/67)  
 Supersedes NAVDOCKS 2544  
 S/N 0105-LF-004-0000

DATE OF INSPECTION

6 NOV 1978

TYPE OF INSPECTION

A  INTERNAL & EXTERNAL

B  INTERNAL & EXTERNAL WITH PRESSURE TEST

C  OPERATIONAL

1. FROM

BASE MAINT. OFFICER CAMP LETAUNE N.C.

2. TO

COMMANDANT Hdqtrs MARINE CORPS (CODE LFF)

14.

CERTIFICATE ISSUED  YES  NO

EXPIRES 29 JUNE 1979

15. BOILER INSPECTOR

Joseph A. Sellers

NAVY OR NATIONAL BOARD NO.

NAVFAC 295

16. REASON FOR NOT ISSUING CERTIFICATE

BOILER DATA

3. MANUFACTURER

FITZGIBBONS

4. PROPERTY NO.

28

5. MFG. SERIAL NO.

36464

6. MFG. MODEL NO.

—

7. BUILDING NO.

TT-48

8. YEAR BUILT

1959

9. CAPACITY

1,000,000 BTU/HR

10. FUEL (Check)

COAL

OIL

GAS

11. PRESSURE

DESIGNED

30

OPERATING

12

TEST

—

12. FEED WATER TREATMENT

SATISFACTORY

UNSATISFACTORY

13. TYPE

WATER TUBE

FIRE TUBE

C. I.

17. BOILER USE

HEATING

18. COMBUSTION CONTROL (Mfg. Name)

HONEYWELL

19. COMBUSTION

9.0

% CO<sub>2</sub>

% EXCESS O<sub>2</sub>

20. FLUE GAS TEMPERATURE

AFTER BOILER 290

°F : AFTER HEAT TRAP

°F

SAFETY DEVICES

SAFETY VALVES

21. MANUFACTURER

McDONNELL MILLER

22. NUMBER AND SIZE

1-1" - 1-1/2"

23. PSI SETTING

30

24. CONDITION

GOOD

STEAM PRESSURE GAUGE

25. MANUFACTURER

ASME STD-

26. CORRECTIONS

WATER LEG CONSTANT

psi

OTHER

psi

27. REASON IF NOT TESTED

FIRING EQUIPMENT

ITEM	IN SERVICE	ALTERNATE
28. MANUFACTURER	AUTOMATIC BURNER CORP.	NONE
29. TYPE	NOZZLE SPRAY -	
30. FUEL GRADE	#2	

31. INSPECTOR'S COMMENTS

REPLACE SMALL SAFETY VALVE (BROKEN STEM)

32. ATTACHMENT(S) (Check)


COPY OF INSPECTOR'S REPORT

SPECIAL COMMENTS

33. SIGNATURE

R.M. Sullivan

BY DIRECTION

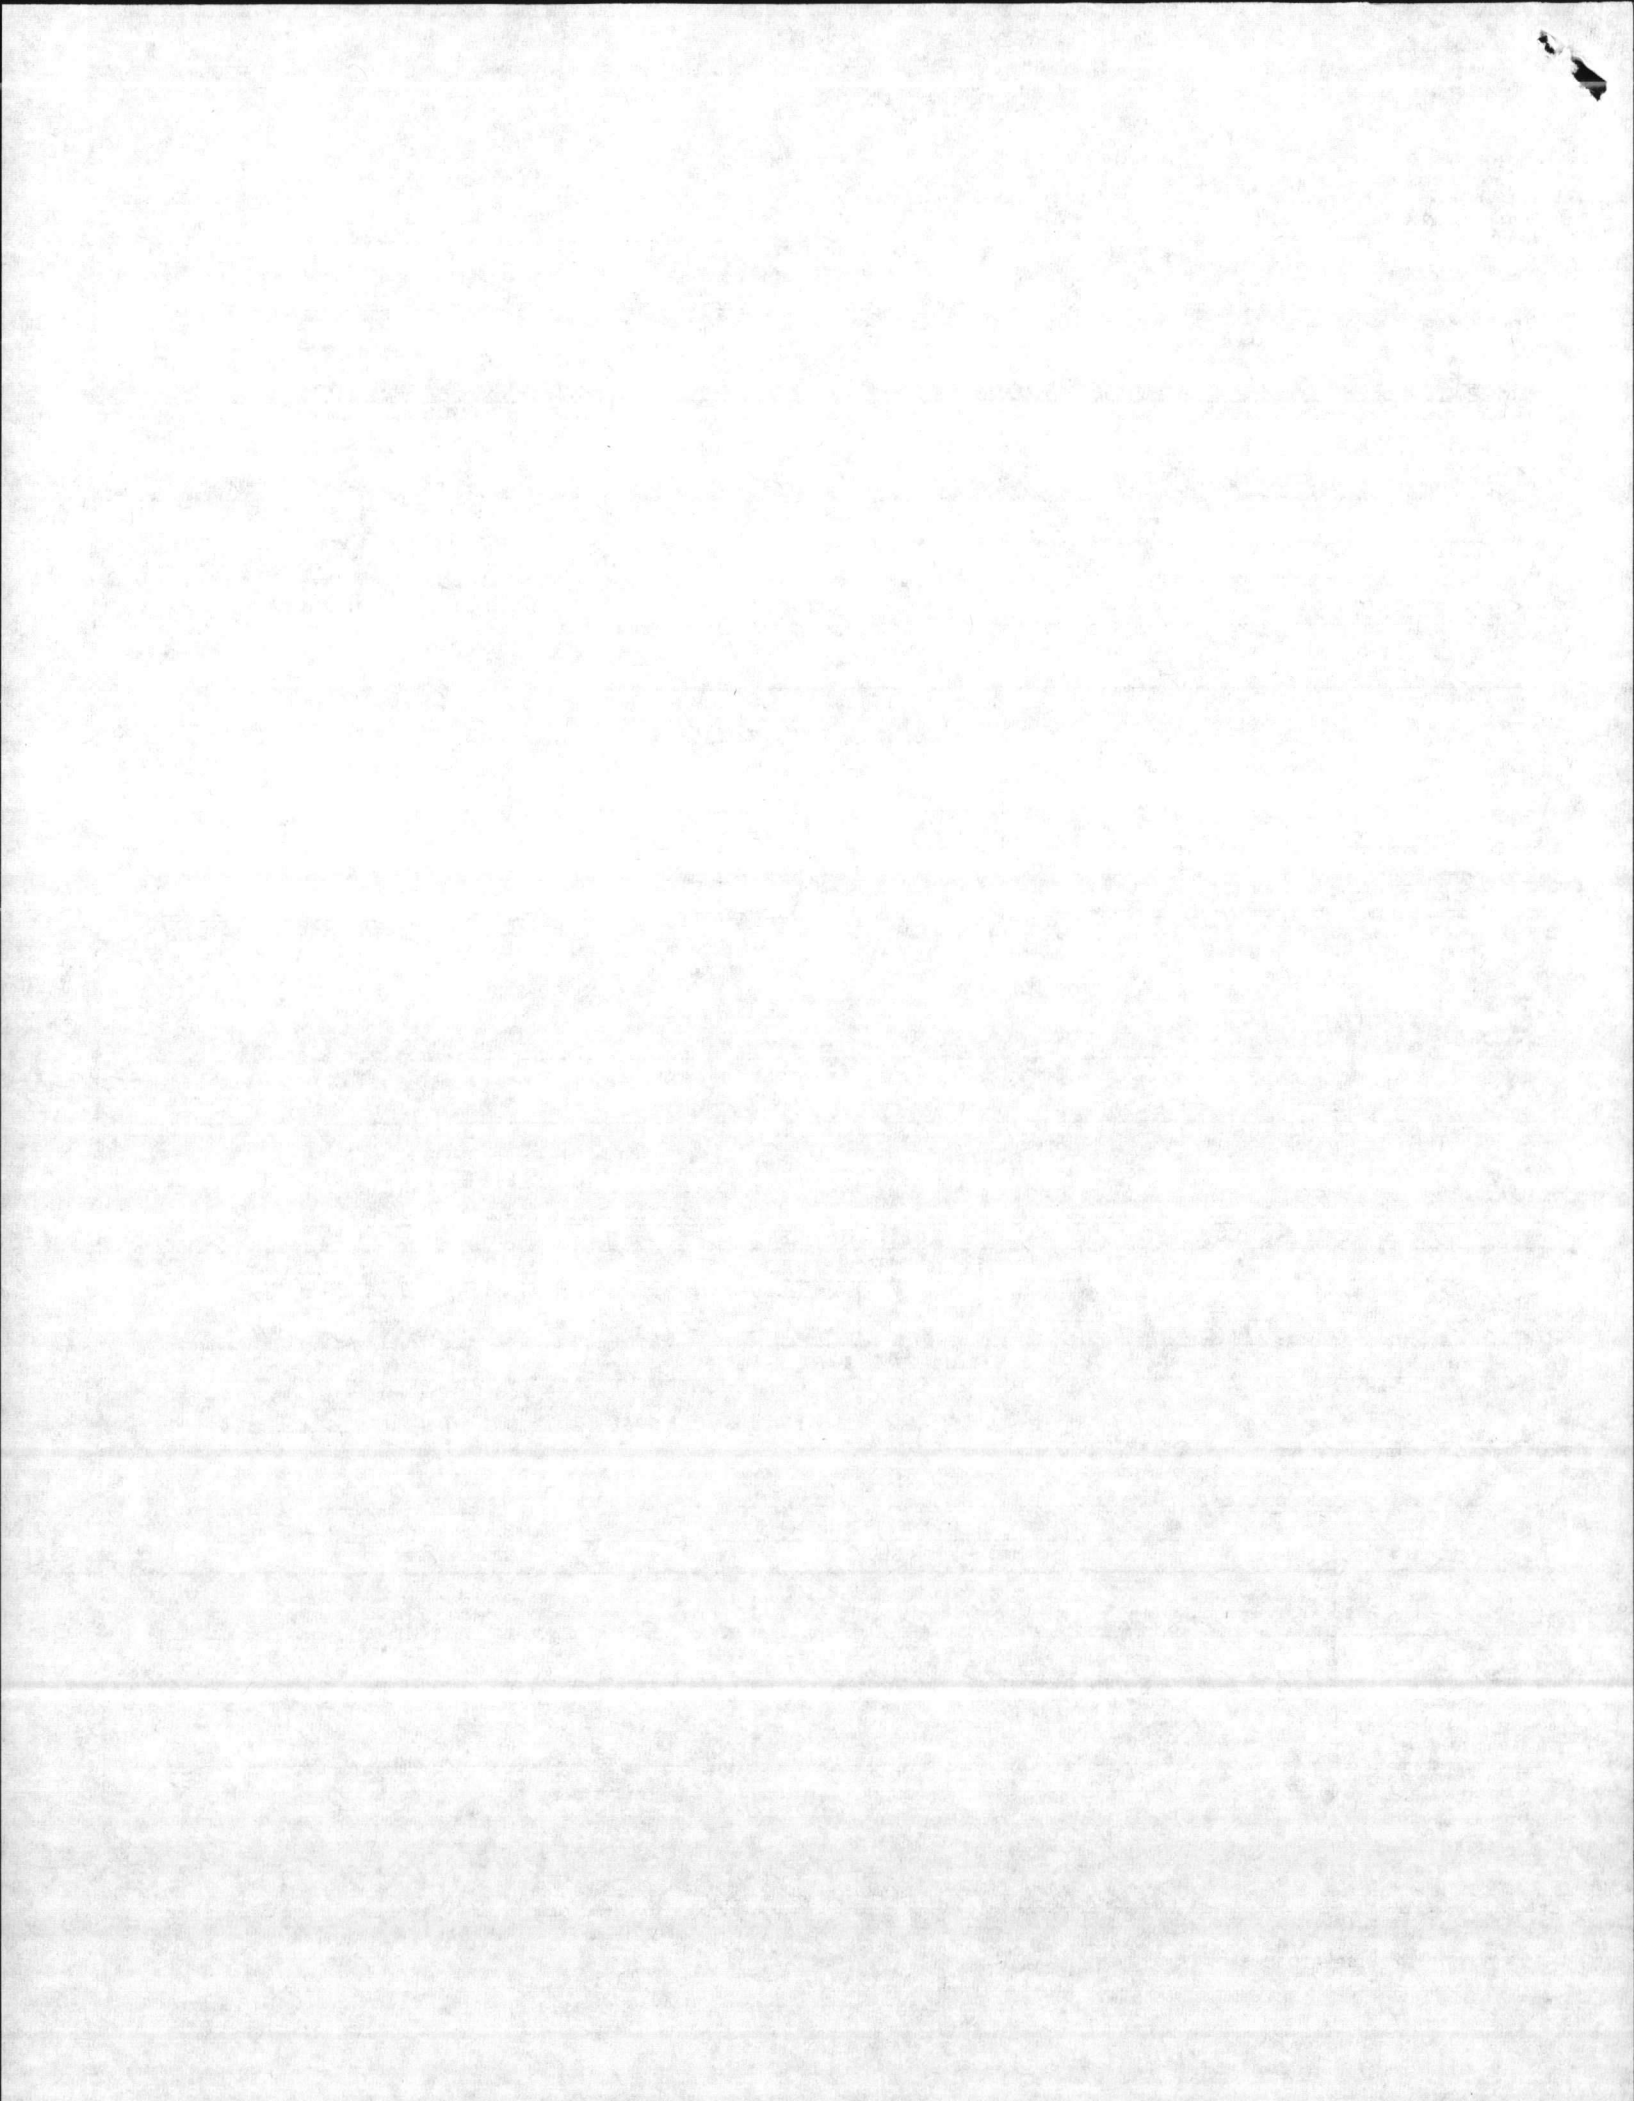

**INSPECTION REPORT-BOILERS**  
 NAVFAC 9-11014/41 (3/67)  
 Supersedes NAVDOCKS 2544  
 S/N 0105-LF-004-0000

DATE OF INSPECTION  
**29 JUNE 1978**

TYPE OF INSPECTION  
 A  INTERNAL & EXTERNAL    B  INTERNAL & EXTERNAL WITH PRESSURE TEST    C  OPERATIONAL

1. FROM  
**BASE MAINT. OFFICER CAMP LEJEUNE N.C.**

2. TO  
**COMMANDANT Hdqtrs MARINE CORPS (CODE LFF)**

14. CERTIFICATE ISSUED  YES  NO  
 EXPIRES **18 JAN 1979**

15. BOILER INSPECTOR  
**Jesse L. Sellers**  
 NAVY OR NATIONAL BOARD NO.

3. MANUFACTURER  
**FITZ GIBBONS**

16. REASON FOR NOT ISSUING CERTIFICATE  
**NAVFAC 225**

4. PROPERTY NO. **28**    5. MFG. SERIAL NO. **36464**    6. MFG. MODEL NO. **NA**

7. BUILDING NO. **TT 48**    8. YEAR BUILT **1959**    9. CAPACITY **1,000,000 BTU/HR**

10. FUEL (Check)  
 COAL     OIL     GAS

11. PRESSURE  
 DESIGNED **30** psi    OPERATING **12** psi    TEST **45** psi

12. FEED WATER TREATMENT  
 SATISFACTORY     UNSATISFACTORY

13. TYPE  
 WATER TUBE     FIRE TUBE     C. I.

17. BOILER USE  
**HEATING**

18. COMBUSTION CONTROL (Mfg. Name)  
**HONEYWELL**

19. COMBUSTION  
 \_\_\_\_\_ % CO<sub>2</sub>    \_\_\_\_\_ % EXCESS O<sub>2</sub>

20. FLUE GAS TEMPERATURE  
 AFTER BOILER \_\_\_\_\_ °F : AFTER HEAT TRAP \_\_\_\_\_ °F

**SAFETY DEVICES**  
**SAFETY VALVES**

21. MANUFACTURER **MCDONNELL MILLER**    22. NUMBER AND SIZE **1-1" 1-1/2"**    23. PSI SETTING **30**    24. CONDITION

**STEAM PRESSURE GAUGE**

25. MANUFACTURER **ASME STD.**    26. CORRECTIONS  
 WATER LEG CONSTANT \_\_\_\_\_ psi; OTHER \_\_\_\_\_ psi

27. REASON IF NOT TESTED


**FIRING EQUIPMENT**

ITEM	IN SERVICE	ALTERNATE
28. MANUFACTURER	<b>RADIANT</b>	<b>NONE</b>
29. TYPE	<b>NOZZLE SPRAY PRESS ATOM</b>	
30. FUEL GRADE	<b>#2</b>	

31. INSPECTOR'S COMMENTS

**OK**  
 32. ATTACHMENT(S) (Check)  
 COPY OF INSPECTOR'S REPORT     SPECIAL COMMENTS

33. SIGNATURE  
**R. M. Sellers**  
 BY DIRECTION

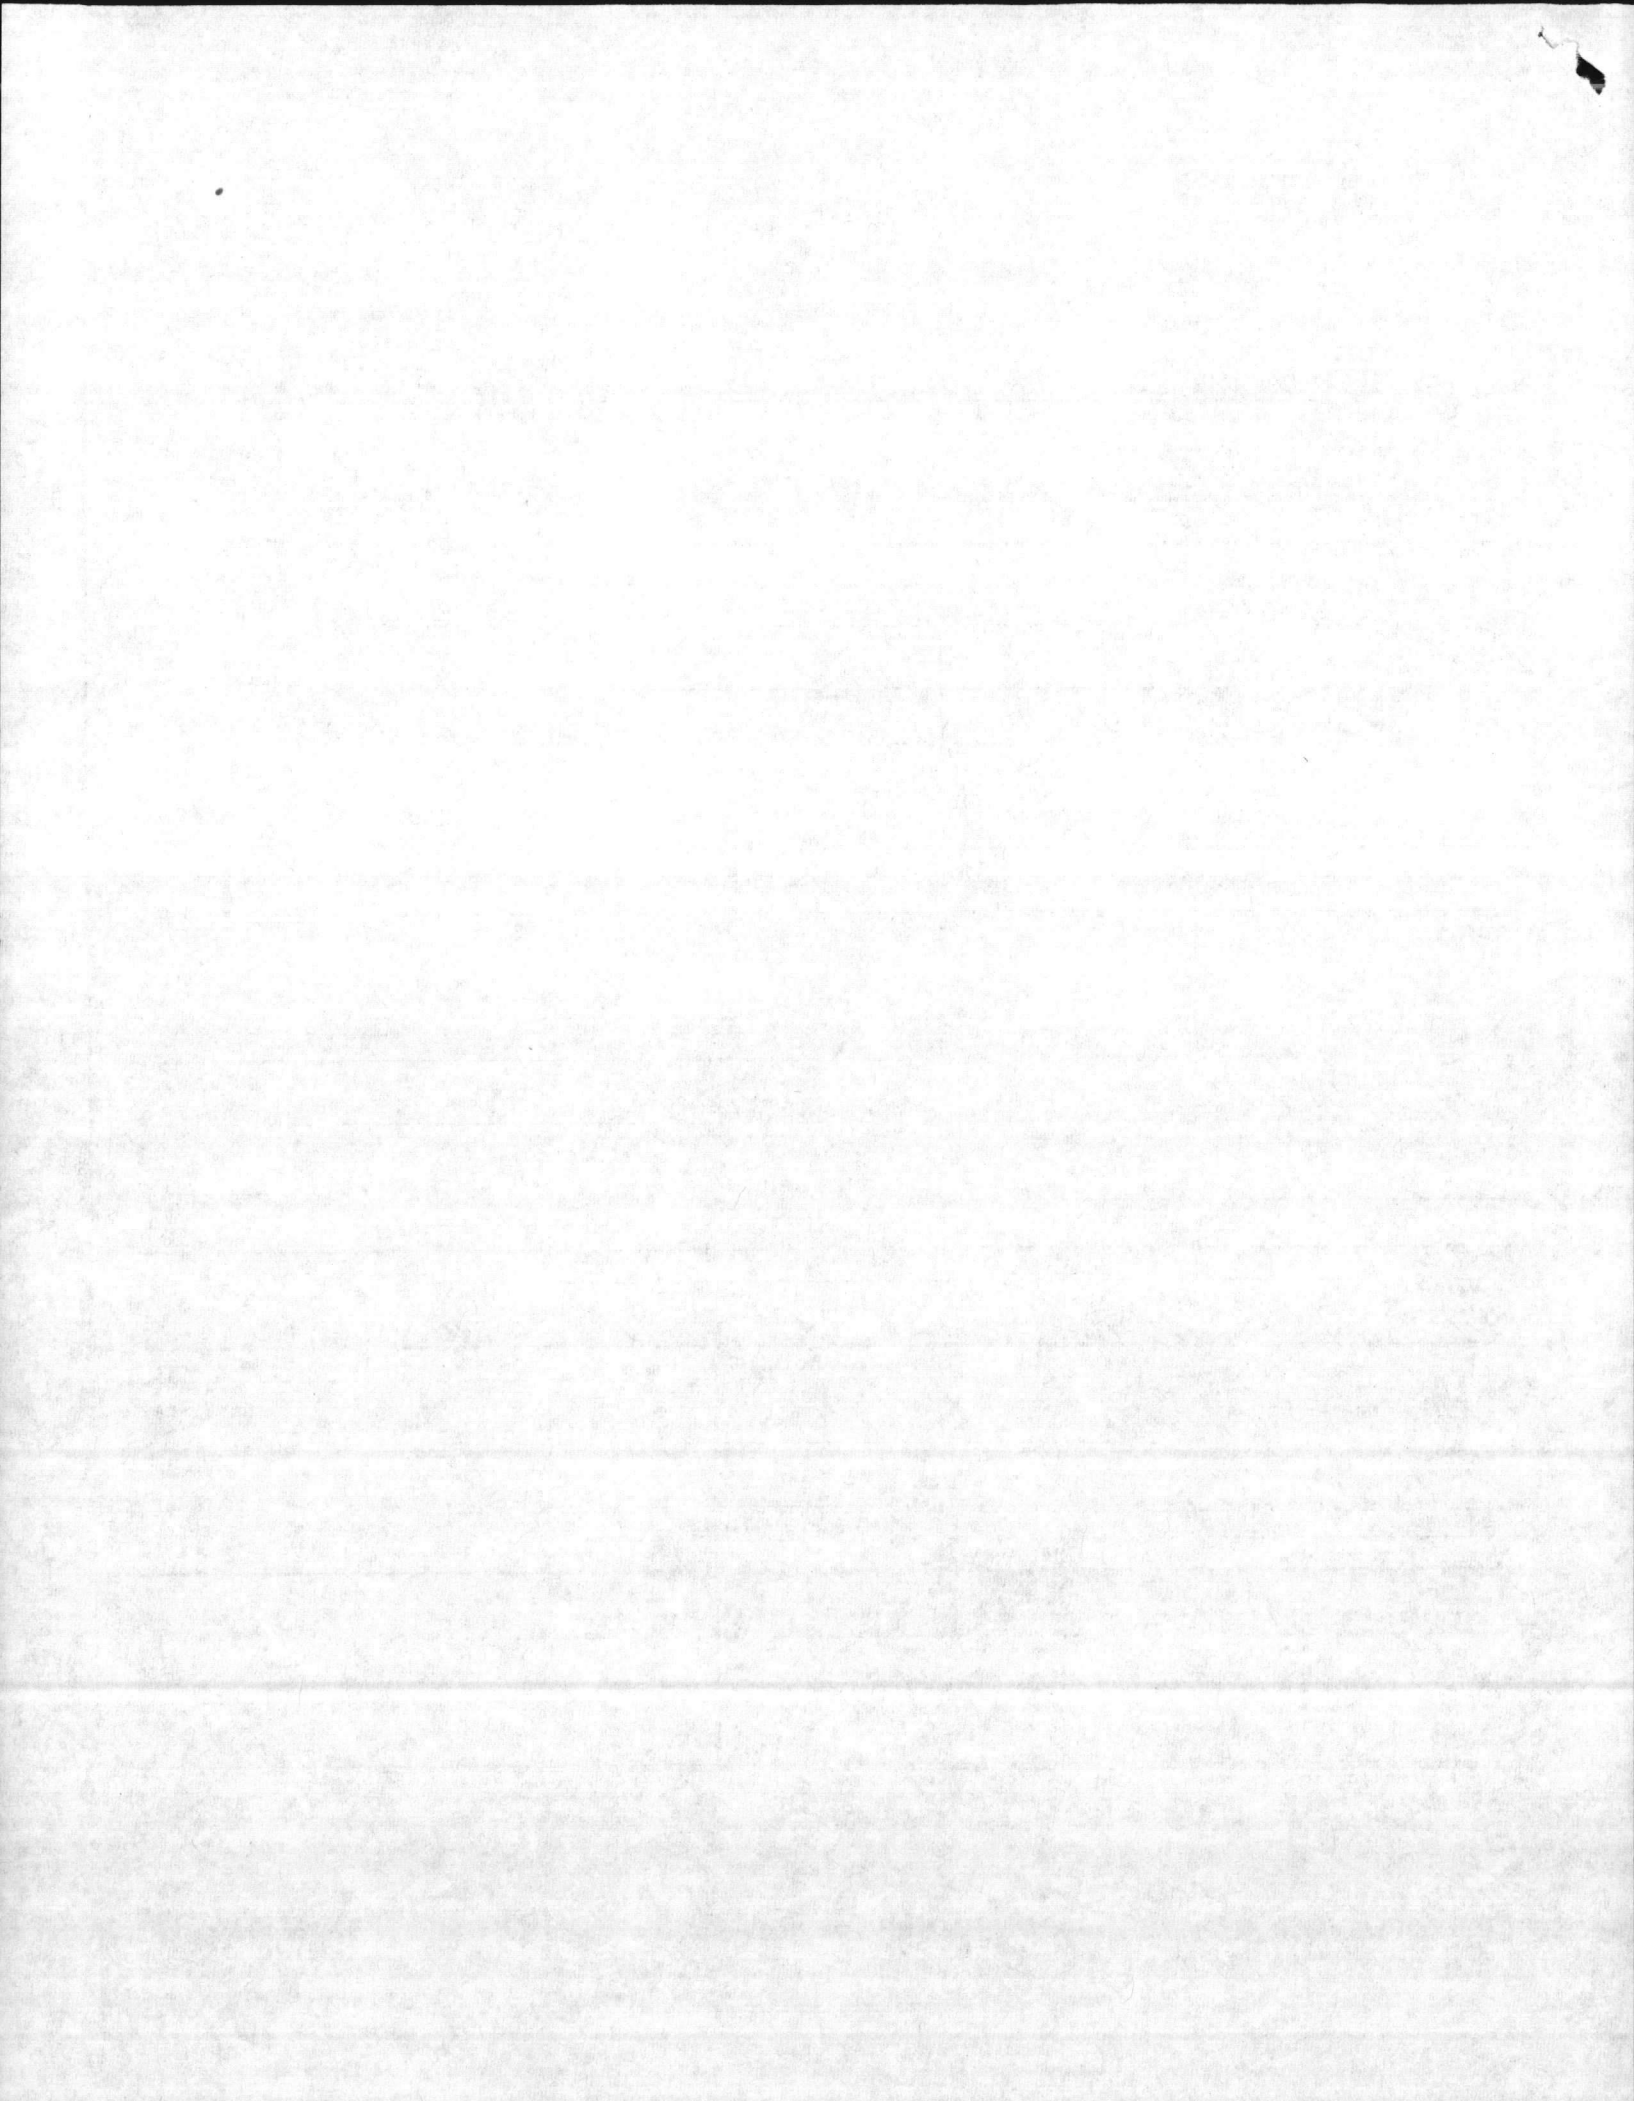

**INSPECTION REPORT-BOILERS**  
 NAVFAC 9-11014/41 (3/67)  
 Supersedes NAVDOCKS 2544  
 S/N 0105-004-0000

DATE OF INSPECTION  
 1-6-77

TYPE OF INSPECTION  
 A  INTERNAL & EXTERNAL B  INTERNAL & EXTERNAL WITH PRESSURE TEST C  OPERATIONAL

1. FROM  
 2. TO  
 Base Maint. Officer Camp Lejeune NC  
 Commandant Hydro Machine Coops (Codelist)

14. CERTIFICATE ISSUED  YES  NO  
 EXPIRES 5-4-77  
 15. BOILER INSPECTOR  
 E. B. McHenry  
 NAVY OR NATIONAL BOARD NC

**BOILER DATA**

3. MANUFACTURER  
 Fitzgibbons  
 4. PROPERTY NO. 28  
 5. MFG. SERIAL NO. 36464  
 6. MFG. MODEL NO. N.A.  
 7. BUILDING NO. II 48 - Wing 60  
 8. YEAR BUILT 1959  
 9. CAPACITY 1,000,000 BTU/HK  
 10. FUEL (Check)  
 COAL  OIL  GAS  
 11. PRESSURE  
 DESIGNED 30 psi OPERATING 12 psi TEST - psi  
 12. FEED WATER TREATMENT  
 SATISFACTORY  UNSATISFACTORY  
 13. TYPE  
 WATER TUBE  FIRE TUBE  C. I.

16. REASON FOR NOT ISSUING CERTIFICATE  
 NAV PFC 101

17. BOILER USE  
 Heating  
 19. COMBUSTION  
 65 % CO<sub>2</sub> % EXCESS O<sub>2</sub>

18. COMBUSTION CONTROL (Mfg. Name)  
 Honeywell  
 20. FLUE GAS TEMPERATURE  
 AFTER BOILER 300 °F ; AFTER HEAT TRAP °F

**SAFETY DEVICES**

SAFETY VALVES  
 21. MANUFACTURER MS Donnell Miller  
 22. NUMBER AND SIZE 1-1" 1 1/2"  
 23. PSI SETTING 30-36  
 24. CONDITION Good

**STEAM PRESSURE GAUGE**

25. MANUFACTURER A.S.M.E STD.  
 26. CORRECTIONS  
 WATER LEG CONSTANT psi; OTHER psi  
 27. REASON IF NOT TESTED

**FIRING EQUIPMENT**

ITEM	IN SERVICE	ALTERNATE
28. MANUFACTURER	Radiant	None
29. TYPE	Nozzle Spray Press Atom.	
30. FUEL GRADE	H.O.	

31. INSPECTOR'S COMMENTS  
 O.K.  
 32. ATTACHMENT(S) (Check)  
 COPY OF INSPECTOR'S REPORT  SPECIAL COMMENTS

33. SIGNATURE  
 Daniel L. White  
 BY DIRECTION





INSPECTION REPORT - BOILERS  
 NAVFAC 9-11014/41 (3/67)  
 Supersedes NAVDOCKS 2544  
 S/N 0105-004-0000

DATE OF INSPECTION  
 5-4-76 - 1:8-76

TYPE OF INSPECTION  
 A  INTERNAL & EXTERNAL B  INTERNAL & EXTERNAL WITH PRESSURE TEST C  OPERATIONAL

1. FROM  
 Base Maint Officer Camp Lejeune N.C.

2. TO  
 Commandant Hotel Marine Corps (Code HR)

14. CERTIFICATE ISSUED  YES  NO  
 Expires 11-12-76

15. BOILER INSPECTOR  
 E.O. Mabley  
 NAVY OR NATIONAL BOARD NO.  
 NAV FAC 101

BOILER DATA

3. MANUFACTURER  
 FITZGIBBONS

4. PROPERTY NO. 28	5. MFG. SERIAL NO. 36464	6. MFG. MODEL NO. N.A.
7. BUILDING NO. T 48-	8. YEAR BUILT 1959	9. CAPACITY 1,000,000 BTU/HR
10. FUEL (Check) <input type="checkbox"/> COAL <input checked="" type="checkbox"/> OIL <input type="checkbox"/> GAS		11. PRESSURE DESIGNED 30 psi OPERATING 12 psi TEST 45 psi
12. FEED WATER TREATMENT <input checked="" type="checkbox"/> SATISFACTORY <input type="checkbox"/> UNSATISFACTORY		13. TYPE <input type="checkbox"/> WATER TUBE <input checked="" type="checkbox"/> FIRE TUBE <input type="checkbox"/> C. I.

16. REASON FOR NOT ISSUING CERTIFICATE

17. BOILER USE  
 Heating

19. COMBUSTION  
 \_\_\_\_\_ % CO<sub>2</sub>      \_\_\_\_\_ % EXCESS O<sub>2</sub>

18. COMBUSTION CONTROL (Mfg. Name)  
 Honeywell

20. FLUE GAS TEMPERATURE  
 AFTER BOILER \_\_\_\_\_ °F ; AFTER HEAT TRAP \_\_\_\_\_ °F

SAFETY DEVICES  
 SAFETY VALVES

21. MANUFACTURER  
 Mc Donnell Miller

22. NUMBER AND SIZE  
 1-1" - 1-1/2"

23. PSI SETTING

24. CONDITION

STEAM PRESSURE GAUGE

25. MANUFACTURER  
 ASME STD.

26. CORRECTIONS  
 WATER LEG CONSTANT \_\_\_\_\_ psi; OTHER \_\_\_\_\_ psi

27. REASON IF NOT TESTED,

FIRING EQUIPMENT

ITEM	IN SERVICE	ALTERNATE
28. MANUFACTURER	Radiant	None
29. TYPE	Nozzle Spray Press. Atom.	
30. FUEL GRADE	#2	

31. INSPECTOR'S COMMENTS  
 O.K.

32. ATTACHMENT(S) (Check)  
 COPY OF INSPECTOR'S REPORT  SPECIAL COMMENTS

33. SIGNATURE  
 Dan White  
 BY DIRECTION

