
	D LANTDIV 4-4355/3 (Rev. 6/	CONTRACT NO.	TRANS	SMITTAL NO.	DATE	
FR	OM CONTRACTOR	81-C-1766. PROJECT TITLE AND LOCATION		86	May 22,	
TO	Trader Const	ruction Company Public Works				
	Lockwood Gree	ane/Six Associates MCB				
_	· Control September	CONTRACTOR USE ONLY	.0.			
		*List only one specification division per form.		REV	IEWER USE ONLY	
		ist only one of the following categories on each transmittal form, and indicate which is being submitted		**ACTION CODES A-Approved D-Disapproved		
NO.	PROJ. SPEC. SECT.	ontractor Approved OICC Approval Deviation/Substi			AN-Approved as noted RA-Receipt acknowledged. C-Comments	
ITEM N	& PARA. and/or PROJ. DWG. NO. *	(Type, size, model no., Mfg. name, dwg. or brochure number)	NO. OF	ACTION CODES	REVIEWER'S INITIALS	
52	10801	Metal Toilet & Bath Accessories	ZÖ	**	CODE AND DATE	
+		Gatalog Data: Stainless Steel Frame Mirrow	7	AN/C	A.B. a.	
		Surface Mted. S.S. Paper towel dispenser	7	A	The state of the s	
1		Grab Bar	7	A		
		Stainless Steel Shelf	7	A		
CONTRA	ACTOR'S COMMENTS	Surface Mounted Toilet Tissue Holder	7	Ä	1:01	
OPY OF	TRANSMITTAL AND SUBMIT	Surface Mounted Toilet Tissue Holder TALS TO ROICE	7	A A	Tiel V	
OPY OF	TRANSMITTAL AND SUBMIT	Surface Mounted Toilet Tissue Holder TALS TO ROICE	7	A A	Tiel V	
OPY OF	TRANSMITTAL AND SUBMIT	Surface Mounted Toilet Tissue Holder TALS TO ROICC CONTRACTOR REPRESENTATIVE (Sign Time, N.C. Dale Sign	7	A A spen	Tiel V	
OPY OF	TRANSMITTAL AND SUBMIT	Surface Mounted Toilet Tissue Holder TALS TO ROICC CONTRACTOR REPRESENTATIVE (Sign THE N.C. FROM (Reviewer) TO	7 Consture)	nop		
OPY OF	TRANSMITTAL AND SUBMIT	Surface Mounted Toilet Tissue Holder TALS TO ROICC CONTRACTOR REPRESENTATIVE (Sign THE N.C. FROM (Reviewer) TO	7 Consture)	nop		
OPY OF	TRANSMITTAL AND SUBMITTAL AND	Surface Mounted Toilet Tissue Holder TALS TO ROICC CONTRACTOR REPRESENTATIVE (Significance) FROM (Reviewer) FROM (Reviewer) To Six Associates, Inc. Trad th action indicated. Approval of an item does not include approval of any deviation for supports the deviation.	nature) er Co	nstructi	ion Co.	
OPY OF ROY ATE RE Tra	TRANSMITTAL AND SUBMITTAL AND	Surface Mounted Toilet Tissue Holder TALS TO ROICC CONTRACTOR REPRESENTATIVE (Significance) FROM (Reviewer) FROM (Reviewer) To Six Associates, Inc. Trad th action indicated. Approval of an item does not include approval of any deviation for supports the deviation.	nature) er Co	nstructi	ion Co.	
OPY OF ROY ATE RE Tra	TRANSMITTAL AND SUBMITTAL AND	Surface Mounted Toilet Tissue Holder TALS TO ROICC CONTRACTOR REPRESENTATIVE (Sign THE N.C. FROM (Reviewer) TO	nature) er Co	nstructi	ion Co.	
Su tra	TRANSMITTAL AND SUBMITTAL AND	TALS TO ROICC CONTRACTOR REPRESENTATIVE (Sign Time. N.C. FROM (Reviewer) Six Associates. Inc. Trad th action indicated. Approval of an item does not include approval of any deviation from the supports the deviation. O LANTDIV with A-E recommendations indicated in REVIEWER USE ONLY Section	er Co	nstructi	ion Co.	
SI STATE RE	TRANSMITTAL AND SUBMITTAL AND	Surface Mounted Toilet Tissue Holder TALS TO ROICC CONTRACTOR REPRESENTATIVE (Significance) FROM (Reviewer) FROM (Reviewer) To Six Associates, Inc. Trad th action indicated. Approval of an item does not include approval of any deviation for supports the deviation.	er Co	nstructi	ion Co.	
SI STATE RE	TRANSMITTAL AND SUBMITTAL AND	Surface Mounted Toilet Tissue Holder TALS TO ROICE CONTRACTOR REPRESENTATIVE (Sign Time, N.C. FROM (Reviewer) Six Associates, Inc. Trad th action indicated. Approval of an item does not include approval of any deviation for a supports the deviation. o LANTDIV with A-E recommendations indicated in REVIEWER USE ONLY Section comply with specifications regarding coved both	er Co	nstructi	ion Co.	
Street Sh	TRANSMITTAL AND SUBMITTAL AND	Surface Mounted Toilet Tissue Holder TALS TO ROICE CONTRACTOR REPRESENTATIVE (Sign Time, N.C. FROM (Reviewer) Six Associates, Inc. Trad th action indicated. Approval of an item does not include approval of any deviation for a supports the deviation. o LANTDIV with A-E recommendations indicated in REVIEWER USE ONLY Section comply with specifications regarding coved both	er Co	nstructi	ion Co.	
SI STATE RE	TRANSMITTAL AND SUBMITTAL AND	Surface Mounted Toilet Tissue Holder TALS TO ROICE CONTRACTOR REPRESENTATIVE (Sign Time, N.C. FROM (Reviewer) Six Associates, Inc. Trad th action indicated. Approval of an item does not include approval of any deviation for a supports the deviation. o LANTDIV with A-E recommendations indicated in REVIEWER USE ONLY Section comply with specifications regarding coved both	er Co	nstructi	ion Co.	

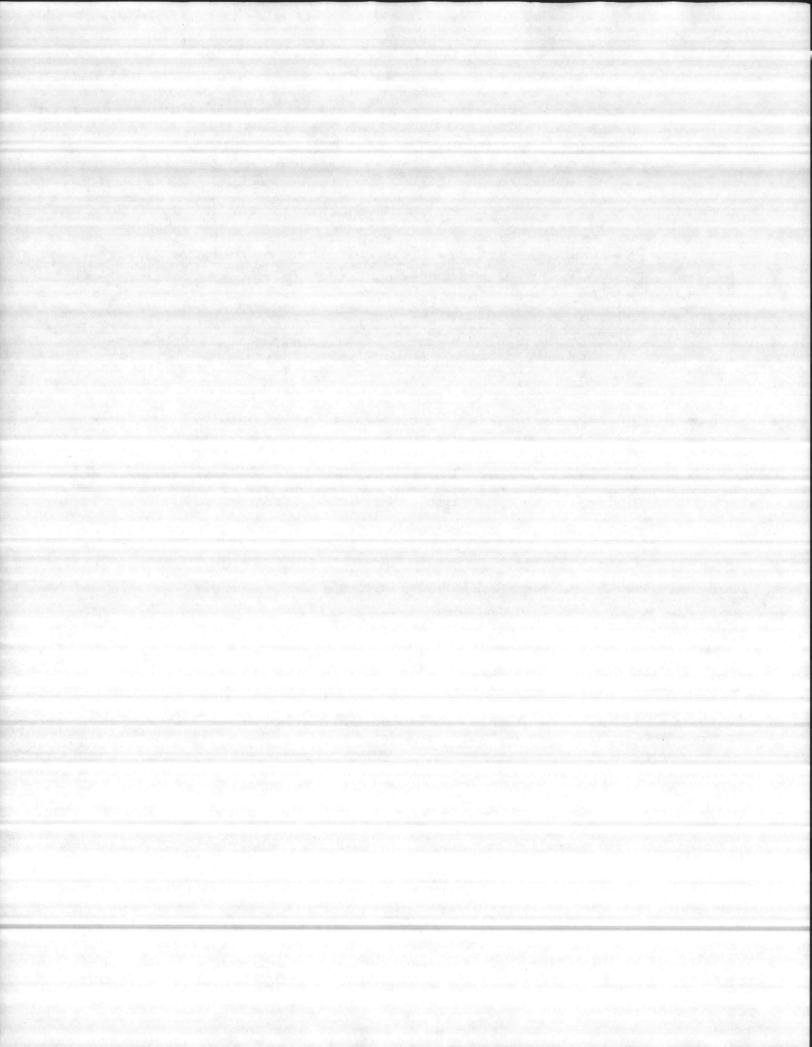

Page 2 of 3 CONTRACTOR'S SUBMITTAL TRANSMITTAL 5ND LANTDIV 4-4355/3 (Rev. 6/76) CONTRACT NO. TRANSMITTAL NO. 81-C-1766 May 22, 1984 FROM CONTRACTOR PROJECT TITLE AND LOCATION PUBLIC WORKS Trader Construction Company MCB Lockwood Greene/Six Associates Camp Lejeunes N. C. CONTRACTOR USE ONLY REVIEWER USE ONLY *List only one specification division per form. **ACTION CODES A-Approved List only one of the following categories on each transmittal form, D-Disapproved and indicate which is being submitted AN-Approved as noted Contractor Approved RA-Receipt acknowledged. OICC Approval Deviation/Substitution C-Comments For OICC Approval R-Resubmit PROJ. SPEC. SECT. NO. OF COPIES ITEM IDENTIFICATION ACTION & PARA. and/or REVIEWER'S (Type, size, model no., Mfg. name, dwg. or CODES PROJ. DWG. NO. INITIALS brochure number) CODE AND DATE 10801 152 (continued) Gatalog Data: Recessed paper towel dispenser Napkin Tampon Dispenser Sanitary napkin disposal and shelf 7 Double Robe hook Powder soap dispenser CONTRACTOR'S COMMENTS COPY OF TRANSMITTAL AND SUBMITTALS TO ROICC CONTRACTOR REPRESENTATIVE (Signature) ROICC, Camp Lejeune, N.C. DATE RECEIVED BY REVIEWER FROM (Reviewer) 5/24/84 Six Associates, Inc. Trader Construction Co. Submittals are returned with action indicated. Approval of an item does not include approval of any deviation from the contract requirements unless the contractor calls attention to and supports the deviation. Submittals are forwarded to LANTDIV with A-E recommendations indicated in REVIEWER USE ONLY Section and in comments below on ONE COPY of the REVIEWER'S COMMENTS See Reviewer's Comments on Page 1 of 3


COPIES TO: ROICC (2) LANTDIV (1) A-E (1)

DATE


6/4/84

SIGNATURE

4.10

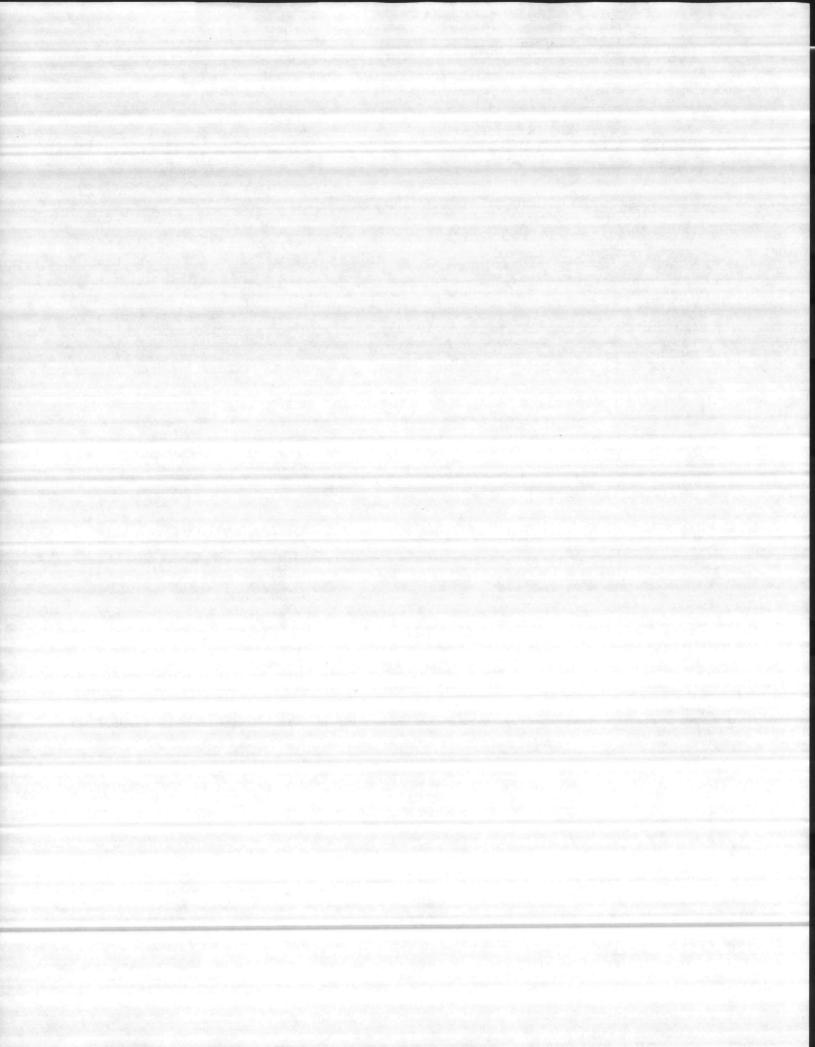


ND L	NTRACTOR'S	6)	CONTRACT NO.					
			CONTINUE NO.		TRANSM	MITTAL NO.	DATE	
ROM	CONTRACTOR		PROJECT TITLE AND LO	00471011	86		May 22, 1	
1	Trader Const	ruction Company						
0		a acaroa dompany	Public Work	S				
	Lockwood Gre	ene/Six Associates	Camp Lejeun	. W	,			
19	or an arrange of the state of t	CONTRACTOR USE ONLY	Comp ne eur	15, 11,	3 2	l ====	Park Alexander	
		*List only one specification division p	er form.		170		ACTION CODES	
	L	ist only one of the following categories on each	h			A-Appr	roved	
		and indicate which is being subm	itted			D-Disa	pproved	
] a	Contractor Approved	OICC Approval	П-				AN-Approved as noted RA-Receipt acknowledged.	
		CICC Approval		ion/Substit		C-Comments R-Resubmit		
	PROJ. SPEC. SECT.	ITEM IDENTIFIC		Oloo App				
	& PARA. and/or PROJ. DWG. NO. *	(Type, size, model no., Mi	g. name, dwg. or		NO. OF COPIES	CODES	REVIEWER'S INITIALS	
+		brochure num	iber)		N O	**	CODE AND DATE	
3	10803	(continued) Cotolor De			5 43	Service Tolk		
1	20002	(continued) Catalog Da	UE.				1	
		Shower curtain rods & fl	angeg		LA.	A	1.2.11	
		make we will be the think it out to be a first	riiges		7	11	712-14W	
6.		Mon Rack			7	A		
					-	1		
		Pail or Ladder Hook		1	7	A		
						1	The second secon	
1000	A STATE OF THE PARTY OF THE PAR	***				1		
		Vacuum hose bracket			7	16		
TRA	CTOR'S COMMENTS	Vacuum hose bracket Tilted mirrow for wheel of Surface mounted ash urn	chair		7 7 7	A	- (
ITRA	CTOR'S COMMENTS	Tilted mirrow for wheel	hair		1	A		
		Tilted mirrow for wheel of Surface mounted agh urn			7 7	A		
	CTOR'S COMMENTS TRANSMITTAL AND SUBM	Tilted mirrow for wheel of Surface mounted agh urn	CONTRACTOR REPRESENT		7 7	A		
OF		Tilted mirrow for wheel of Surface mounted ash urn	CONTRACTOR REPRESENT	Ata	7 7	A	7	
OF	TRANSMITTAL AND SUBM	Tilted mirrow for wheel of Surface mounted sah urn IITTALS TO ROICC FROM (Reviewer)	CONTRACTOR REPRESENT	I To	nature)	A	,	
OF	TRANSMITTAL AND SUBM	Tilted mirrow for wheel of Sunface mounted ash urn WITTALS TO ROICC TO N. C. FROM (Reviewer) Six Associates.	CONTRACTOR REPRESENT	Trad	nature)	Ponstruct	ion Co.	
OF REC Su tra	TRANSMITTAL AND SUBM CEIVED BY REVIEWER 5/24/8/4 Job mittals are returned vactor calls attention to	Tilted mirrow for wheel of Surface mounted sah urn IITTALS TO ROICC FROM (Reviewer)	CONTRACTOR REPRESENT	Trade	nature) er Cg	contract requi	irements unless the con-	
OF REC Su tra	TRANSMITTAL AND SUBMITTAL AND	Tilted mirrow for wheel of Surface mounted ash urn MITTALS TO ROICC FROM (Reviewer) Six Associates with action indicated. Approval of an item does reand supports the deviation. It to LANTDIV with A-E recommendations indicated.	Inc. Inc. Include approval of any outled in REVIEWER USE ONL	Trade	nature) er Cg	contract requi	irements unless the con	
OF REC Su tra Su tra	TRANSMITTAL AND SUBMITTAL AND	Tilted mirrow for wheel of Symface mounted ash urn WITTALS TO ROICC FROM (Reviewer) Six Associates, with action indicated. Approval of an item does rand supports the deviation.	Inc. Inc. Include approval of any outled in REVIEWER USE ONL	Trade	nature) er Cg	contract requi	irements unless the con	
OF REC Su tra	TRANSMITTAL AND SUBMITTAL AND	Tilted mirrow for wheel of Surface mounted ash urn MITTALS TO ROICC FROM (Reviewer) Six Associates with action indicated. Approval of an item does reand supports the deviation. It to LANTDIV with A-E recommendations indicated.	Inc. Inc. Include approval of any outled in REVIEWER USE ONL	Trade	nature) er Cg	contract requi	irements unless the con	
OF REC Su tra Su tra	TRANSMITTAL AND SUBMITTAL AND	Tilted mirrow for wheel of Surface mounted ash urn MITTALS TO ROICC FROM (Reviewer) Six Associates with action indicated. Approval of an item does reand supports the deviation. It to LANTDIV with A-E recommendations indicated.	Inc. Inc. Include approval of any outled in REVIEWER USE ONL	Trade	nature) er Cg	contract requi	irements unless the con-	
OF REC Su tra Su tra	TRANSMITTAL AND SUBMITTAL AND	Tilted mirrow for wheel of Surface mounted ash urn MITTALS TO ROICC FROM (Reviewer) Six Associates with action indicated. Approval of an item does reand supports the deviation. It to LANTDIV with A-E recommendations indicated.	Inc. Inc. Include approval of any outled in REVIEWER USE ONL	Trade	nature) er Cg	contract requi	ow on ONE COPY of the	
OF REC Su tra	TRANSMITTAL AND SUBMITTAL AND	Tilted mirrow for wheel of Surface mounted ash urn MITTALS TO ROICC FROM (Reviewer) Six Associates with action indicated. Approval of an item does reand supports the deviation. It to LANTDIV with A-E recommendations indicated.	Inc. Inc. Include approval of any outled in REVIEWER USE ONL	Trade	rature) er CG rom the c	contract requi	irements unless the con	
Su tra	TRANSMITTAL AND SUBM CEIVED BY REVIEWER 5/24/84 Ubmittals are returned vactor calls attention to ubmittals are forwarded insmittal form. 'S COMMENTS ee Reviewer	Tilted mirrow for wheel of Surface mounted ash urn WITTALS TO ROICC FROM (Reviewer) Six Associates, with action indicated. Approval of an item does rand supports the deviation. d to LANTDIV with A-E recommendations indicates. Six Comments on Page 1 of 3.	Inc. Inc. Include approval of any outled in REVIEWER USE ONL	Trade	nature) er Cg	contract requi	ow on ONE COPY of the	
Su tra	TRANSMITTAL AND SUBM CEIVED BY REVIEWER 5/24/8/4 Jabmittals are returned vactor calls attention to abmittals are forwarded insmittal form. TS COMMENTS REVIEWER 1. To 1.	Tilted mirrow for wheel of Surface mounted ash urn MITTALS TO ROICC FROM (Reviewer) Six Associates with action indicated. Approval of an item does reand supports the deviation. It to LANTDIV with A-E recommendations indicated.	Inc. Inc. Include approval of any outled in REVIEWER USE ONL	Trade	and in c	contract requi	ow on ONE COPY of the	

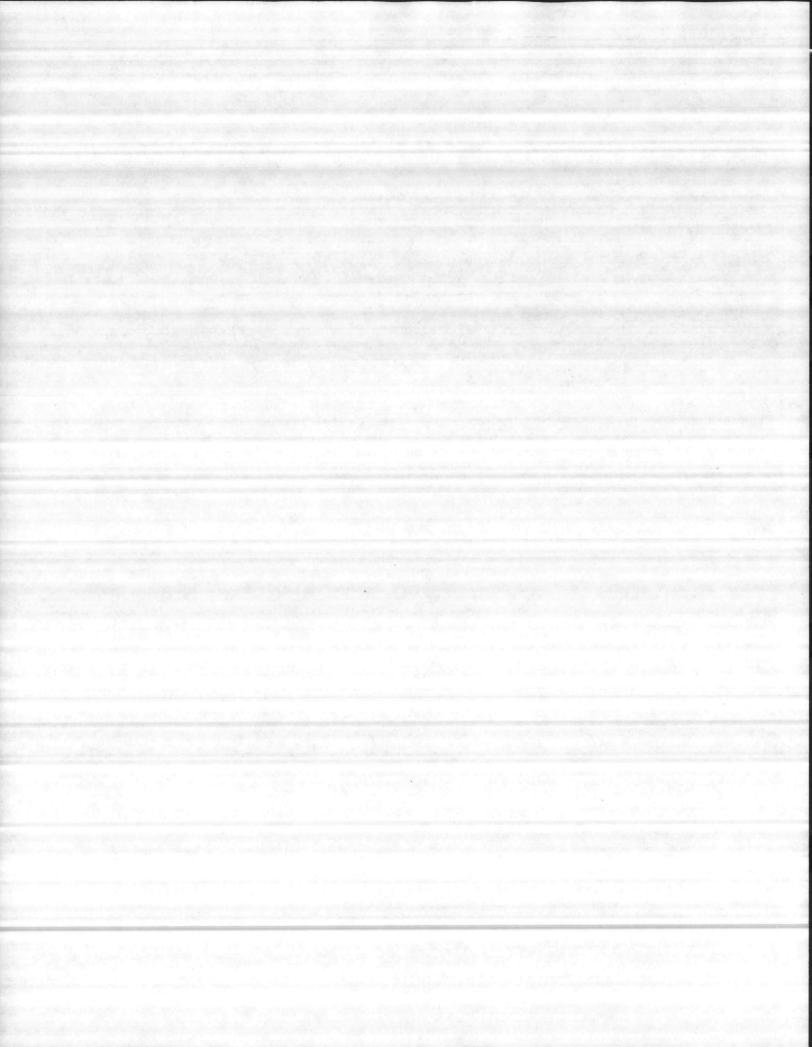

STAINLESS STEEL CHANNEL FRAME MIRROR W/SHELF

06256

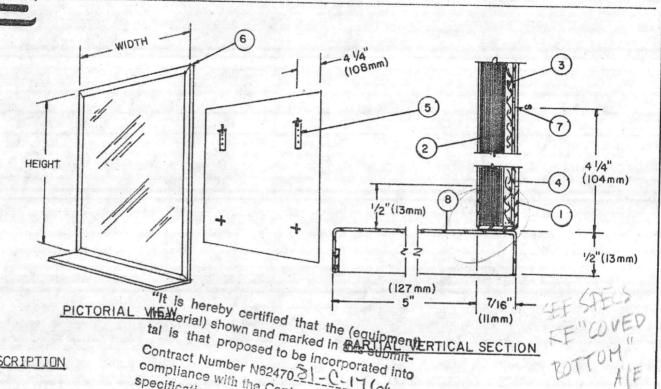

DESCRIPTION

Contract Number N62470 21-C-17 (c) The Compliance with the Contract draws as SPRING TENSION LOCKING DEVICE compliance with the Contract drawings SPRING ILLIP

Specification with the Contract drawings SPRING TENSION LUCI 1. 20 GAUGE STAINLESS STEEL PRAMED be installed in the all Cocking CLIP

I'm attended to the all Cocking CLIP

STAINLESS

STAINLESS 2. 1/4" PLATE GLASS MIRRORS, and is submitted in the all Deking CLIP

3. non absorbent filleral.

4. 22 GAUGE STEEL PATHIEDROP BACK STEEL SHELF

5-22-84 SPECIFICATIONS FRAME FACE - FRAME IS FABRICATED OF-20 GAUGE TYPE 304L, 18-8 ALLOY STAINLESS STEEL WITH CORNER MITRED AND POLISHED. ENTIRE FRAME IS POLISHED TO A NO. 4 SATIN FINISH PROTECTED BY A POLYVINYL COATING (PVC) EASILY REMOVED AFTER INSTALLATION. ALL EDGES ARE ROUNDED AND POLISHED SMOOTH. BACK PLATE IS FABRICATED OF NO. 22 GAUGE CORROSION RESISTANT PAINT-LOK STEEL COATED WITH ZINC BY ELECTROLYTIC DEPOSITION, ONE PIECE AND DIE CUT TO FIT FRAME. BACK PLATE IS SUPPLIED WITH CROSS TYPE SLOTS PROVIDED FOR MOUNTING AND A MINIMUM OF TWO SPRING TENSIONED LOCKING DEVICES IN SLOTS. SHELF - 20 GA.STAINLESS STEEL

GLAZING - THE NO. 625 FRAME IS AVAILABLE WITH THE FOLLOWING GLAZING SURFACES:


- A. PLATE GLASS IS 1/4" (6MM) QUALITY POLISHED PLATE GLASS, SILVER COATED AND HERMETICALLY SEALED. MIRRORS MEET GOVERNMENT SPECIFICATIONS NO. DD-G-451, AND ARE GUARANTEED FOR 15 YEARS AGAINST SILVER SPOILAGE.
- B. TEMPERED GLASS IS 1/4" (6MM) THICK POLISHED TEMPERED GLASS WITH TWO COATS OF SILVER, PROPERLY APPLIED. THE COVERING IS HERMETICALLY SEALED BY ELECTROPLATING WITH A HEAVY UNIFORM COATING OF COPPER. BACK OF MIRROR IS FINISHED AND PROTECTED WITH A THICK COAT OF HEAVY WATERPROOF PAINT. (FED. SPEC. DD-G-1403B, AMEND. !)

C. METAL MIRRORS - ARE STAINLESS STEEL POLISHED TO A MIRROR FINISH.

INSTALLATION -

SURFACE MOUNTED AND SECURED TO WALL BY MEANS OF THE FOUR REAR WALL CROSS SLOTS AND SCREWS FURNISHED BY MANUFACTURER. THEFT-PROOF IS AUTOMATIC UPON COMPLETION. MOUNTING SUGGESTIONS - FOR 20" (508MM) AND 24" (610MM) HIGH MIRRORS, 48" (1220MM) FROM FINISHED LOOR TO BOTTOM OF MIRROR FRAME.


MIRRORS IN EXCESS OF 97" (2464MM) WIDE ARE FABRICATED IN TWO OR MORE SECTIONS.

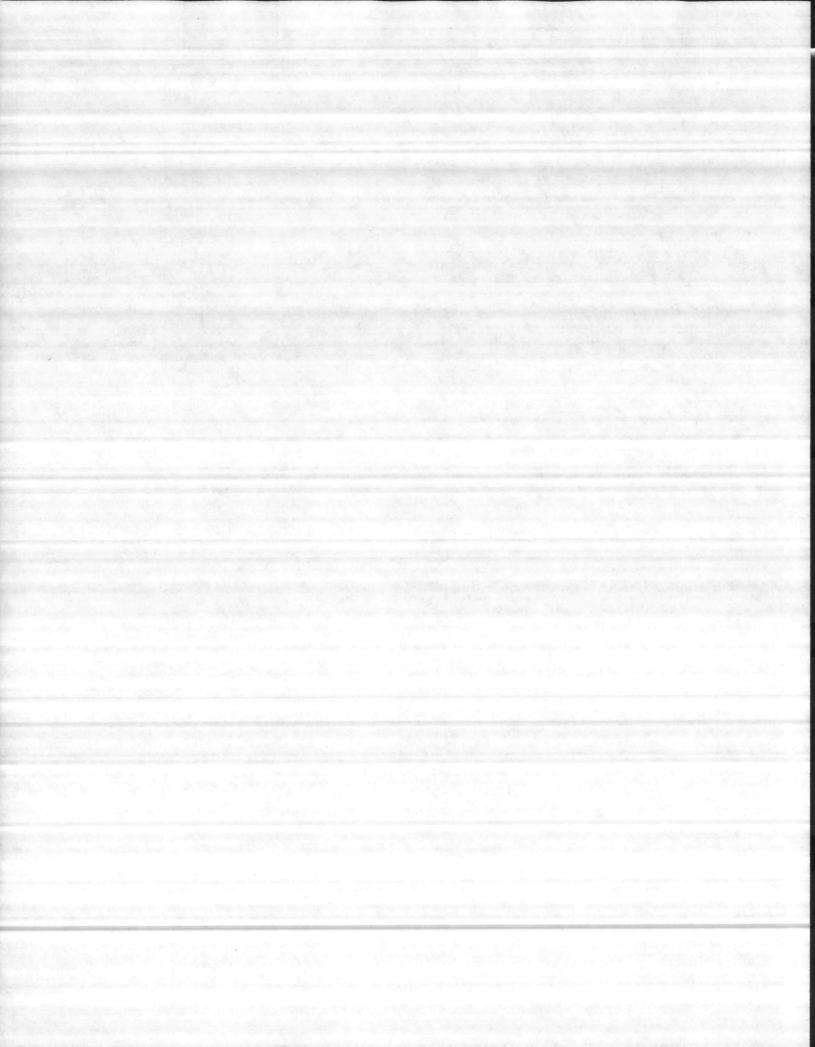



SURFACE MOUNTED STAINLESS STEEL PAPER TOWEL DISPENSER

0210/0230

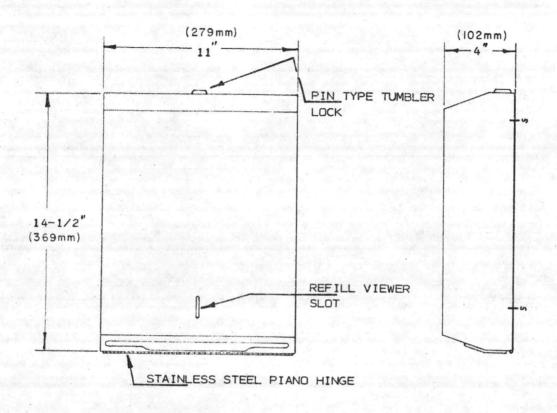

SPECIFICATION -

PAPER TOWEL DISPENSER IS FABRICATED OF NO. 20 GAUGE TYPE 304L, 18-8 ALLOY STAINLESS STEEL WITH A NO. 4 SATIN FINISH PROTECTED BY A POLYVINYL COATING (PVC) EASILY REMOVED AFTER INSTALLATION. DOOR IS PIVOTED FROM LOWER PORTION OF CABINET AND HELD CLOSED BY MEANS OF A PIN TYPE TUMBLER LOCK. DOOR IS ALSO PROVIDED WITH REFILL VIEWER SLOT.

CAPACITY - 500 MULTI FOLD OR 400 C-FOLD PAPER TOWELS

INSTALLATION - UNIT IS SUPPLIED WITH WOOD SCREWS FOR MOUNTING THROUGH SLOTS PROVIDED IN REAR OF CABINET FURNISHED BY MANUFACTURER.

"It is hereby certified that the (equipment)

(material) shown and maker in issessemit
(1270 mm)

(1270 mm)

("It is hereby certified that the (equipment)


(material) shown and maker in issessemit
(1270 mm)

Contract Number 1/20 mm 6)


Contract Number N62470 81-0 17 (2,4s in compliance with the Contract drawings and specifications, can be installed in the allocated spaces, and is submitted Government

Certified by D.S.

Date ____5-22.84

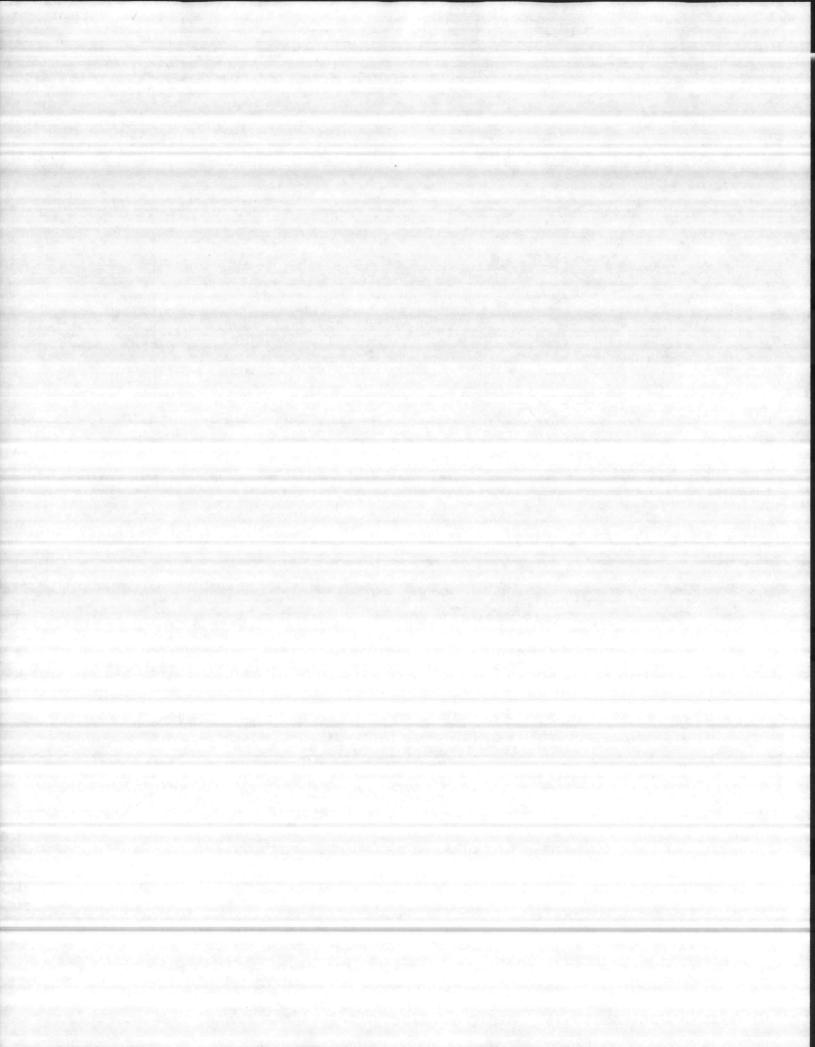


NAVAL FACILITIES ENGINEERING COMMAND NORFOLK, VIRGINIA 23511 APPROVED APPROVED APPROVED APPROVED SUBJECT TO THE REQUIREMENTS OF CONTRACT NO ACLEY TO A SUBMITIAL DOES NOT INCLUDE APPROVAL OF A SUBMITIAL DOES NOT INCLUDE APPROVAL OF ANY DEVIDITION FROM FHE CONTRACT REQUIREMENTS OF CALLS ATTENTION TO AND SOPPORTS THE CONTRACT STALL BE FESPONSIBLE FOR PROVIDING PROPIER PHYSICAL DIMENSIONS OPTIONS APPROVAL OF ANY DEVIDITION FROM FHE CONTRACT STALL BE FESPONSIBLE FOR PROVIDING PROPIER PHYSICAL DIMENSIONS OPTIONS APPROVAL OF ANY DEVIDENCE OF TRADES, FIC., AS REQUIRED. K - KNURWLEWER ATEL TO AND SOPPORT PHYSICAL DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (32mm) TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE HELITARC WELL TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICAT OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINI INSTALLATION - PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE W LOCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WIT ELONGATED SLOT FOR 3/B". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE IS MOUNTED TO WALL. FLANCES FOR FITTED OVER TENON PLATE AND INSTALLATION IS COMPLETED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE AS MOUNTED TO WALL. FLANCES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	DRY SPECIALTIES, INC.
NAVAL FACILITIES ENGINEERING COMMAND NORFOLK, VIRGINIA 23511 APPROVED APPROVED APPROVED APPROVED SUBJECT TO THE REQUIREMENTS OF CONTRACT NO MOLUTO FLOW THE CONTRACT NO MOLUTO FOR THE CONTRACT NO MOLUTO FOR THE CONTRACT NO MOLUTO FOR THE CONTRACT NO FAILESS SET NAME OF CASE HARDENED SHALL BE STAINLESS STEEL ALEN HEAD SET SCREWS. FLANCES (AND CENTER FLANCES CONTRACT NO FAILESS THE CONTRACT NO FAILES NO FAILESS THE CONTRACT NO FAILES AND FAILESS THE CONTRACT NO FAILESS THE CONTRACT NO FAILES AND FAILESS THE CONTRACT NO FAILES AND INSTALLATION IS COMPLETED BY TIPES AVAILABLE.) SLOT IN TENDN PLATE AND INSTALLATION OF THE ALLEN HEAD SCREWS.	GRAB BAR WITH CONCEALED MOUNTING 3100
APPROVED AS NOTED DISAPPROVED SUBJECT TO THE RECHREMENTS OF CONTRACT NO 16 24 70 12 - 1766 APPROVAL OF A SUBMITNAL DOES NOT INCLUDE APPROVAL OF AN SUBMITNAL DOES NOT INCLUDE APPROVAL OF ANY DEVITITION FROM THE CONTRACTOR CALLS ATTENTION TO AND SUPPORTS THE DEVIA- TION THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING PROPER PHYSICAL DIMENSIONS OPTIONS APPRECHOS/LOOGIFOINMIECON RED THANDES, EIC., AS REQUIRED. X - K- KNURWLEWER ATE P - P EENE OF OFFICER IN CHARGE OF CONSTRUCTION STATNLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (I.32mm) Z - I-I/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STATNLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (I.32mm) TO TUSING TO FORM A SINCLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICAT OF CASE HARDENED STATNLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELL TO TUSING TO FORM A SINCLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICAT OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINISHED. INSTALLATION - PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WELLOWED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICAL INDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATE SAND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	SION ERING COMMAND A 23511
APPROVED AS NOTED DISAPPROVED SUBJECT TO THE REGUREMENTS OF CONTRACT NO MOLY 70 - (1-C-166 APPROVAL OF ANY DEVITION FROM PLATE APPROVAL OF ANY DEVITION FROM PLATE TRACT REQUIREMENTS WILESS THE CONTRACTOR CALLS ATTENTION TO AND SOPPORTS THE DEVIA- TION THE CONTRACTOR SHALL BE RESONSIBLE FOR PROVIDING PROPER PHYSICAL DIMENSIONS OPTIONS APPRICADOMEDIAL SET THAN SHALL BE RESONSIBLE FOR PROVIDING PROPER PHYSICAL DIMENSIONS OPTIONS APPRICADOMEDIAL SET THAN SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (32mm) Z-1-1/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (32mm) Z-1-1/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (32mm) TO. TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES REQUIRED) SHALL BE STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELD CASE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELD TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICAT OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINI INSTALLATION - PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WELD CALL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WIT INSTALLATION - PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED ONLY WHEN SPECIFICAL INDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL. FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	
SUBJECT TO THE RECHIREMENTS OF CONTRACT NO ACLY TO CIC-C-1266 APPROVAL OF A SUBMITTAL DOES NOT INCLIDE APPROVAL OF ANY DEVIRTION FROM THE CONTRACTOR TRACT REQUIREMENTS BULESS THE CONTRACTOR CALLS ATTENTION TO AND APPROVISIONS FOR PROVIDING PROPER PHYSICAL DIMENSIONS OPTIONS APPRENDINGOOM DIMENSION BETWEEN FOR PROVIDING PROPER PHYSICAL DIMENSIONS REQUIRED. K- KNUMBULEWER P-PEENE BOR OFFICER IN CHARGE OF CONSTRUCTION Z-I-I/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (32mm) Z-I-I/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (32mm) TO TUPING TO FORM A SINILESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCESSE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELL TO TUBING TO FORM A SINILE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICATED OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINI INSTALLATION - PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WELLOCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WITH ELONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALING TENON PLATE IS PROVIDED WITH ELONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICAL INDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	
CONTRACT NO 10-17-16-6 APPROVAL OF A SUBMITTAL DDES NOT INCLUDE APPROVAL OF ANY DEVIATION FROM FIGURE APPROVAL OF ANY DEVIATION FROM FIGURE APPROVAL OF ANY DEVIATION FROM FIGURE THACT REQUIREMENTS WILLSS THE CONTRACTOR CALLS ATTENTION TO AND SOPPORTS THE DEVIA- TION THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING PROPER PHYSICAL DIMENSIONS OPTIONS APPRENCHED/NICOORDINAMEDIK OF TRADES, FIG., AS REQUIRED. K - KNURRYHEWER ATE P - PEENE FOR OFFICER IN CHARGE OF CONSTRUCTION SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (32mm) Z-1-1/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (32mm) TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES REQUIRED) SHALL BE STAINLESS STEEL APER-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCE CASE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELL TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICATED TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICATED TO CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINI INSTALLATION - PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE MELOCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WITH ELONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL INDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TEROND PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS TOMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	PLATE
APPROVAL OF A SUBMITIAL DOES NOT INCLUDE APPROVAL OF ANY DEVISITION FROM THE CONTRACTOR TRACT REQUIREMENTS UNLESS THE CONTRACTOR CALLS ATTENTION TO AND SUPPORTS THE DEVIA- TION. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING PROPER PHYSICAL DIMENSIONS OPTIONS APPRECHABILED FROM TRADES, FIG., AS REQUIRED. K - KNURWIEWER DATE L-1/4" DIA. Z - I-1/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (30.D.). TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES) CASE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELD TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICATE OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINI INSTALLATION - PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WELLOCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WIT ELONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL INDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	61-C-1766
APPROVAL OF ANY DEVIATION FROM, THE UNITAGE OF TRACTOR TRACTOR CALLS ATTENTION TO AND SUPPORTS THE DEVIATION THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING PROPER PHYSICAL DIMENSIONS OPPTIONS APPRENDING PROPER PHYSICAL DIMENSIONS REQUIRED. K - KNURWLEWER P - PENE FOR OFFICER IN CHARGE OF CONSTRUCTION Z - I-I/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (32mm) Z - I-I/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (32mm) C.D. TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES) CASE HARDENED STAINLESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCEASE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELL TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICATED FOR THE PROPERTY OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINITED TO THE PROPERTY OF THE PROPE OF THE PROPERTY OF THE PROPERTY OF THE PROPERTY OF THE PROPER	
TION THE CONTRACTOR STATEL BY RESPONSIONS FOR PROVIDING PROPER PHYSICAL DIMENSIONS OPTIONS PRECHOSILOCOMPDICATED TRADES, FIC., AS REQUIRED. K - KNURWIEWER A - KNURWIEWER C- L-1/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF No. 16 GAUGE (.064 THICK) 1-1/4" (3 D.D. TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES REQUIRED) SHALL BE STAINLESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROC CASE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELL TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICAT OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINI INSTALLATION - PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WELL COCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WIT LINDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	STHE CONTRACTOR
OPTIONS PREMISED PROPER PHYSICAL DIMENSIONS REQUIRED. K - KNURWIEWER P - PEENE BOR OFFICER IN CHARGE OF CONSTRUCTION P - PEENE BOR OFFICER IN CHARGE OF CONSTRUCTION To the second of the second o	AFF RE KESLOWINGIDE / / / / Mark X
REQUIRED. K - KNURRVIEWER DATE P - P ENE DOR OFFICER IN CHARGE OF CONSTRUCTION Z - I-1/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (3 D.D. TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES REQUIRED) SHALL BE STAINLESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCE CASE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELL TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICAT OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINI INSTALLATION - PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WELL COCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WITH ELONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL INDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	YSICAL DIMENSIONS / / SET
K- KNURWIEWER DATE P-PEENEDROFFICER IN CHARGE OF CONSTRUCTION Z-I-I/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (30.0.0.0.0.0.0.0.0.0.0.0.0.0.0.0.0.0.0.	D TRADES, FIG., AS SCREWS
P-PENEDROFICER IN CHARGE OF CONSTRUCTION Z-I-I/2" (38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - DIAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (30.0). TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES REQUIRED) SHALL BE STAINLESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCESSE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELD TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICATOF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINITY. INSTALLATION - PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WE CONCEALED ANCHOR SPECIFICALL MOUNTING TENON PLATE IS PROVIDED WITH LONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL NDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	" Street
Z-1-1/2"(38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF No. 16 GAUGE (.064 THICK) 1-1/4" (30.D. TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES REQUIRED) SHALL BE STAINLESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCESSE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELD TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICATED CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINITY OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINITY OF CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WE COCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WITH THE CONCEALED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN ENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	
Z-1-1/2"(38mm) CLEAR DIMENSION BETWEEN BAR AND FINISHED WALL. SPECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF No. 16 GAUGE (.064 THICK) 1-1/4" (30.0. TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES REQUIRED) SHALL BE STAINLESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCESSE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELD TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICATED CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINING MOUNTING CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WE COLD CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED ON PLATE IS PROVIDED WIT LONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL NDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN ENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON LATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	OF CONSTRUCTION (32mm)
BAR AND FINISHED WALL. PECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (3 J.D. TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES REQUIRED) SHALL BE STAINLESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCASE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELD O TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICAT F CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINI NSTALLATION - ROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WOLLD BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WITH LONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL NDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN ENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON LATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	
PECIFICATIONS - STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF No. 16 GAUGE (.064 THICK) 1-1/4" (30.0. TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES DEQUIRED) SHALL BE STAINLESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCESSE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELL OF TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICATE FOR CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINITED PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WE OCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WITLL LONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL NDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN ENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON LATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	SION BETWEEN
STAINLESS STEEL GRAB BAR SHALL BE FABRICATED OF NO. 16 GAUGE (.064 THICK) 1-1/4" (30.D. TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES REQUIRED) SHALL BE STAINLESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCESSE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELD TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICAT OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINITURE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WE CONCEALED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL NDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	
D.D. TYPE 304L, 18-8 ALLOY STAINLESS STEEL TUBING. END FLANGES (AND CENTER FLANGES REQUIRED) SHALL BE STAINLESS STEEL PRE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROCESSE HARDENED STAINLESS STEEL ALLEN HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELD TO TUBING TO FORM A SINGLE STRUCTURAL UNIT. MOUNTING TENON PLATE SHALL BE FABRICATED CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINITURY OF CASE HARDENED CADMIUM PLATED STEEL. ALL STAINLESS STEEL SHALL HAVE A SATIN FINITURY OF CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WE LOCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WITH ELONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL INDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	
PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WELLOCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WITTELONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL INDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	STEEL TUBING. END FLANGES (AND CENTER FLANGES IF RE-DRILLED AND TAPPED FOR THREE (3) TAMPER PROOF HEAD SET SCREWS. FLANGES SHALL BE HELIARC WELDED UNIT. MOUNTING TENON PLATE SHALL BE FABRICATED
PROVIDE CONCEALED ANCHOR DEVICE OR BACKING AS SPECIFIED OR REQUIRED IN ACCORDANCE WITH LOCAL BUILDING CODES BEFORE WALL IS FINISHED. MOUNTING TENON PLATE IS PROVIDED WITH ELONGATED SLOT FOR 3/8". DIAMETER BOLT. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALL INDICATED BY TYPES. SEE ANCHOR SPECIFICATION SHEET FOR TYPES AVAILABLE.) SLOT IN TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	
TENON PLATE ALLOWS FOR APPROX. 1" VERTICAL OR HORIZONTAL ADJUSTMENT. AFTER TENON PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	INISHED, MOUNTING TENON PLATE IS PROVIDED WITH T. (ANCHORS ARE PROVIDED ONLY WHEN SPECIFICALLY
PLATE IS MOUNTED TO WALL, FLANGES ARE FITTED OVER TENON PLATES AND INSTALLATION IS COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	[사람이의 기존에게 그 네일이 아이들이 되었다. 이 시간에 가장하는 것이 되는 것이 없는 것이 없는 것이 없는 사람이 없는 것이 없는
COMPLETED BY TIGHTENING OF THE ALLEN HEAD SCREWS.	FITTED OVER TENON PLATES AND INSTALLATION IS
	HEAD SCREWS.
ECHNICAL DATA - (material) shown and that the (equipment)	(material) shown and
HEN INSTALLED STRICTLY IN ACCORDANCE COMMUNICATION NOT NOT NOT INTO COMMUNICATION NOT NOT NOT NOT NOT NOT NOT NOT NOT N	Gamble MANUFACTURERS INSTRUCTION Into
LEXURAL STRENGTH - 8,000 PSI MODULUS DECIREBETURE	Special Running the Contract drawings in
Compliance with the Contract drawings and HEAR & PULL OUT - 1,000 LBS. PER LINEALS FOOT; and is submitted Government Certified.	EALSHERDS; and is submitted in the allocate
Certificate Government	ertification of the control of the c
Stitled by DS	ordined by DS
Date5 · 22 · 84	ite5 · 22 · 84
	The state of the s

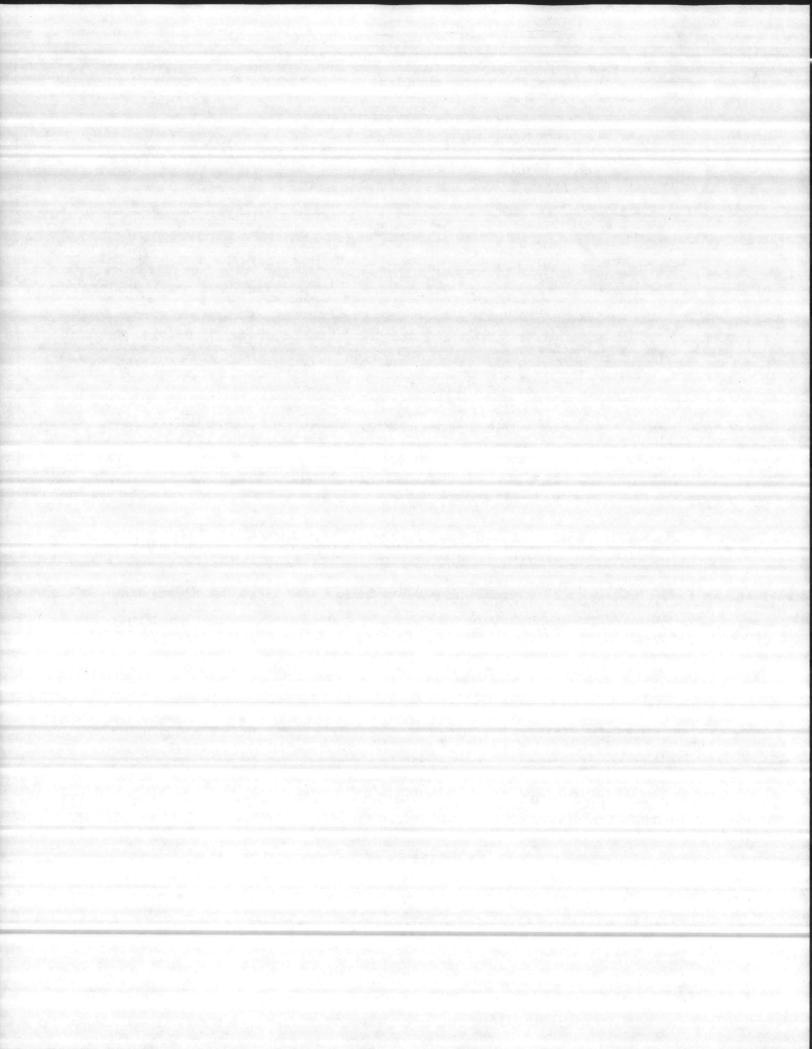



STAINLESS STEEL SHELF

0692

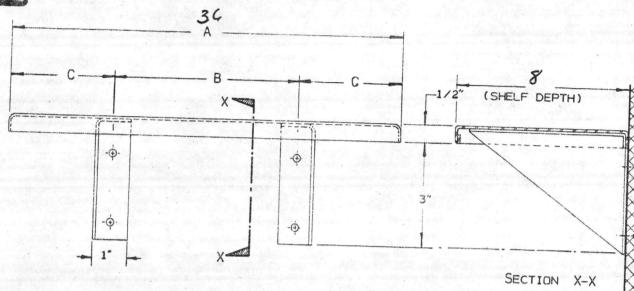

	SCH			
	LENGTH A	DIM B	DIM C	BRKTS REQD
	12"	6°	3"	2
	16"	10"	3*	2
	18"	12"	3"	2
	24"	18"	3"	2
	30"	12"	3"	3
>	36"	15"	3"	3
1	42"	18"	3"	3
E	48"	14"	3"	4
	60"	18"	3"	4
L	72*	16-1/2*	3*	5

"It is hereby certified that the (equipment) (material) shown and marked in this submittal is that proposed to be incorporated into Contract Number N62470 8) - (1) (is in spaces, and is submitted Government) (Certified by D.C.)

SPECIFICATIONS

SHELF IS FABRICATED OF 18-8 ALLOY TYPE 304L STAINLESS STEEL POLISHED TO A #4 SATIN FINISH. SHELF BODY IS #18 GAUGE.

SHELF IS PROVIDED WITH A 1/2" LIP ON ALL FOUR SIDES.

BRACKETS TO BE 16 GAUGE, WELDED IN PLACE AND FURNISHED AT DEFINITE INTERVALS AS INDICATED IN THE ABOVE SCHEDULE.


INSTALLATION SHELF BRACKETS ARE PROVIDED WITH TWO (2) HOLES PER BRACKET TO ACCOMMODATE 3/16" DIAMETER SCREWS.

NOTE - SINCE SHELVES ARE CUSTOM FABRICATED, ALMOST ALL SIZES ARE AVAILABLE. LENGTHS SCHEDULED ABOVE ARE STANDARD.

MOUNTING SUGGESTIONS


LOCATION - 42" FROM TOP OF FINISHED FLOOR TO TOP OF SHELF OR 18" ABOVE TOP OF WASH BASIN.

AVAILABLE SHELF DEPTHS - 5" , 6" , 8" , 12" , AND 18"

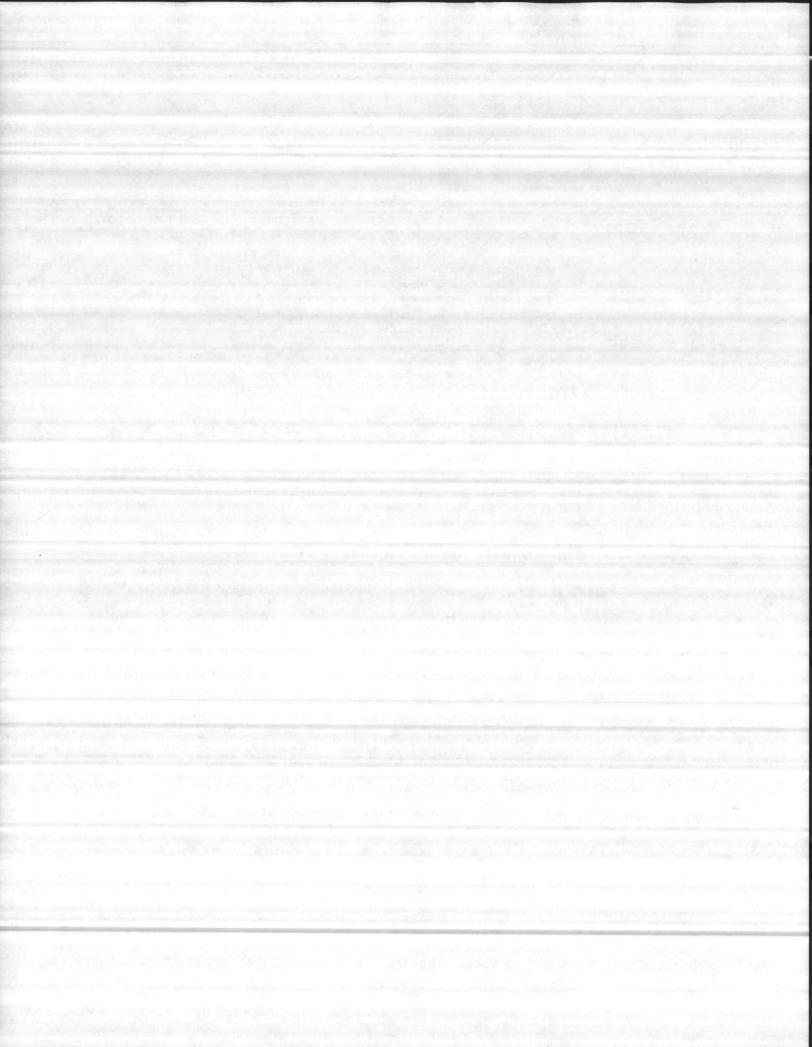



SURFACE MOUNTED SINGLE ROLL TOILET TISSUE HOLDER

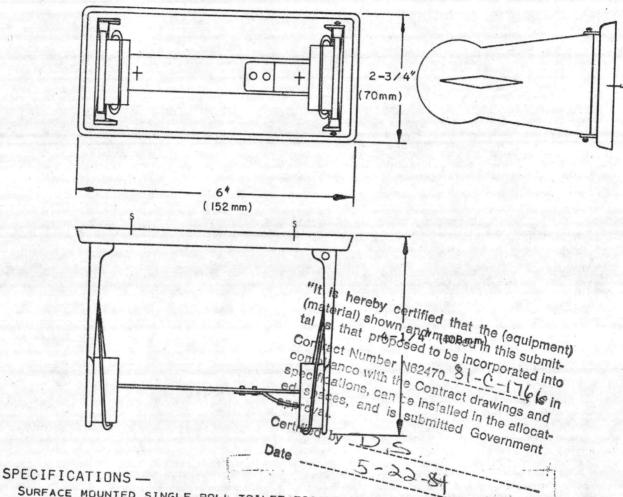

SURFACE MOUNTED SINGLE ROLL TOILET TISSUE HOLDER SHALL BE FARRICATED OF NO. 18 GAUGE STEEL, ENTIRE SURFACE SHALL BE HIGH POLISHED CHROME PLATED DVER NICKEL AND COPPER. MOUNTING SHALL BE THRU HORIZONTAL ELONGATED COUNTER SUNK SLOTS PROVIDED ON BACK WALL OF HOLDER. A BRAKE-SPRING ACTION DEVICE WILL BE PROVIDED TO PREVENT FREE ROLL OF TOILET TISSUE. A PILFER PROOF LOCKING DEVICE SHALL ALSO BE PROVIDED.

CAPACITY-

ONE (1) ROLL (STANDARD SIZE) TOILET TISSUE.

INSTALLATION -


HOLDER SHALL BE MOUNTED BY MEANS OF 3/4" SLOTS PROVIDED IN BACK WALL TO ACCOMMO-(19mm) DATE 3/16" DIAMETER SCREWS FURNISHED BY MANUFACTURER.

MOUNTING SUGGESTIONS -

LOCATION - 32" FROM TOP OF FINISHED FLOOR TO CENTER LINE OF HOLDER.


OPTIONAL -

UNIT AS SPECIFIED IS AVAILABLE WITH A SATIN CHROME FINISH. SPECIFY NO. 0710A

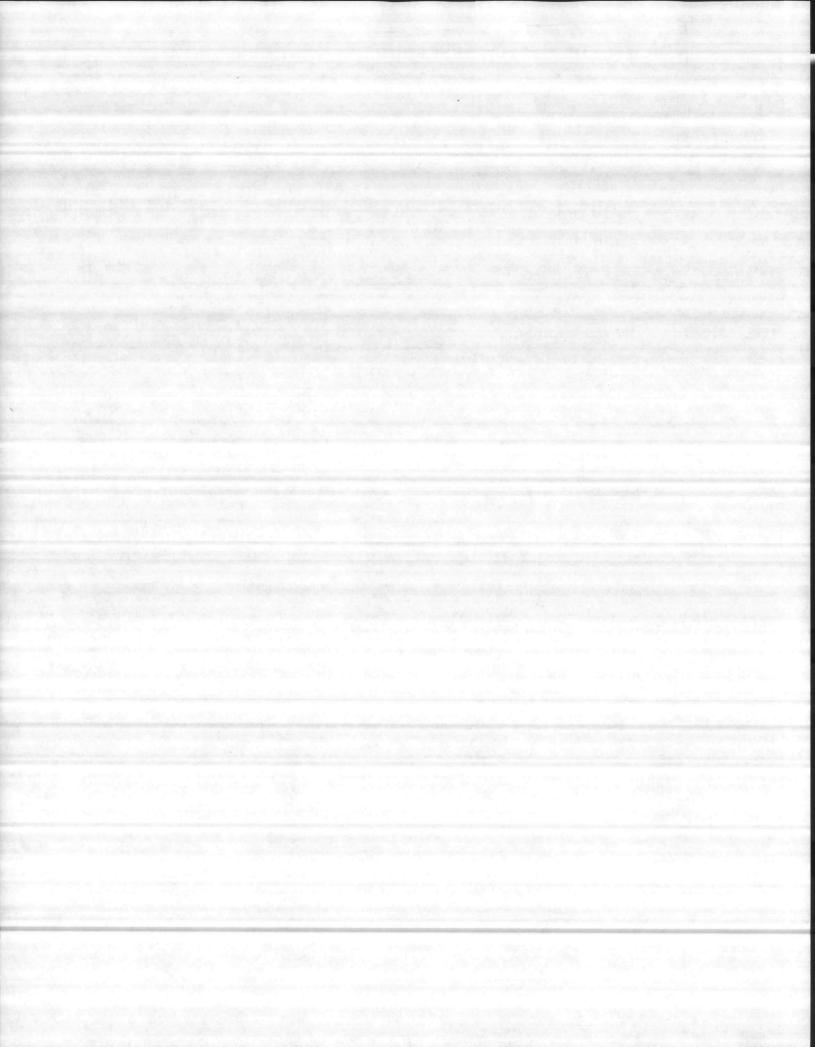

RECESSED PAPER TOWEL DISPENSER-DISPOSAL UNIT

0463

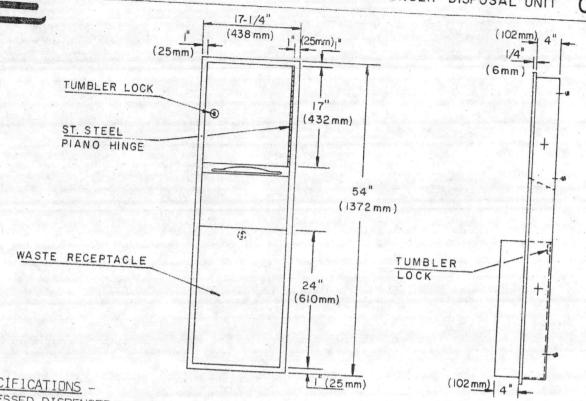

SPECIFICATIONS -

RECESSED DISPENSER AND SEMI-RECESSED DISPOSAL SHALL BE FABRICATED OF No. 22 GAUGE, TYPE 304L, 18-8 ALLOY STAINLESS STEEL WITH A NO. 4 SATIN FINISH PROTECTED BY A POLY-VINYL COATING (PVC) EASILY REMOVED AFTER INSTALLATION. FACE TRIM SHALL BE ONE PIECE CONSTRUCTION WITH NO MITRES OR WELDING 1" WIDE AND RETURNING 1/4" TO THE WALL. CABINET SHALL HAVE NO EXPOSED FASTENING DEVICES OR SPOT WELDED SEAMS. DISPENSER DOOR SHALL BE DOUBLE PAN CONSTRUCTION, MOUNTED TO CABINET BODY ON HEAVY DUTY STAINLESS STEEL PIAND HINGE AND PROVIDED WITH PIN TUMBLER TYPE LOCK. REMOVABLE WASTE TO HAVE PIN TUMBLER LOCK KEYED ALIKE.

"It is hereby certified that the (equipment) (material) shown and marked in this submit-CAPACITY Towel Dispenser - 600 C-Fold or 800 Multipart Number PROJECT C-176 Compliance with the Contract drawings and specifications can be incorporated into compliance with the Contract drawings and

WALL OPENING - WIDTH - 15-3/4" (400MM PPAREPGHENT 1525 SUBMITTED Government specifications, can be installed is shown (1934 4-1/4" (108MM)

INSTALLATION - CABINET SHALL HAVE CONCERNED WOODTING HOLES WHICH SCHALL ACCOMMODATE Date _____5

MOUNTING SUGGESTIONS -


LOCATION-16" (106MM) FROM TOP OF FINISHED FLOOR TO BOTTOM OF UNIT:


NOTES -

- 1. ASI #0463 IS PROVIDED WITH AN ADAPTER WHICH PERMITS CHANGING FROM C-FOLD TO A
- 2. THIS UNIT IS KEYED ALIKE WITH OTHER ASI EQUIPMENT.

OPTIONAL:

A. MIRRORED UPPER DOOR.

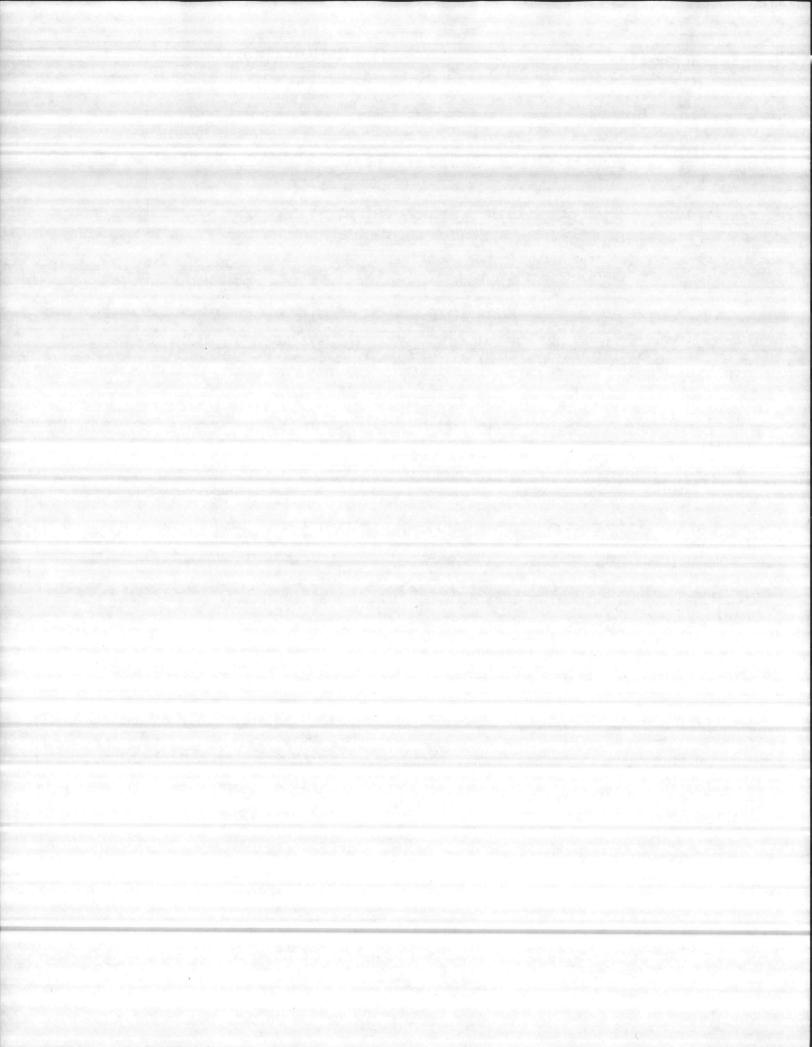

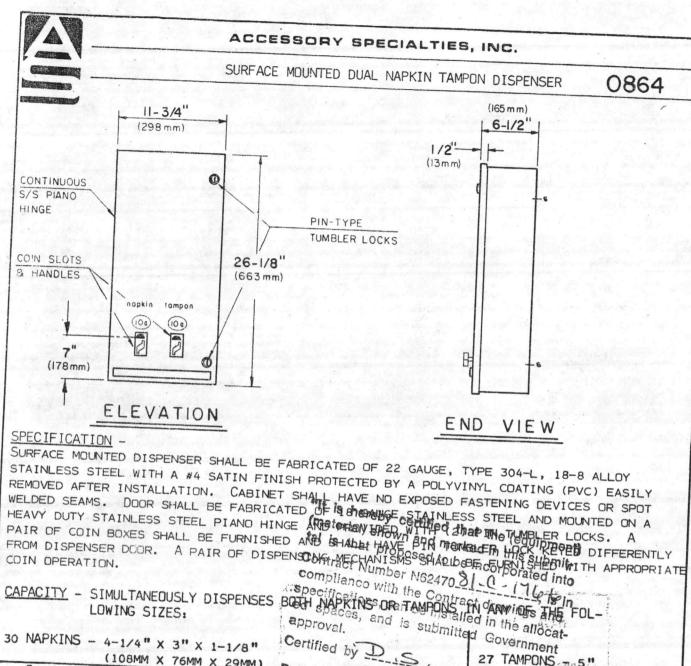

27 TAMPONS 7.5" (108MM X 76MM X 29MM)


STAYFREE #4 GUARDS-#704, 707, 07010, 07040, KOTEX PURE-NAT #M-4 07045, 07300 OR 07320 TAMPAX , MODESS #4 MODESS TAMPONS

INSTALLATION - CABINET HAS (4) HOLES ACCOMMODATING 3/16" (5MM) DIA. SCREWS FOR MOUNTING

MOUNTING SUGGESTION - LOCATION - 32" (813MM) TO 40" (1016MM) FROM TOP OF FINISHED FLOOR

NOTES: 1. THIS UNIT IS KEYED ALIKE WITH OTHER A.S.I. EQUIPMENT.


MECHANISM IS AVAILABLE FOR OPERATION BY MEANS OF THE FOLLOWING: 100 250 GRATIS PLEASE SPECIFY

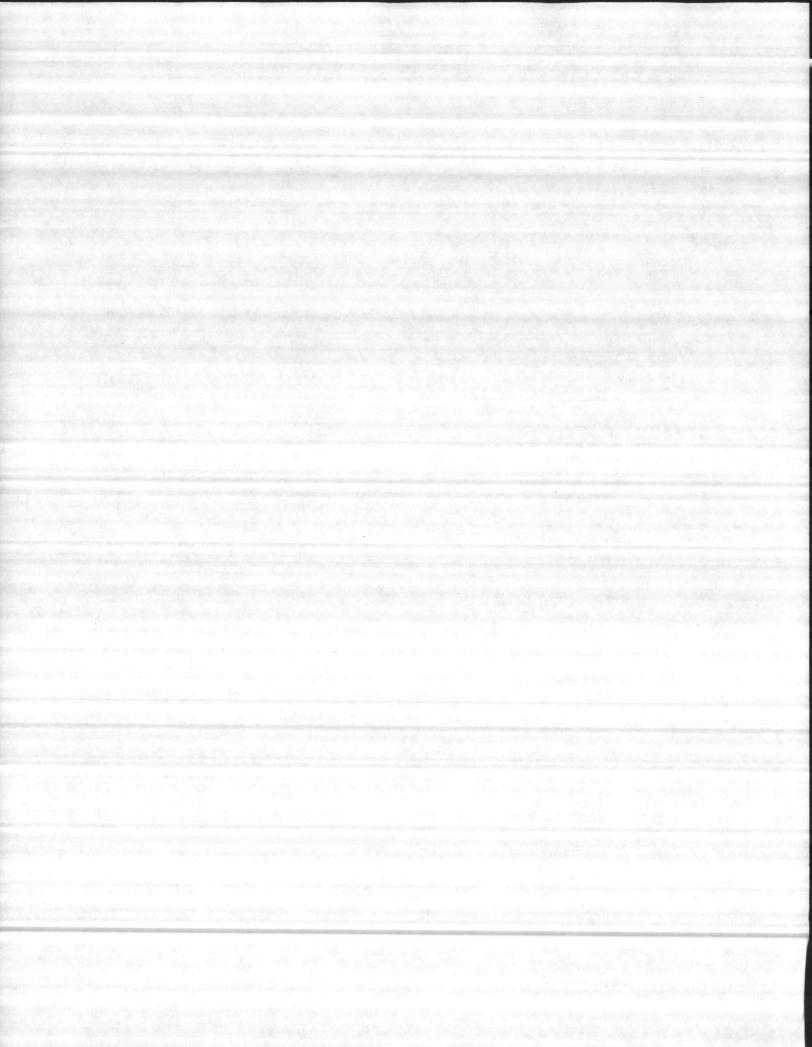

SANITARY NAPKIN DISPOSAL AND SHELF

0852SH

With Deodorant Compartment

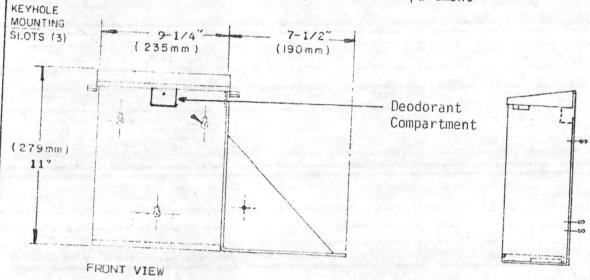

S

SIDE VIEW

"It is hereby certified that the (equipment) (material) shown and marked in this submitis that proposed to be incorporated into Contract Nonmer N624708 - (- () () in the Contract drawings and specifications, can be installed in the allocated spaces, and is submitted Government approval.

SPECIFICATION-

SANITARY NAPKIN DISPOSAL SHALL BE FABRICATED OF NO. 22 GAUGE, TYPE 304L 18-8 ALLOY STAINLESS STEEL WITH A NO. 4 SATIN FINISH PROTECTED BY A POLYVINYL COATING (PVC) EASILY REMOVED AFTER INSTALLATION. CABINET SHALL HAVE NO EXPOSED FASTENING DEVICES OR SPOT WELDED SEAMS. BOTH DOORS ARE TO BE HUNG ON A HEAVY DUTY STATILESS STEEL PIAND HINGE. UPPER DOOR IS TO BE PROVIDED WITH A HEAVY GAUGE STAINLESS STEEL LIFT HANDLE ON EACH END. LOWER TRAP DOOR IS TO HAVE A HIDDEN STAINLESS STEEL SPRING TENSIONED SELF CATCHING LOCK AND SHALL BE HINGED ON FRONT FACE SO AS TO PERMIT CON-VENIENT REMOVAL OF WASTE. REMOVABLE PURSE SHELF IS TO BE FABRICATED OF 22 GAUGE STAINLESS SIEEL WITH FINISH TO MATCH CABINET BODY. CAPACITY-

396 CUBIC (NCHES.(0006m3)


PLAN VIEW

INSTALLATION-

THREE CONCEALED MOUNTING HOLES ARE TO BE PROVIDED IN REAR OF CABINET THAT SHALL ACCOMMODATE #10 SCREWS FURNISHED BY THE MANUFACTURER.


MOUNTING SUGGESTION-


LOCATION - 18" FROM TOP OF FINISHED FLOOR TO BOTTOM OF DISPOSAL.

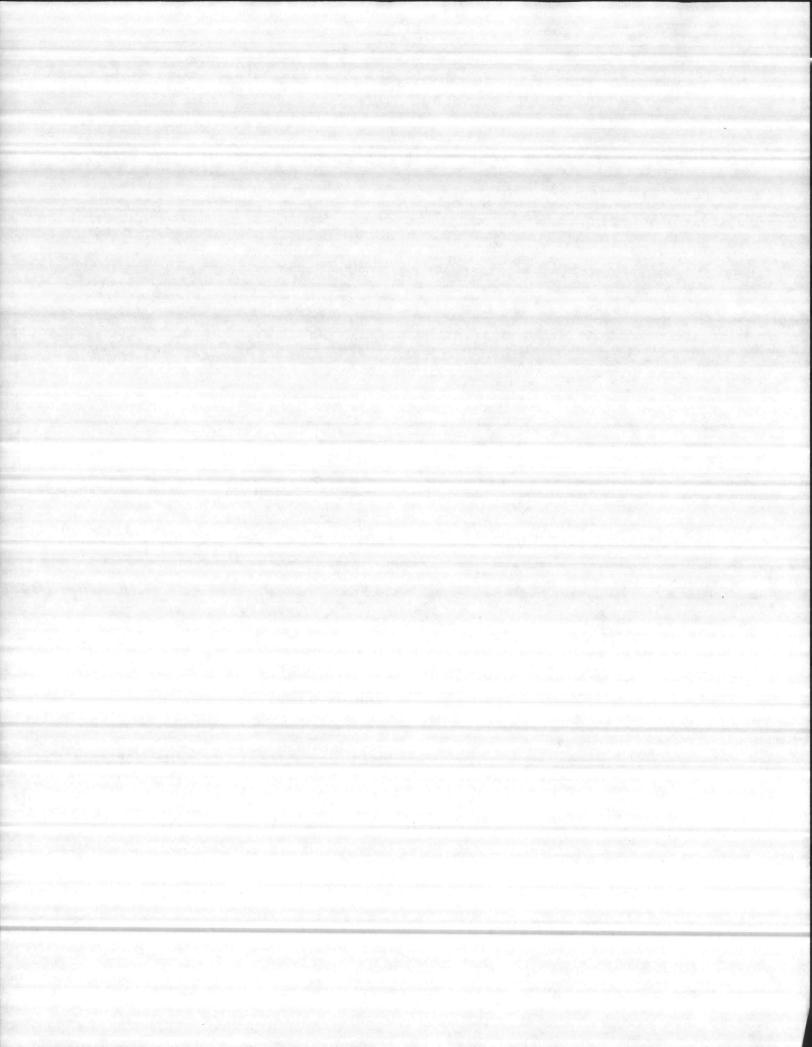


DOUBLE ROBE HOOK

0745

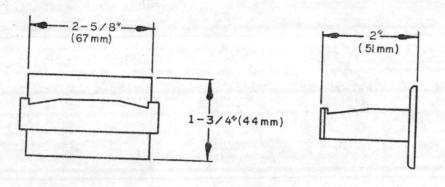



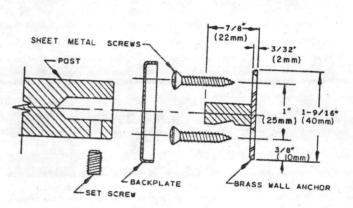

SPECIFICATIONS-

HOOK SHALL BE FABRICATED ENTIRELY OF BRASS. ALL EXPOSED SURFACES TO BE HIGH POL-ISHED, TRIPLE PLATED HEAVY CHROME NICKEL AND COPPER. A CHROME PLATED STAMPED BACK PLATE SHALL CONCEAL THE BRASS WALL DOWEL-ANCHOR. CHROME PLATED HOOK IS TO FIT SNUG-LY OVER DOWEL. ENTIRE ASSEMBLY IS TO BE MADE THEFT PROOF BY MEANS OF A TEMPERED HARDENED STAINLESS STEEL SET SCREW FITTING THROUGH HOOK INTO NOTCH PROVIDED IN DOWEL

INSTALLATION __

WALL ANCHOR SHALL HAVE TWO COUNTER SUNK HOLES TO ACCOMMODATE S.M. SCREWS FURNISHED BY MANUFACTURER.


MOUNTING SUGGESTIONS -

LOCATION - 66" FROM TOP OF FINISHED FLOOR TO CENTER LINE OF HOOK.

"It is hereby certified that the (equipment) (material) shown and marked in this submittal is that proposed to be incorporated into

Contract Number N6247081-C-176,4s in compliance with the Contract drawings and specifications, can be installed in the allocated ed spaces, and is submitted Government

Certified by DS

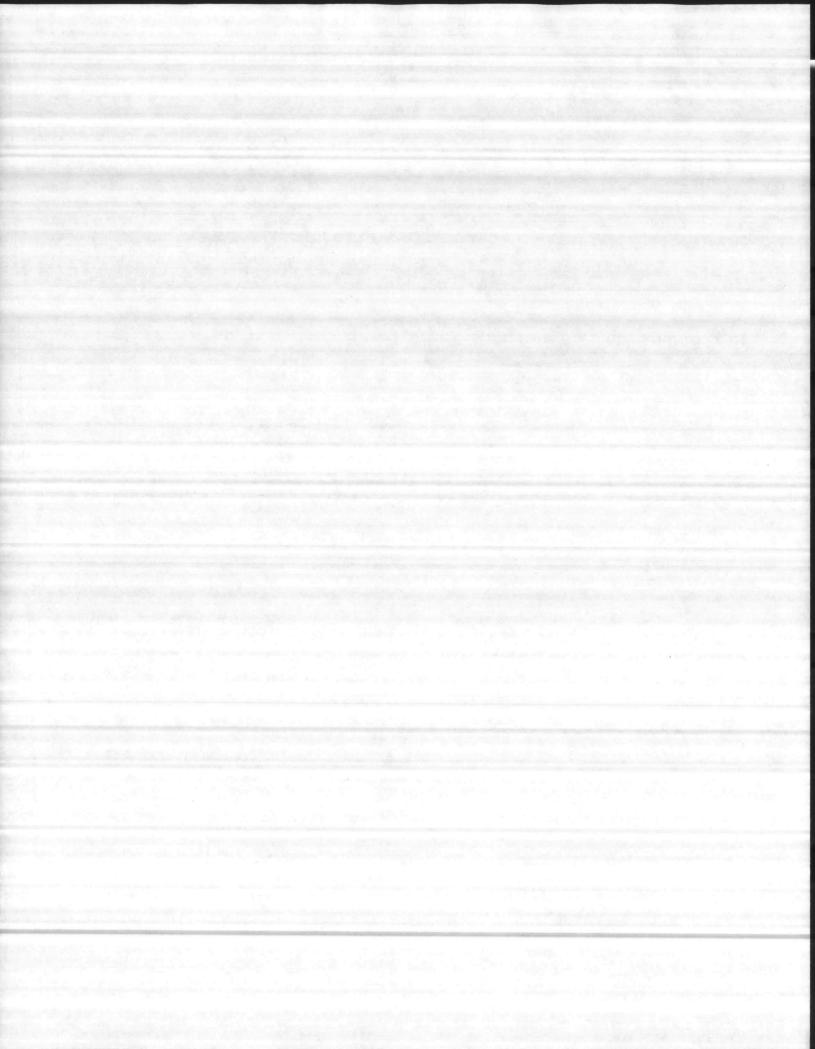







POWDER SOAP DISPENSER

0337A

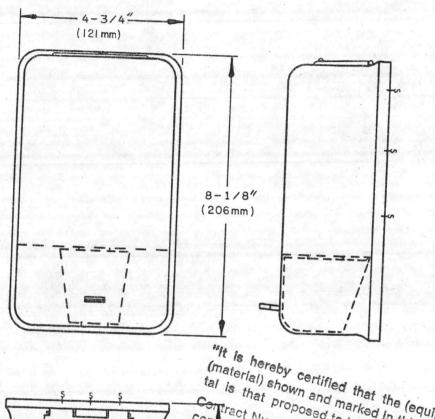

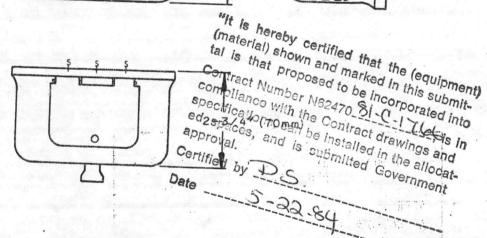

SPECIFICATION-

SURFACE MOUNTED POWDER SDAP DISPENSER SHALL BE FABRICATED OF NO. 20 GAUGE STEEL WITH ALL SURFACES CHROME PLATED OVER COPPER AND NICKEL. MOUNTING SHALL BE BY MEANS OF INTERLOCKING WEDGE BRACKETS AND TO BE LOCKED IN PLACE BY MEANS OF A SCREW IN-STALLED THROUGH VANDAL PROOF REFILL CAP.

CAPACITY-


32 DUNCES.

INSTALLATION -

BRACKET WILL BE PROVIDED WITH MOUNTING HOLES TO ACCOMMODATE 3/16" SCREWS FURNISHED BY MANUFACTURER.


MOUNTING SUGGESTIONS -

LOCATION - 42" FROM TOP OF FINISHED FLOOR TO BOTTOM OF UNIT OR 6" ABOVE WASH

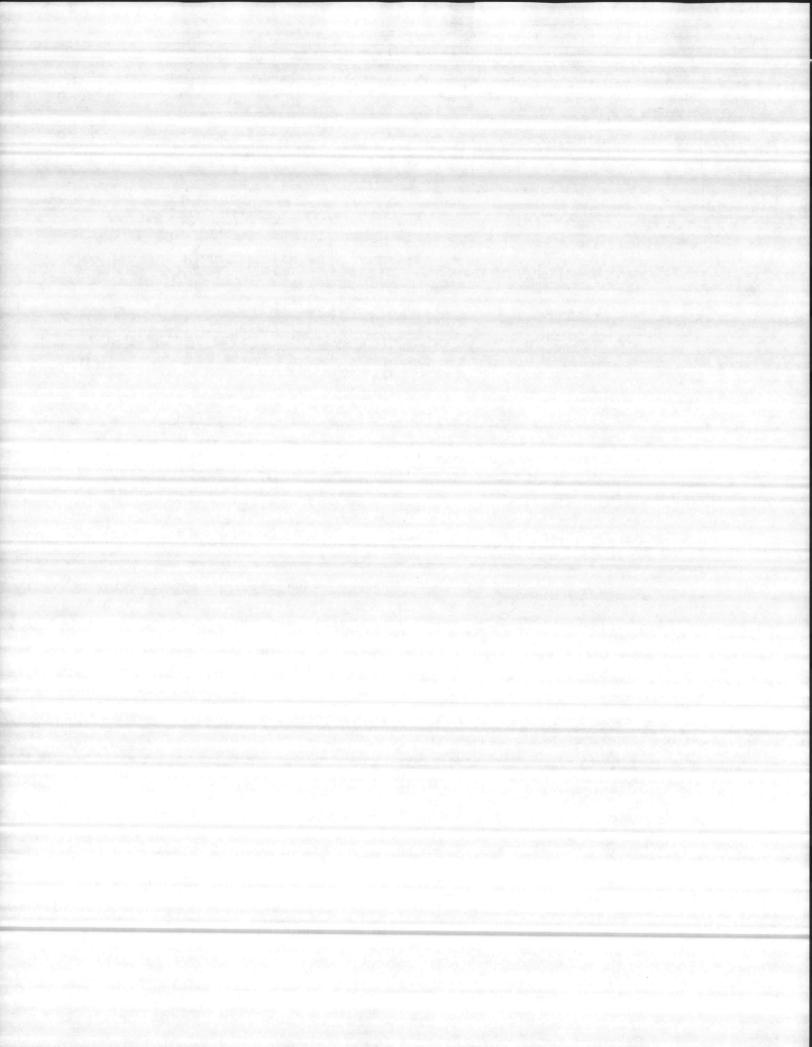

SHOWER CURTAIN RODS

CURTAIN ROD FLANGES

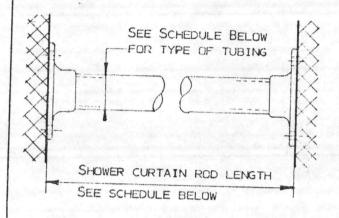

#1204 - 1" TUBE CHROME PLATED STEEL

#1204A - 1-1/4" TUBE CHROME PLATED STEEL


#1205 - 1" TUBE CHROME PLATED BRASS


#1205A - 1-1/4" TUBE CHROME PLATED BRASS


#1206 - 1" TUBE STAINLESS STEEL

#1206A - 1-1/4" TUBE STAINLESS STEEL (32mm) 18GA. (.049)

ITEM #	TYPE	LENGTH	QTY.
ell is born	and a second office of		
(material) s	y certified hown and ma proposed to	that the (equalities in this be incorpora	ipment)
POULT SOT AL		- "IUUIIIOPA	to al t
compliance pecifications despaces	with the Con	tract drawing	Plote in
pecifications d spaces, c pproval.	nd is subm	alled in the	Hocat-
ertified by	D C	Govern	ment
ite	2201		
THE RESIDENCE AND A COLOR STORE SHOULD BE THE RESIDENCE OF THE PARTY O	The statement with the statement of the		ransc. no san sa

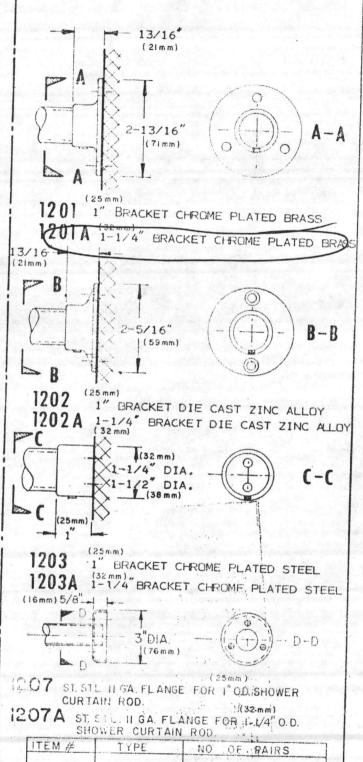

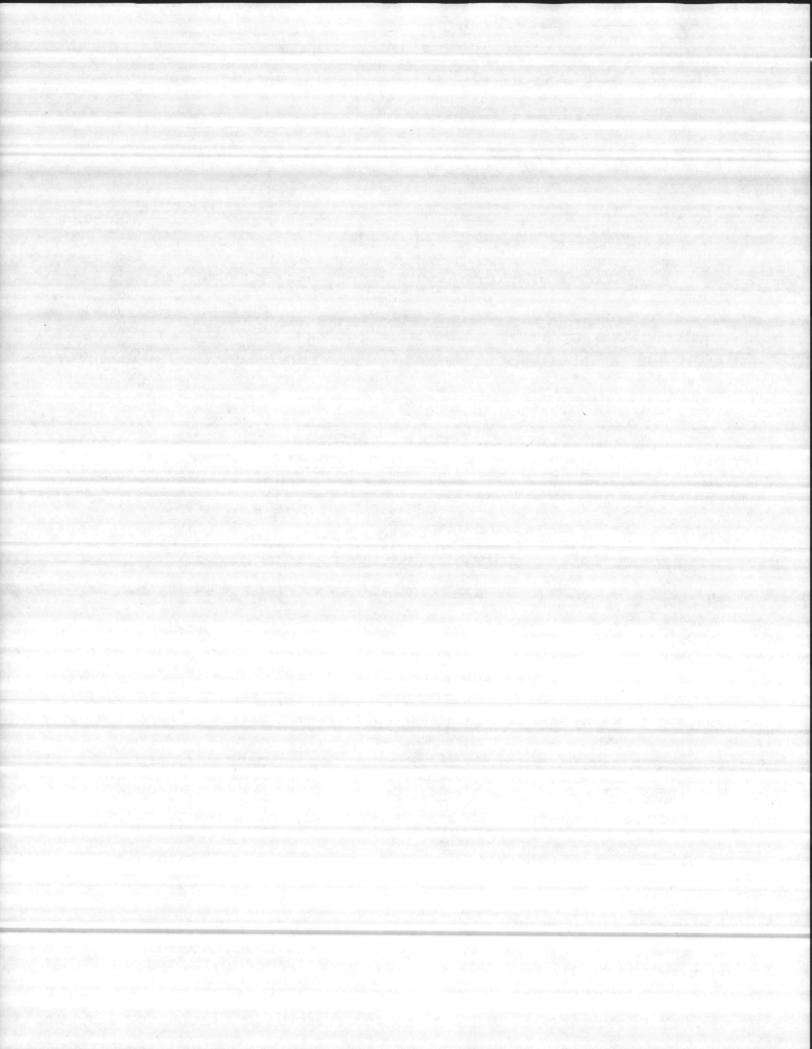

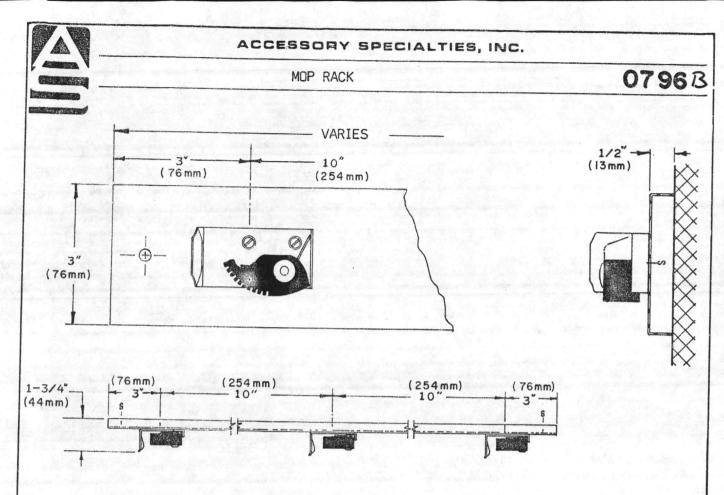

SCHEDULE

	ASI MOD. NO.	SUFFIX	REQ'D. LENGTH	MOP HOLDER	QUANTITY
L	0796	A	26"(660mm)		
->	0796	В	36"(914 mm)	4	
	0796	С	46"(1168 mm)	5	
	0796	D	56"(1422mm)	6	
	No. of the latest and		1 7 6		

SPECIFICATION -

RACK IS FABRICATED OF A ONE PIECE CHANNEL OF NO. 20 GAUGE, TYPE 304L, 18-8 ALLOY STAINLESS STEEL WITH HORIZONTAL EDGES RETURNING 1/2" TO THE WALL. SURFACE OF RACK IS POLISHED TO A NO. 4 SATIN FINISH. MOP HOLDERS ARE RIVETED TO RACK AT 10" INTERVALS. IS POLISHED TO A NO. TO SERVE TO BE CAMIUM PLATES STEEL WHICH IS RIDGE.

MOP HOLDERS ARE FABRICATED OF CADMIUM PLATES STEEL WHICH IS RIDGE.

A PIVOTING SERRATED RUBBER CAM HOLDS MOP IN FIXED POSITION.

(it is hereby certified that the (equipment) (material) shown and proposed that the proposed to be incorporated into Contract Number Negation.


Contract Number Negation (1)

Contract Number N6247081-C-1766 is In

MOUNTING SUGGESTION
Specification of BOTTOM OF BACK alled in the allocat
Approval.


Specification the Contract drawings and species, and is submitted Government

Certified by P.S.

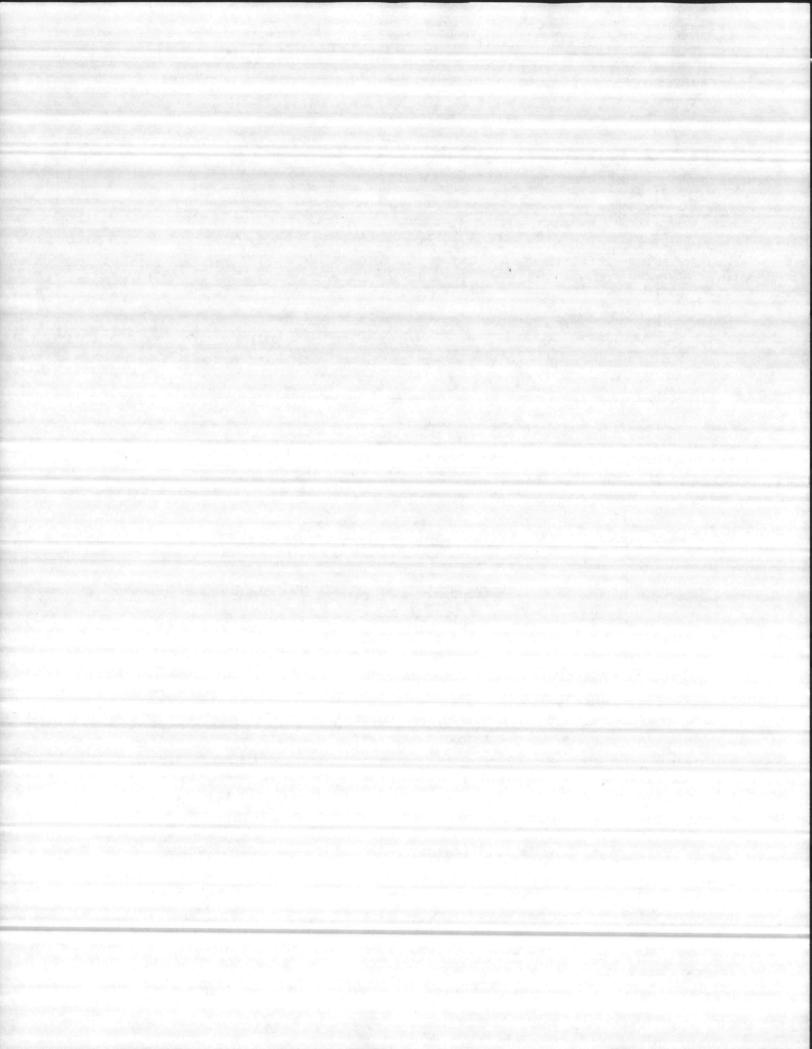

PAIL OR LADDER HOOK

1301 A

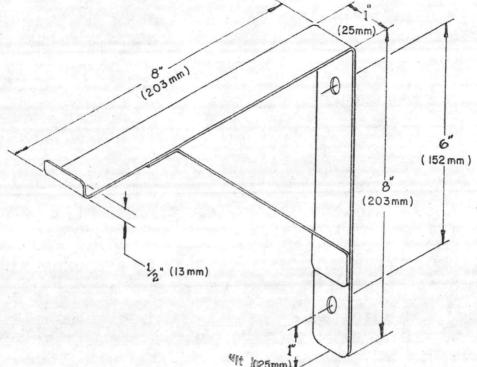

"It (25mm) by certified that the (equipment) (material) shown and marked in this submittal is that proposed to be incorporated into Contract Number N62470 81-C-1766 in compliance with the Contract drawings and specifications, can be installed in the allocated spaces, and is submitted Government approval.

Certified by DS


SPECIFICATION -

HOOK IS FABRICATED OF #12 GAUGE TYPE 304L, 18-8 ALLOY STAINLESS STEEL WITH A NO. 4 SATIN FINISH PROTECTED BY A POLYVINYL COATING (PVC) EASILY REMOVED AFTER INSTALLATION. HOOK HAS A 1/2" HIGH 90° LIP AND IS REINFORCED WITH A DIAGONAL BRACE. (13mm)

INSTALLATION -


(6mm)

HOOK IS PROVIDED WITH TWO MOUNTING HOLES TO RECEIVE 1/4" DIAMETER SCREWS.

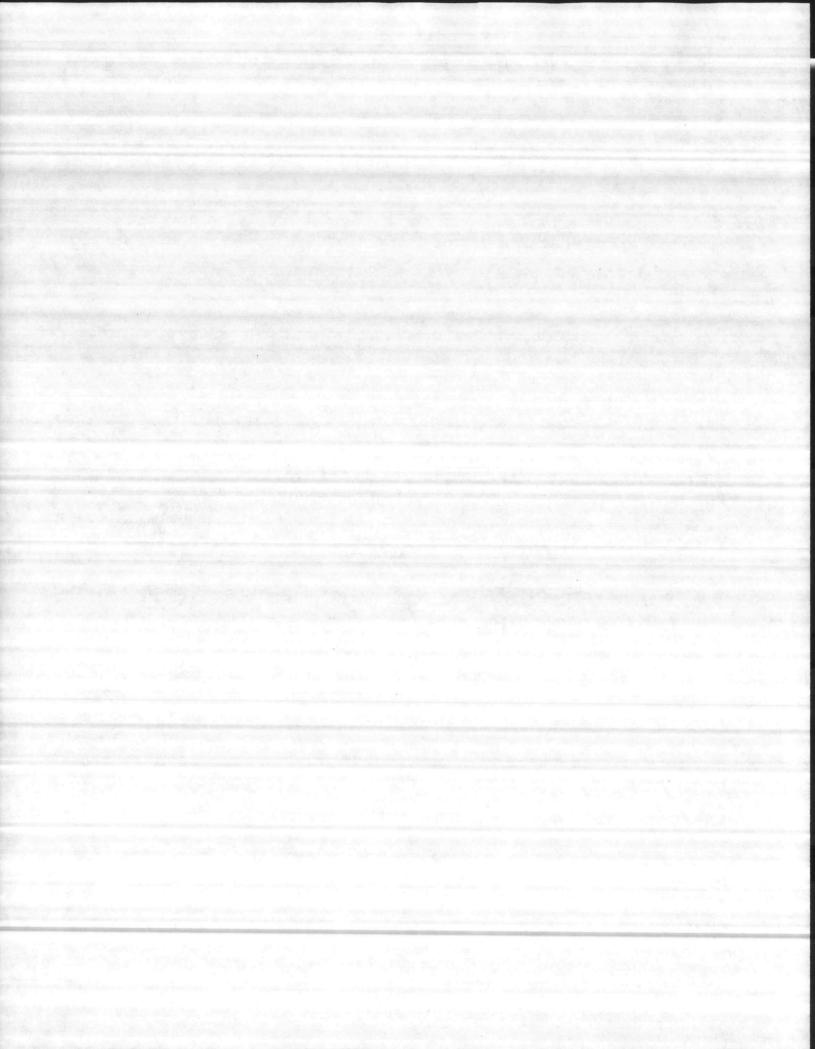

VACUUM HOSE BRACKET - ALUMINUM / STAINLESS

1305A

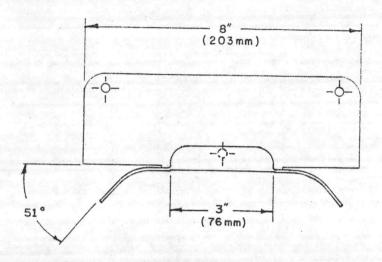

← 2-13/16"-(71mm) 3-13/16 (97mm) 1-1/16" (27mm)

FRONT VIEW

END VIEW

SPECIFICATION - 1305

(3mm)

VACUUM HOSE BRACKET IS FABRICATED OF 1/8" THICK 6063-T3 ALLOY ALUMINUM. BRACKET IS SHAPED IN ONE PIECE WITH ALL CORNERS AND EDGES ROUNDED. BRACKET IS ANODIZED DEEP ETCHED TO A SATIN FINISH.

SPECIFICATION - 1305A

VACUUM HOSE BRACKET IS FABRICATED OF #14 GAUGE TYPE 304L, 18-8 ALLOY STAINLESS STEEL WITH PLASTIC CLAD PRE-POLISHED NO. 4 SATIN FINISH ON ALL EXPOSED SURFACES. BRACKET IS SHAPED IN ONE PIECE AND HAS ALL CORNERS AND EDGES ROUNDED.

INSTALLATION -

(5mm)


VERTICAL INTEGRAL BACK PLATE IS PROVIDED WITH THREE HOLES TO ACCOMMODATE 3/16" DIAMETER SCREWS.

MOUNTING SUGGESTION
LOCATION - 60" FROM TOP OF FINISHED FLOOR TO BOTTOM CORTIFICOS THE RACKET.

(material) shown and marked in this submit-


tal is that proposed to be incorporated into Contract Number N62470 \$1-C-17 66 in compliance with the Contract drawings and specifications, can be installed in the allocated spaces, and is submitted Government

Certified by DS

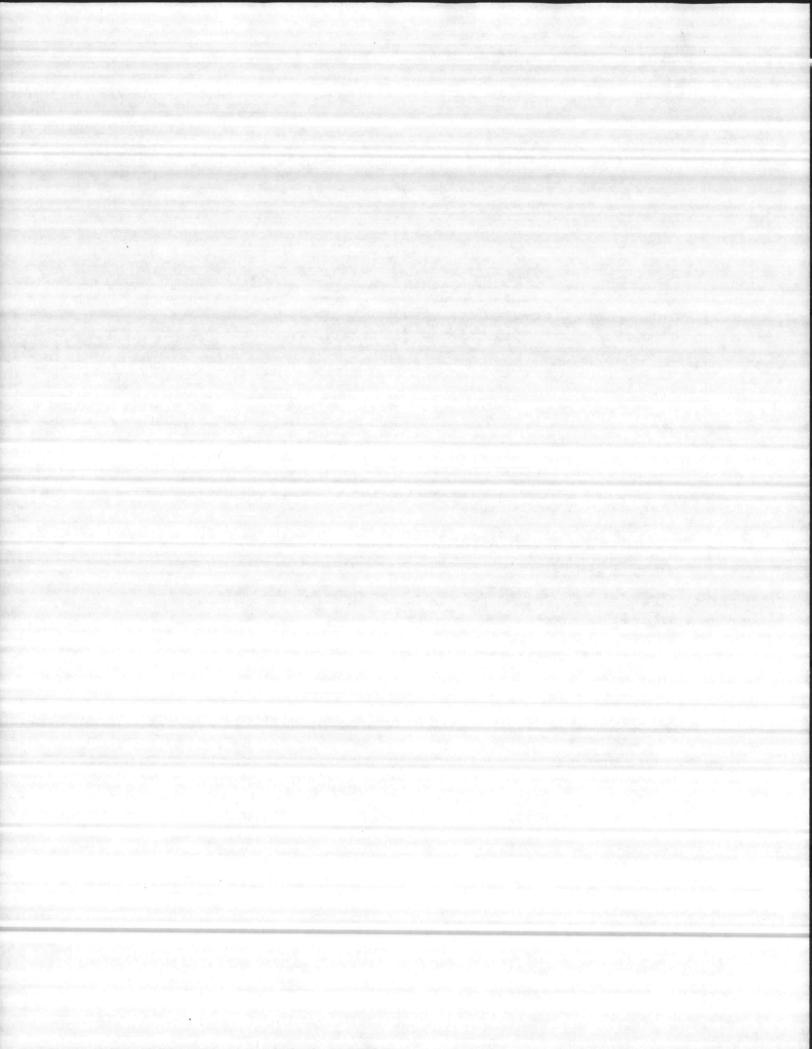


TILTED MIRROR FOR WHEEL CHAIR PATIENT (STAINLESS STEEL FRAME)

0535-053



WIDTH

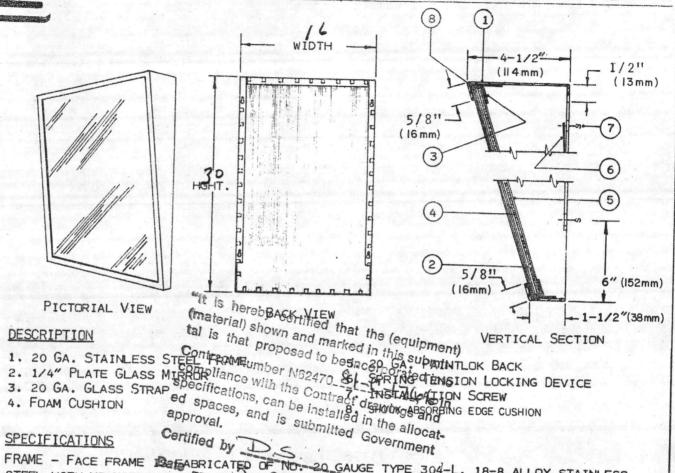

FRAME - FACE FRAME BAFABRICATED OF NO: 20 GAUGE TYPE 304-L, 18-8 ALLOY STAINLESS STEEL WITH NO MITRES, SPOT WELDED STANS OR SEPARATE COLLARS. ENTIRE FRAME IS POLISHED TO A NO. 4 SATIN FINISH. BACK PLATE IS FABRICATED OF NO. 20 GAUGE GAL-VANIZED STEEL, ONE PIECE AND DIE CUT TO FIT FRAME. HANGER ASSEMBLY IS PROVIDED TO PERMIT WALL MOUNTING AND HAS CONCEALED THEFT PROOF LOCKING DEVICES. A 1/16" THICK FELT BACK IS PROVIDED BETWEEN MIRROR AND BACK PLATE. MIRROR IS 1/4" QUALITY POLISHED PLATE GLASS, SILVER COATED AND HERMETICALLY SEALED WITH A UNIFORM COATING OF ELECTROLYTIC COPPER PLATING GUARANTEED FOR 15 YEARS. MIRRORS MEET GOVERNMENT SPECIFICATIONS NO. DD-G-451.

GLAZING - THE ABOVE FRAME IS ALSO AVAILABLE WITH THE FOLLOWING SURFACES.

- B. TEMPERED GLASS IS 1/4" THICK POLISHED TEMPERED GLASS WITH TWO COATS OF SILVER, PROPERLY APPLIED. THE COVERING IS HERMETICALLY SEALED BY ELECTRO-PLATING WITH A HEAVY UNIFORM COATING OF COPPER. BACK OF MIRROR IS FINISHED AND PROTECTED WITH A THICK COAT OF HEAVY WATERPROOF PAINT, (FED. SPEC. DD-G-1403B
- C. METAL MIRRORS ARE STAINLESS STEEL POLISHED TO A MIRROR FINISH AND PROVIDED WITH ADDITIONAL HARDBOARD BACKING.


INSTALLATION - REAR LEGS OF MIRROR HAVE KEY HOLE SLOTS WITH INTEGRAL TAMPER-PROOF LOCKING DEVICES.


NOTES - TILTED MIRROR FOR WHEEL CHAIR PATIENTS IS AVAILABLE IN TWO SIZES

(406 mm) (762 mm) No. 535 - 16" WIDE BY 30" HIGH No. 535-A - 18" WIDE BY 36" HIGH (457mm) (914 mm)

MOUNTING SUGGESTIONS

33" FROM TOP OF FINISHED FLOOR TO BOTTOM OF MIRROR OR 3" ABOVE TOP OF WASH BASIN (76 mm) (838 mm)

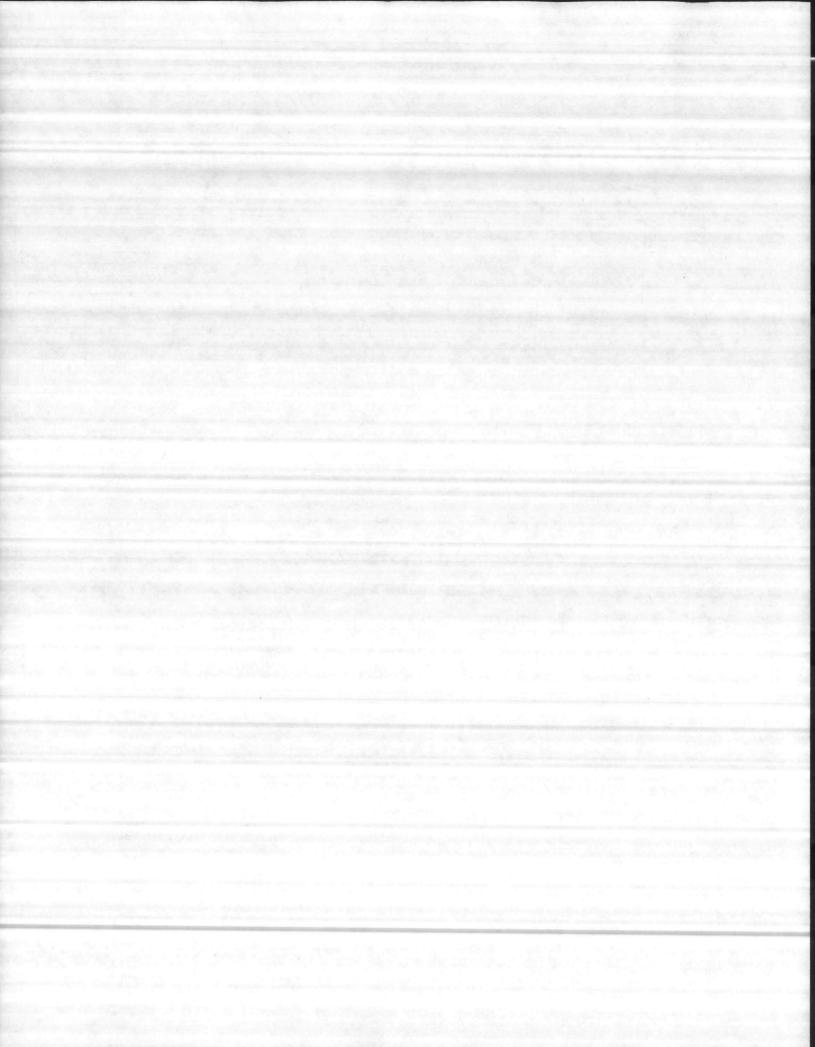

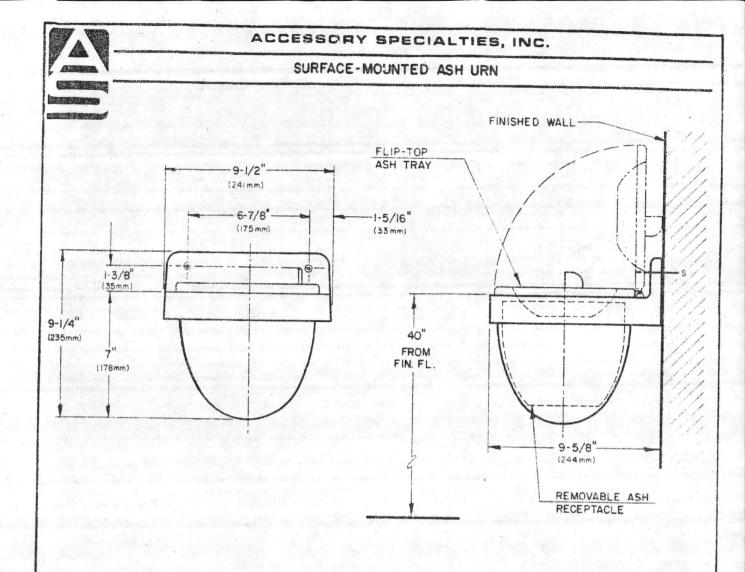

ELEVATION

END VIEW

SPECIFICATION -

FLIP-TOP ASH TRAY AND WALL URN SHALL BE FABRICATED OF #22 GAUGE, TYPE 304, STAINLESS STEEL WITH A SATIN FINISH. SEAMLESS ALUMINUM RECEPTACLE IS REMOVABLE FOR SERVICING. FLIP-TOP ASH TRAY IS SECURED TO WALL URN BY HINGE: VANDALPROOF, HEAVY-DUTY MOUNTING BRACKET IS FABRICATED OF ANODIZED ALUMINUM WITH & SATIN FINISH.

FOR BRONZETONE FINISH -ADD SUFFIX "A" "It is hereby certified that the (equipment) (material) shown and marked in this submittal is that proposed to be incorporated into Contract Number NS247081-C-176 (4s in compliance with the Contract drawings and specifications, can be installed in the allocated spaces, and is submitted Government

Certified by D.S. Date ____5-22-84

10/21/81

SURFACE-MOUNTED ASH URN

8095

