
ALTITUDE VALVE TO RAW WATER SYSTEM TO RAW WATER SYSTEM TO HAW WATER SYSTEM 17 1/2" OPEN HOLE CONCRETE WELL SEAL ELEVATION ELEVATION DEPARTMENT OF THE NAVY
MARINE CORPS BASE
CAMP LEJEUNE, NORTH CAROLINA WATER WELLS CAMP GEIGER SYSTEM WELL NO. TC 1001 WELL NO. TC 600 WELL NO. TC 700 WELL NO. TC 1000 EXISTING CONDITIONS PUMP CAPACITY 175 GPM
WELL YIELD 170 GPM
DATE INSTALLED 1941 PUMP CAPACITY 200 GPM
WELL YIELD 195 GPM
DATE INSTALLED 1941 PUMP CAPACITY 130 GPM WELL YIELD 130 GPM 1941 PUMP CAPACITY 200 GPM
WELL YIELD 100 GPM
DATE INSTALLED 1941 PUMP CAPACITY 110 GPM
WELL YIELD 110 GPM
DATE INSTALLED 1941 DATE 31 AUG 84 SCALE NONE SHEET 18 of 21 00000122

1 · 1

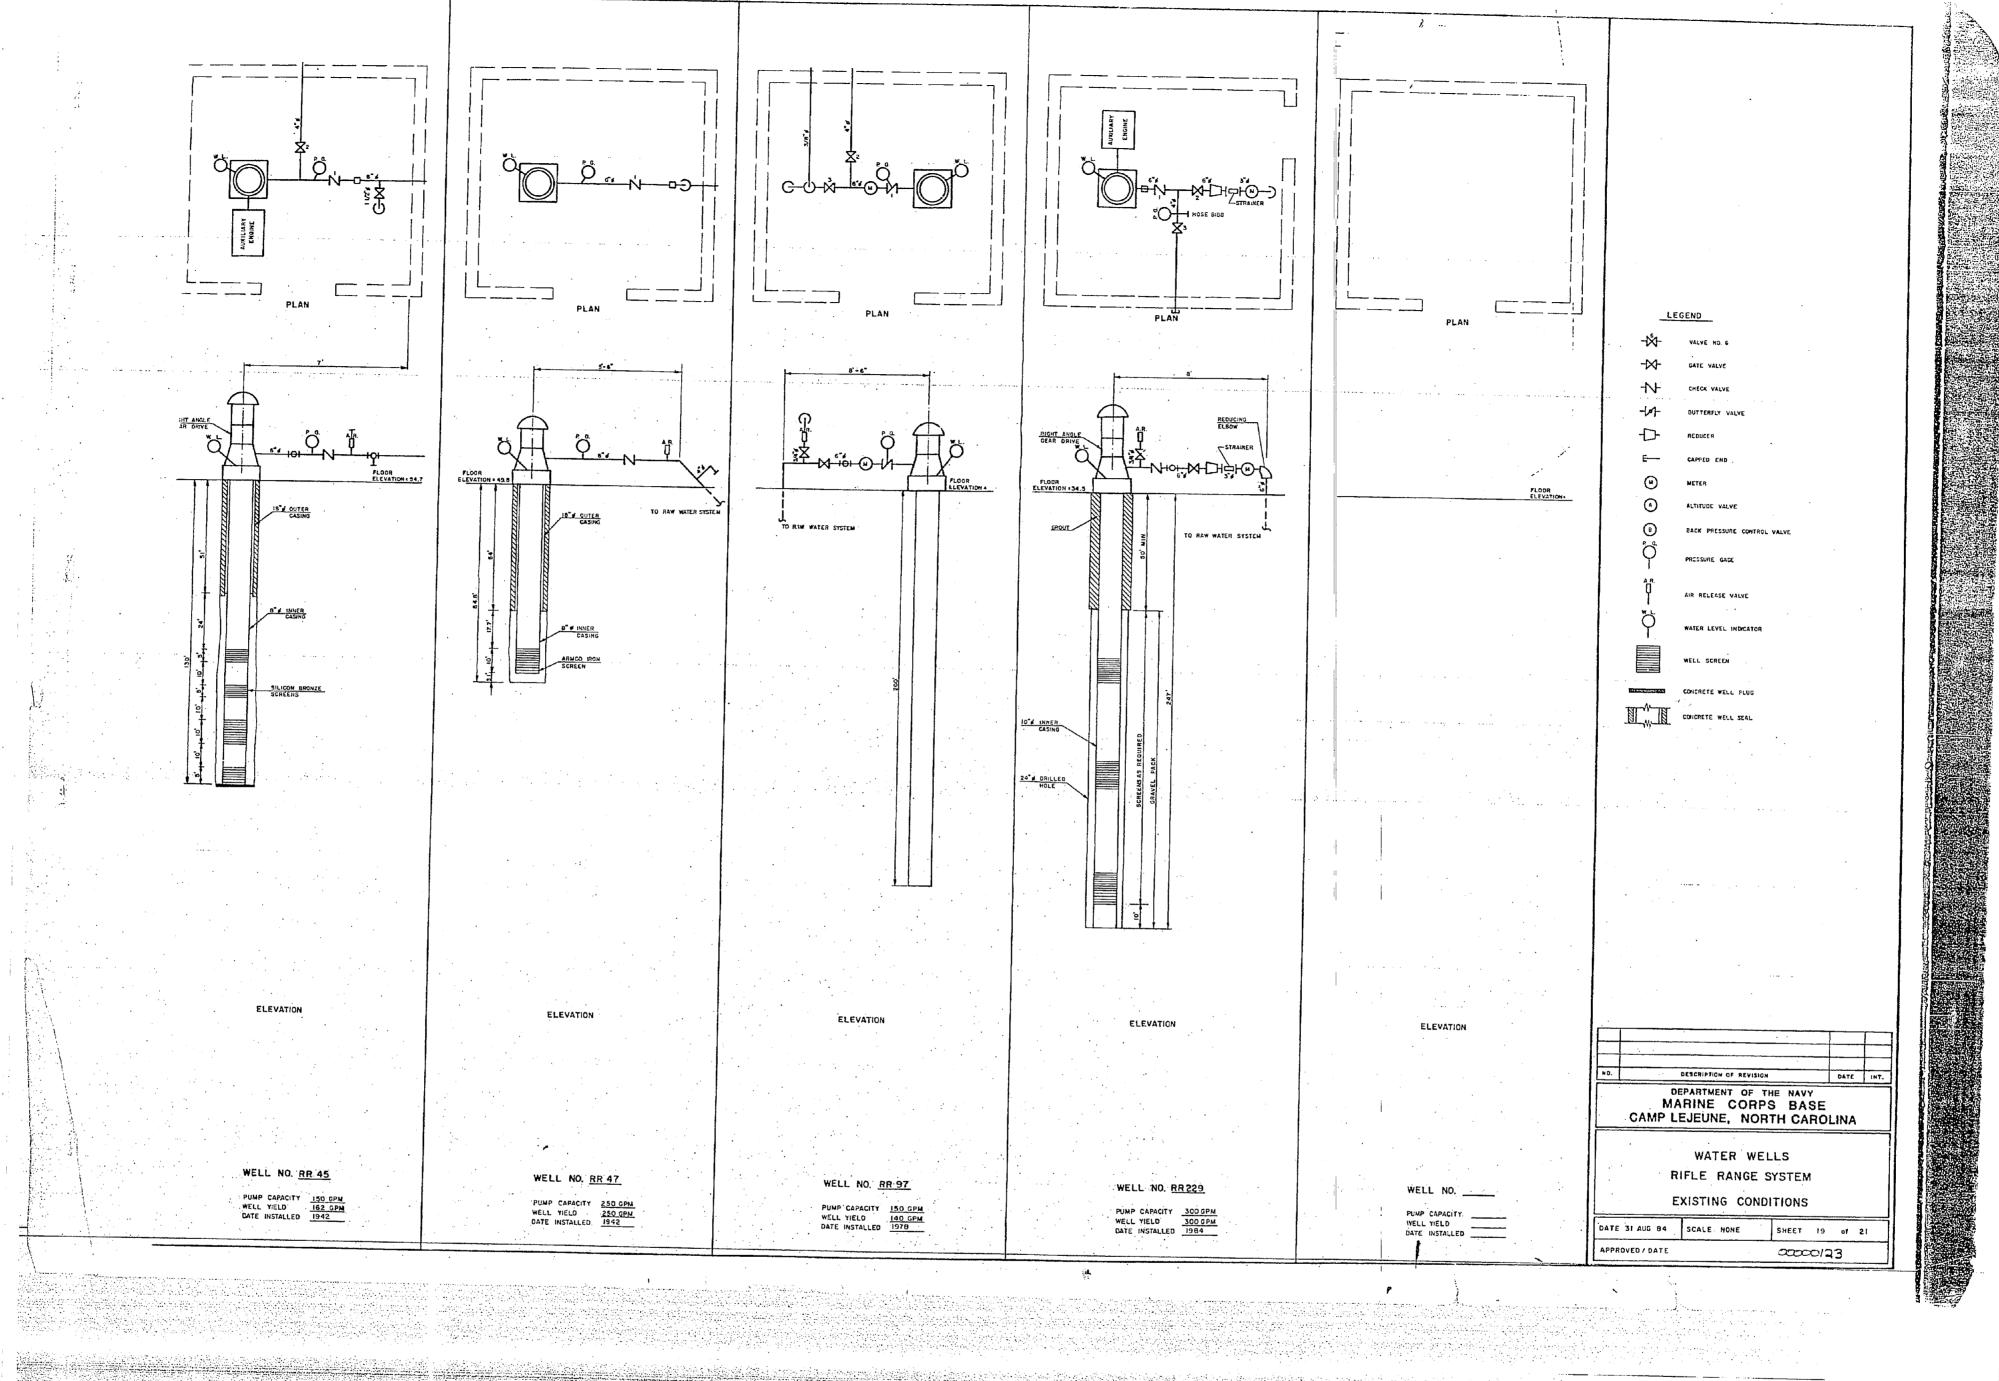

1 L

A A A

1 1

1 · 1