


0162



UNITED STATES MARINE CORPS
MARINE CORPS BASE
CAMP LEJEUNE, NORTH CAROLINA 28542

IN REPLY REFER TO
NREAD/DDS/th
11300

JUN 1 1983

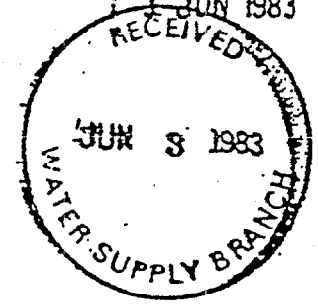

Mr. Charles E. Rundgren, Head
Water Supply Branch
Division of Health Services
Post Office Box 2091
Raleigh, North Carolina 27602-2091

Dear Mr. Rundgren:

Enclosed are results of Inorganic Chemical and Corrosivity Analyses conducted during 1982 for all eight water treatment plants aboard Marine Corps Base, Camp Lejeune, as required by the Safe Drinking Water Act. Also enclosed is a table showing the construction materials used in each distribution system.

The laboratory analysis was run by Grainger Laboratories, Incorporated, Raleigh, North Carolina. The field analyses (temperature and pH) were run by personnel of the Quality Control Laboratory located in the Natural Resources and Environmental Affairs Division, Assistant Chief of Staff, Facilities. Ms. Elizabeth Betz, Quality Control Laboratory, telephone (919) 451-5977, is the point of contact in this matter.

Sincerely,

J. T. MARSHALL
Colonel, U. S. Marine Corps
Assistant Chief of Staff, Facilities
By direction of the Commanding General

- Encl:
- (1) Inorganic Chemical Results
 - (2) Corrosivity Results
 - (3) Construction Materials System

Copy to:
CMDR, NAVFACENCOM (Code 114)

CLW


0000000934

INORGANIC CHEMICAL RESULTS (mg/l) FOR SERIAL NO. 04-67-041 thru 048

Parameter	Method	Containment Code								
			041	042	043	044	045	046	047	048
Arsenic	123	1005	0.002	0.002	0.002	0.002	0.002	0.002	0.002	0.002
Barium	101	1010	0.01	0.04	0.03	0.01	0.04	0.04	0.01	0.01
Cadmium	101	1015	0.0011	0.0005	0.0005	0.0005	0.0005	0.0005	0.0011	0.0005
Chromium	101	1020	0.003	0.003	0.003	0.003	0.017	0.004	0.003	0.003
Fluoride	107	1025	0.994	0.24	0.856	1.00	0.139	0.126	0.109	0.146
Lead	101	1030	0.01	0.02	0.01	0.01	0.01	0.01	0.01	0.01
Mercury	103	1035	0.002	0.002	0.002	0.002	0.002	0.002	0.002	0.002
Nitrate (N)	109	1040	0.17	0.05	0.11	0.05	0.05	0.05	0.11	0.05
Selenium	123	1045	0.002	0.002	0.002	0.002	0.002	0.002	0.002	0.002
Silver	101	1050	0.001	0.001	0.001	0.001	0.001	0.001	0.001	0.001
Iron	101	1028	0.045	0.338	0.037	0.020	0.673	0.544	0.536	0.556
Manganese	101	1032	0.002	0.004	0.002	0.006	0.015	0.030	0.011	0.025
Sodium	101	1052	20.7	79.8	24.4	19.8	81.9	88.7	81.5	66.4

All Samples Collected (Except Sodium): 29 September 1982
 Sodium Samples Collected: 3 September 1982

All Results Run by Grainger Laboratories (ID# 37709)

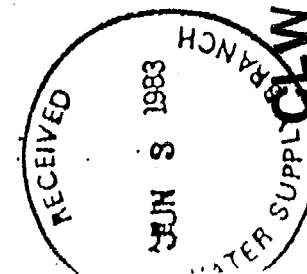

000000935


CORROSIVITY RESULTS FOR SERIAL NO. 04-67-041 thru 048

<u>PARAMETER</u>	<u>METHOD</u>	<u>CONTAMINANT CODE</u>	<u>041</u>	<u>042</u>	<u>043</u>	<u>044</u>	<u>045</u>	<u>046</u>	<u>047</u>
pH	135	1925	8.8	7.6	8.2	8.2	7.1	8.0	7.9
Temperature °C	130	1996	20.0	20.0	19.0	20.0	20.0	23.0	21.0
Total Alkalinity as CaCO ₃ mg/l	142	1927	51.9	136	82.3	76.4	166	151	164
Total Filterable Residue mg/l	139	1930	106	320	10	152	126	230	246
Calcium As CaCO ₃ mg/l	101	1919	40.9	48.0	56.1	101	41.9	44.3	50.0
Stability Index (Langelier)	140	1910	0.25	-0.59	0.03	0.19	-0.95	0.06	-0.12

All samples collected: 3 September 1982

pH & temperature run by Quality Control Laboratory (ID #37807)

The rest of the results run by Grainger Lab (ID #37709)

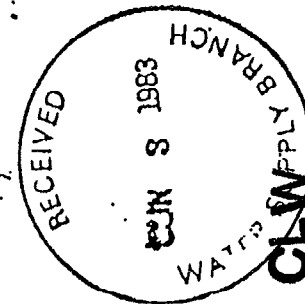

000000936

GENERAL SYSTEM INFORMATION FOR INORGANIC CHEMICAL - CORROSIVITY
MONITORING ABC&D MARINE CORPS BASE, CAMP LEJEUNE

All system types are: Community

All sources of water are: Ground

All sample sources are: Plant Tap

All sample types are: D-Regular

TYPE OF TREATMENTS

<u>SYSTEM #</u>	<u>CHLORINATED</u>	<u>FLUORIDATED</u>	<u>FILTERED</u>	<u>LIME</u>	<u>WATER SOFTENER</u>
04-67-041	X	X	X	X	X
04-67-042	X		X	X	X
04-67-043	X	X	X	X	X
04-67-044	X	X	X	X	X
04-67-045	X				X
04-67-046	X		X	X*	X
04-67-047	X		X	X*	X
04-67-048	X		X		X

* For pH Control

CLW

000000937